LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/17/2023 Expiration Date: 08/16/2024

Property Owner: Larry Goitia

Mailing Address: [redacted]

Telephone: [redacted] E-mail:

Installer: Ricky Peterson License #: 92

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system.

Parcel Description:

Legal: S13, T35 N, R26 W, COS 4178, PARCEL C, ACRES 40.27

Property Address: 758 Mill Site Dr., Eureka, MT 59917 Assessment Code: 12024

DEQ COSA: EQ# Date:

Approved Design Criteria: Installation of new gravity system with 4 laterals@84' with reduction given for chambers.

# of Bedrooms: 3 Septic Tank Size: 1000 gallon Trench Width: 24"

# of Laterals: 4 Length of Laterals: 84' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reductions given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, S97

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

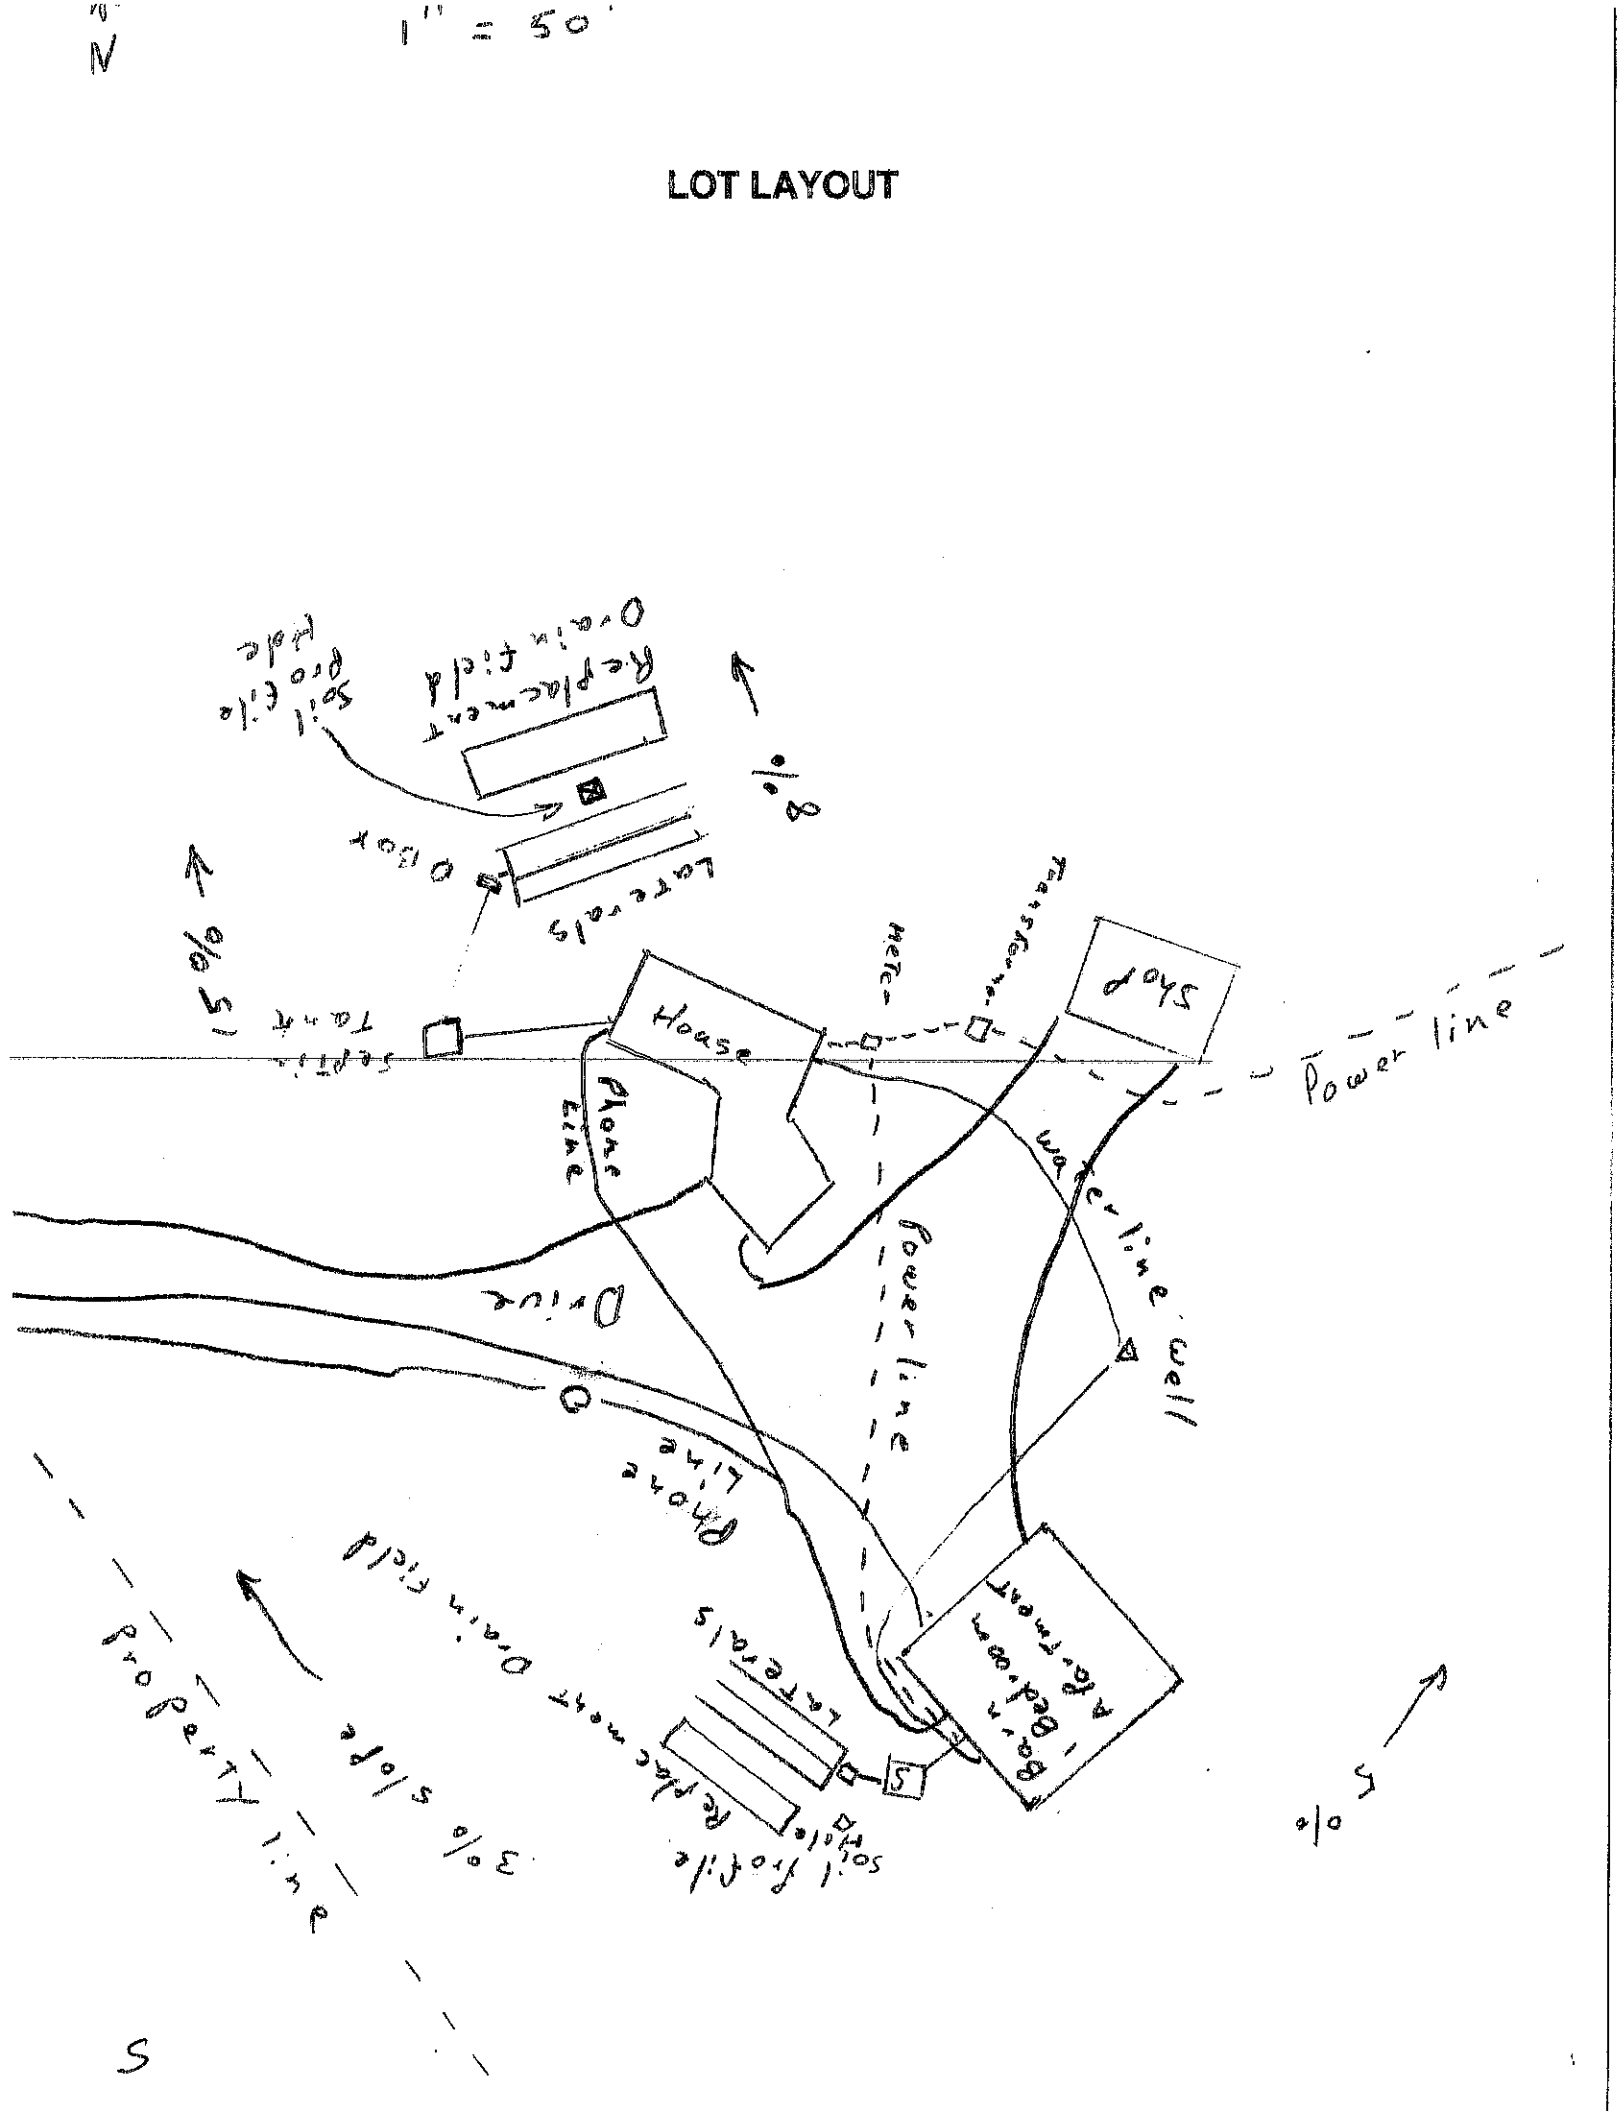
Signed: Robin Blumberg *Date:* 10/18/23

__✓__ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


N
1" = 50'
Power line
House
Shop
Here -
Transformer
Septic Tank
Plant Line
Drive
Power line
Water line well
Phone Line
Laterals
Re placement field
Soil profile hole
Open field
8%
5%
3% slope
Existing road
Boarding Apartment
Laterals
Re placement field
Soil profile hole
5%
S