LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Permit #24-15208

Issue Date: 07/08/2024 Expiration Date: 07/07/2025

Property Owner: Jeremy and Jason Hageness

Mailing Address: [redacted]

Installer: Paul Dalziel License #: 175

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for 3 Bedroom House.

Parcel Description:

Legal: S06, T36 N, R31 W, COS 4834, PARCEL B, ACRES 40.02

Property Address: 36996 Yaak River Rd., Troy, MT 59935 Assessment Code: 15208

DEQ COSA: EQ.# Date:

Approved Design Criteria: Installation of new pressure dosed system for 3 Bedroom House with 3 Laterals @ 75' shallow capped absorption trenches. Minimum distance of drainfield to river 140'.

# of Bedrooms: 3 Septic Tank Size: 1000/500 gallons Trench Width: 36"

# of Laterals: 3 shallow capped absorption trenches Length of Laterals: 75' Trench Depth: 12"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, R.S.

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

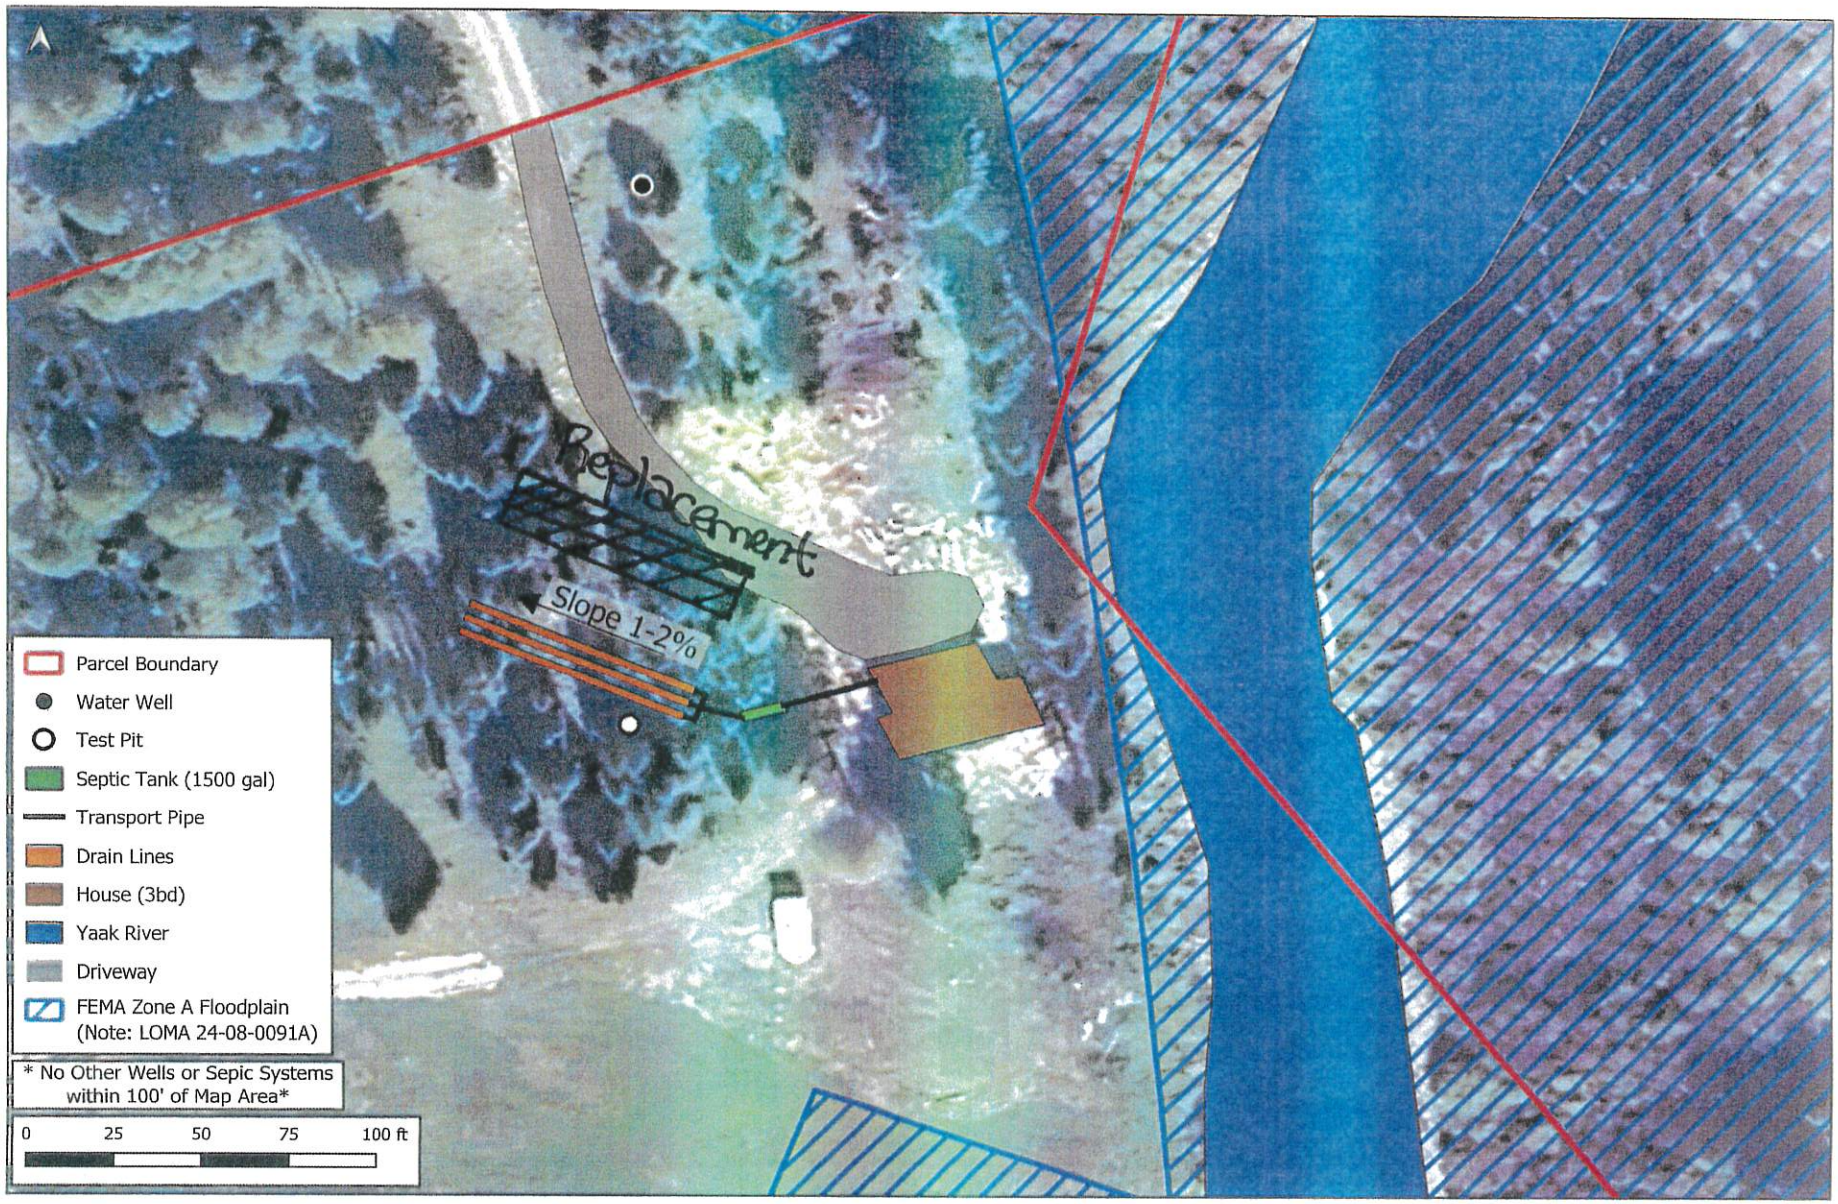
Signed: Robin Blumberg *Date:* 7/30/24

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

SV


Replacement
Slope 1-2%
Parcel Boundary
Water Well
Test Pit
Septic Tank (1500 gal)
Transport Pipe
Drain Lines
House (3bd)
Yaak River
Driveway
FEMA Zone A Floodplain
(Note: LOMA 24-08-0091A)
* No Other Wells or Sepic Systems within 100' of Map Area*
0
25
50
75
100 ft