LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/27/2022 Expiration Date: 10/26/2023

Property Owner: Michael Hayden

Mailing Address: [redacted]

Telephone: [redacted] Email:

Installer: ~~Homeowner~~ Tony Barzet License #: 26

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Gravity system with standard trenches, 3 @75' laterals using drain rock and pipe.

Parcel Description:

Legal: MAHONEY'S SUBURBAN ADDN, S32, T31 N, R31 W, BLOCK 003, Lot 5, ACRES 1.2865

Property Address: 112 Pioneer Rd Libby MT 59923 Assessment Code: 8905

Approved Design Criteria:

# of Bedrooms: 2 Septic Tank Size: 1000 gallons Trench Width: 24 inches

# of Laterals: 3 Length of Laterals: 75 feet Trench Depth: 24-36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT. Variance for trench separation approved 7/11/23.

Issued By: Kathi J. Hooper, R.S.

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

I, Robin Blumberg *, have inspected this system and found it to be in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 8/7/23

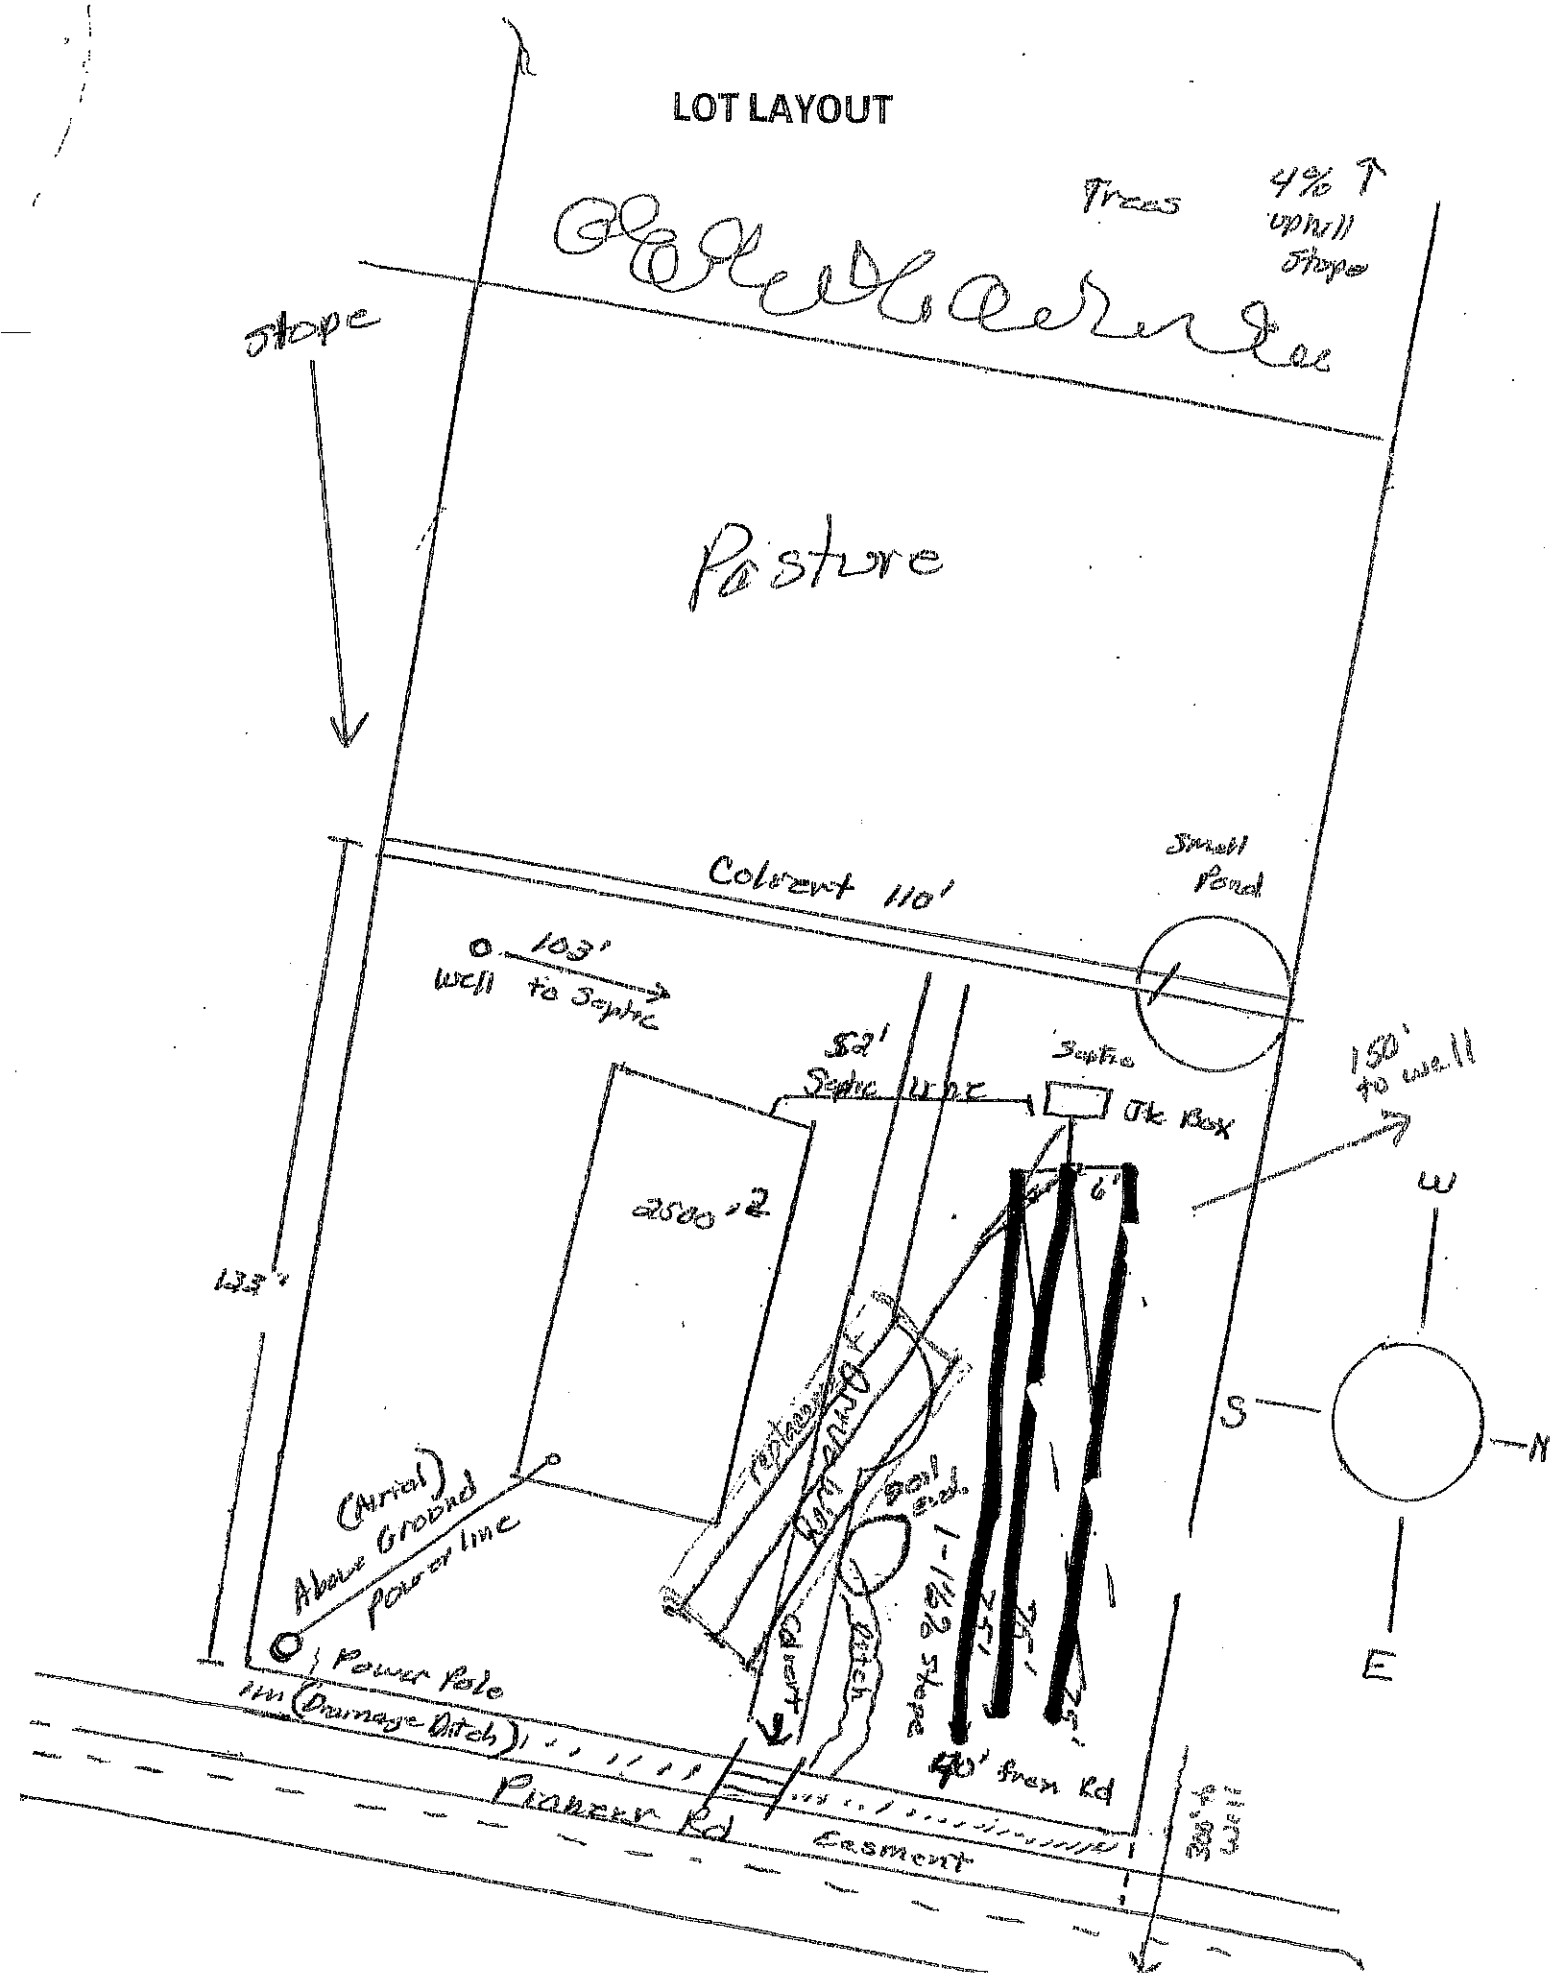
✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

✓

LOT LAYOUT


Trees
4% ↑ uphill slope
Slope
Pasture
Culvert 110'
Small Pond
103' well to Septic
52' Septic line
Septic Tk Box
150' to well
2500 ± 2
133'
6'
W
S
N
E
(Aerial) Above Grade power line
Power Pole
Ditch (Drainage Ditch)
Pioneer Rd
Easement
40' from Rd
1-1½ Slope
Ditch
Soil end.
Soil end.
330' ± 33'