Permit # 24-53752

LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/06/2024 Expiration Date: 06/05/2025

Property Owner: Christopher & Josie Hermes

Mailing Address: [redacted]

Installer: Logan Munts License #: 160

Approved Work: (Check One) ☐ New Installation ☐ Existing System

☒ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of gravity system 3 Laterals @ 85'.

Legal: VAN DYKE HOMESTEAD, S34, T31 N, R33 W, ACRES 8, LOT 5B PM 6528 in NE

Property Address: 148 Van Dyke Dr Troy, MT 59935 Assessment Code: 53752

DEQ COSA: E.Q.# 04-2085 Van Dyke Homestead Date: February 26, 2004

Approved Design Criteria: Installation of replacement for gravity system, 3 Laterals @ 85' with reduction for chambers.

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 3 Length of Laterals: 85' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Kathi Hooper, RS

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

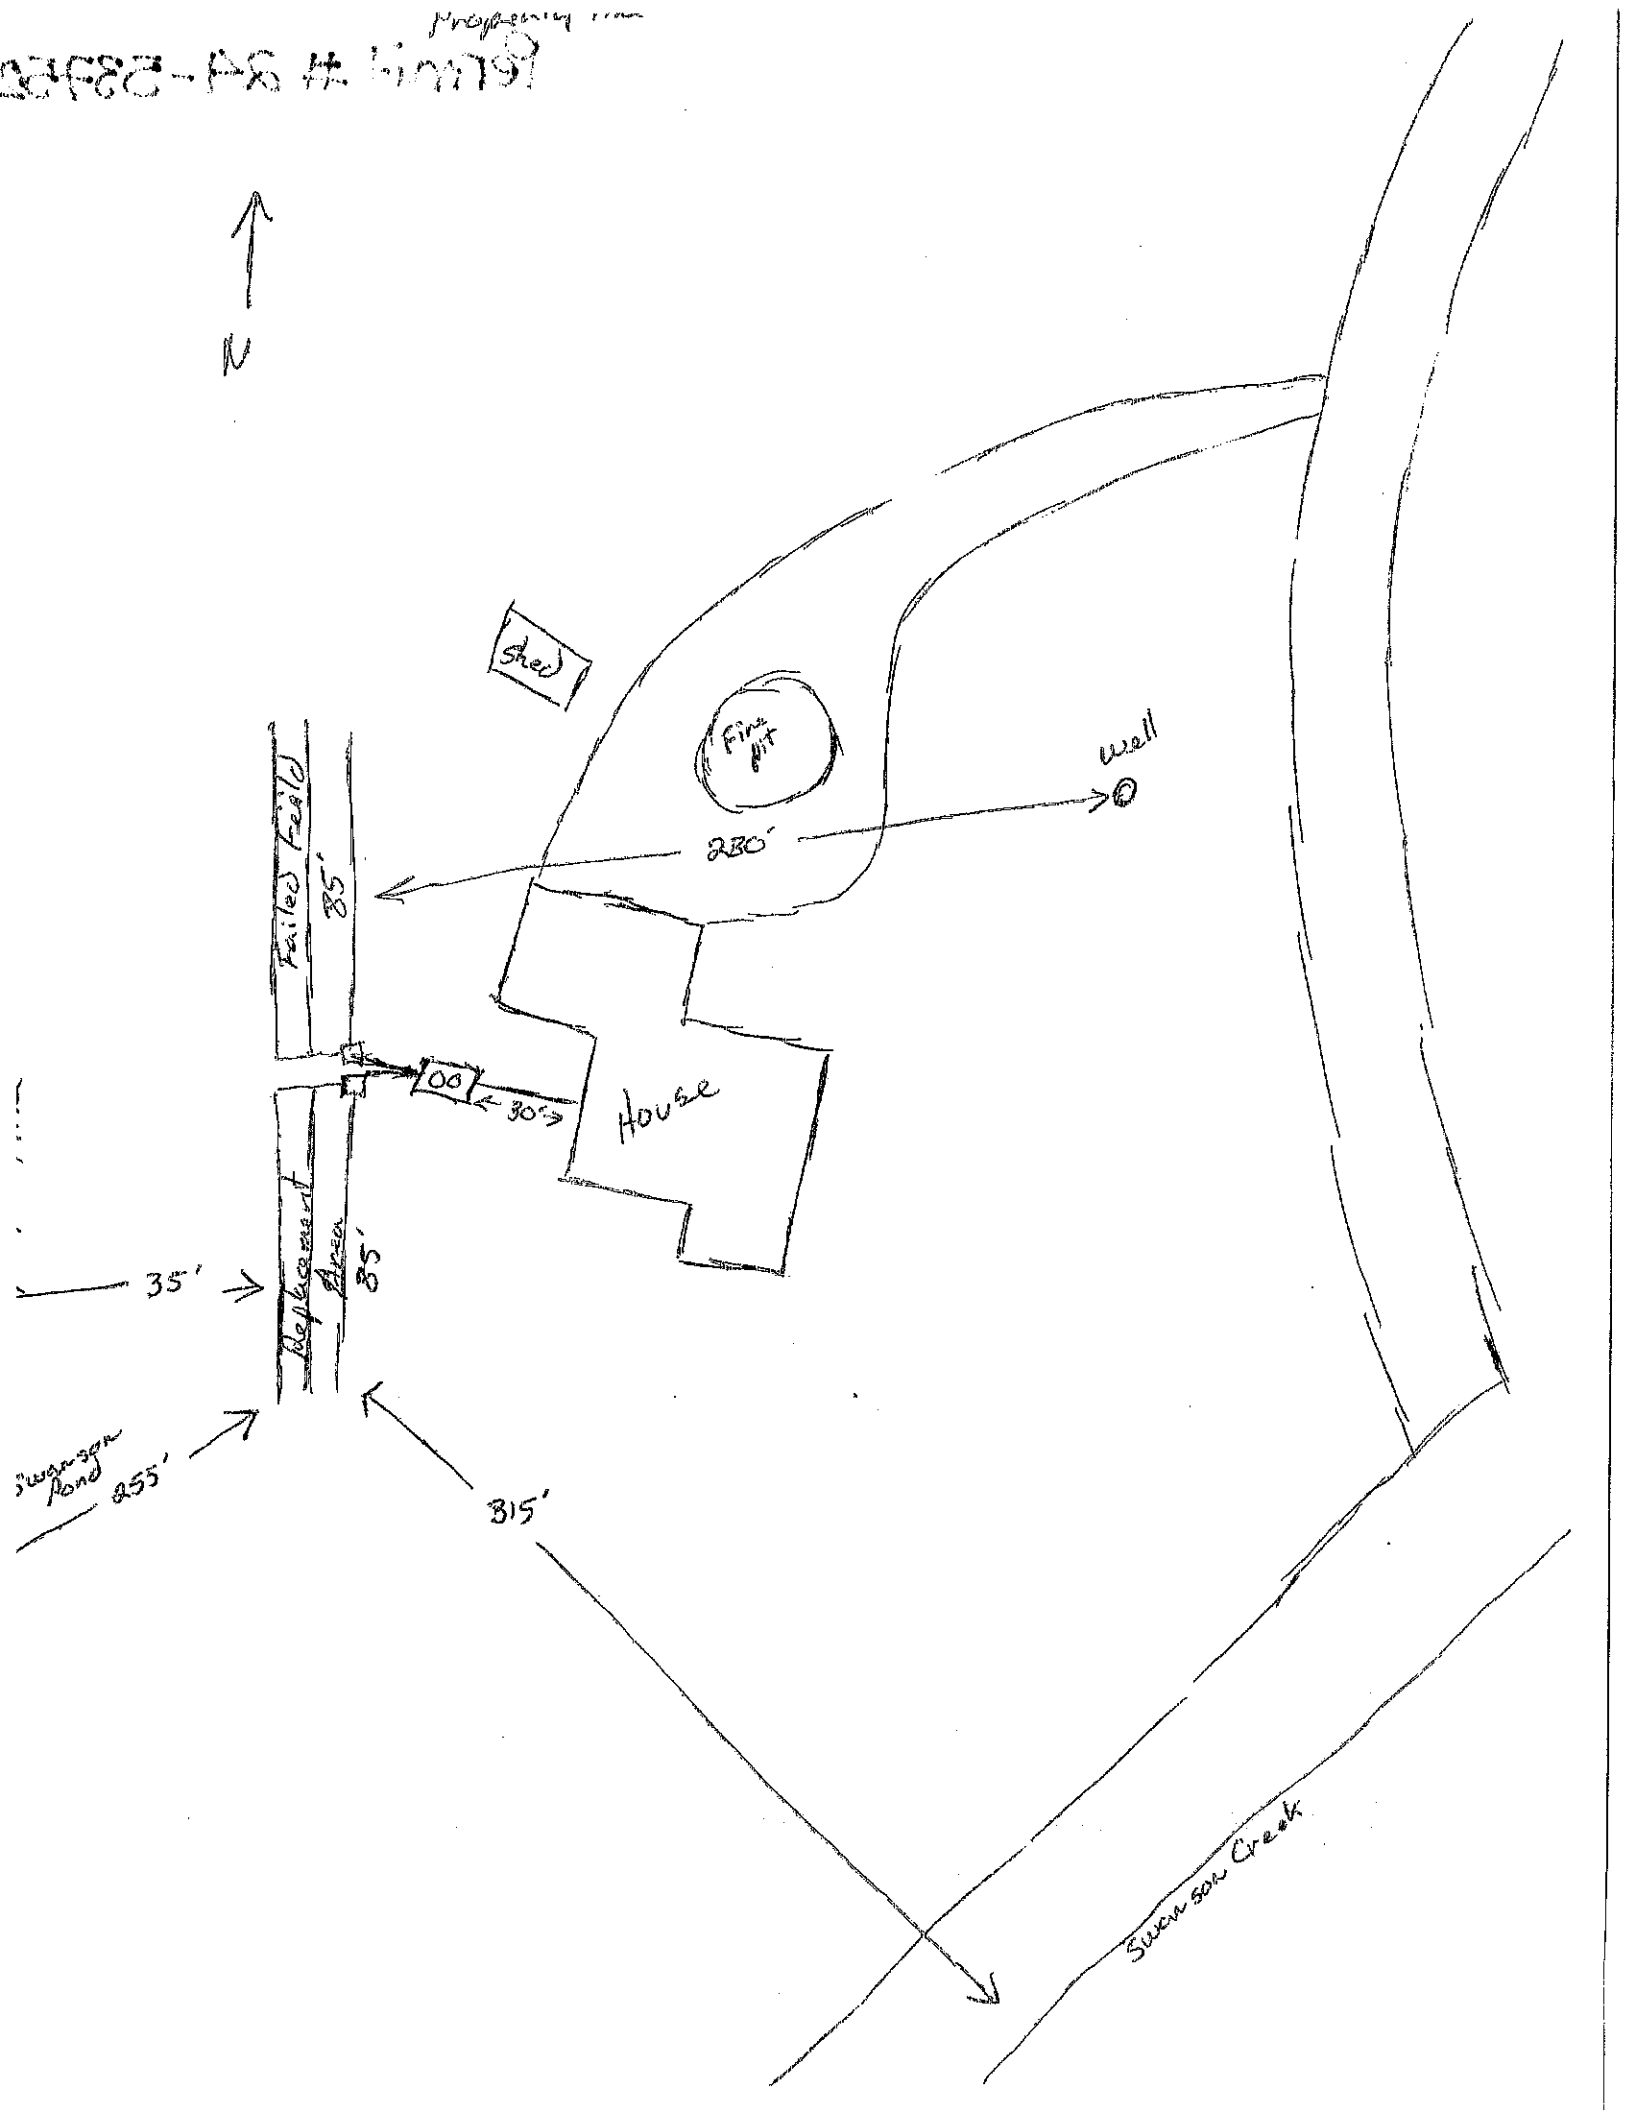
Signed: Robin Palmer *Date:* 6/19/24

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

SA


N
Shed
Fire pit
well
280'
Failed field
85'
House
30'
35'
Replacement Area
85'
315'
Swanson Creek