LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/08/2023 Expiration Date: 08/07/2024

Property Owner: Mary and Frank Hinkle

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Cory Persson License #: 197

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new septic system.

Parcel Description:

Legal: S15, T37 N, R27 W, C.O.S. 4457, PARCEL TRACT 2, ACRES 2.32

Property Address: 442 Sophie Dr. Eureka, MT 59917 Assessment Code: 15801

DEQ COSA: EQ#17-1115 Date: 10/17/2016

Approved Design Criteria: Installation of new septic system.

# of Bedrooms: 3 Septic Tank Size: 1000 gallon Trench Width: 24"

# of Laterals: 3 Length of Laterals: 84' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, SIT

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 9/22/23


✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

447 sophie drive Frank Hinkle 406 249 4522

copy 406 249 4523

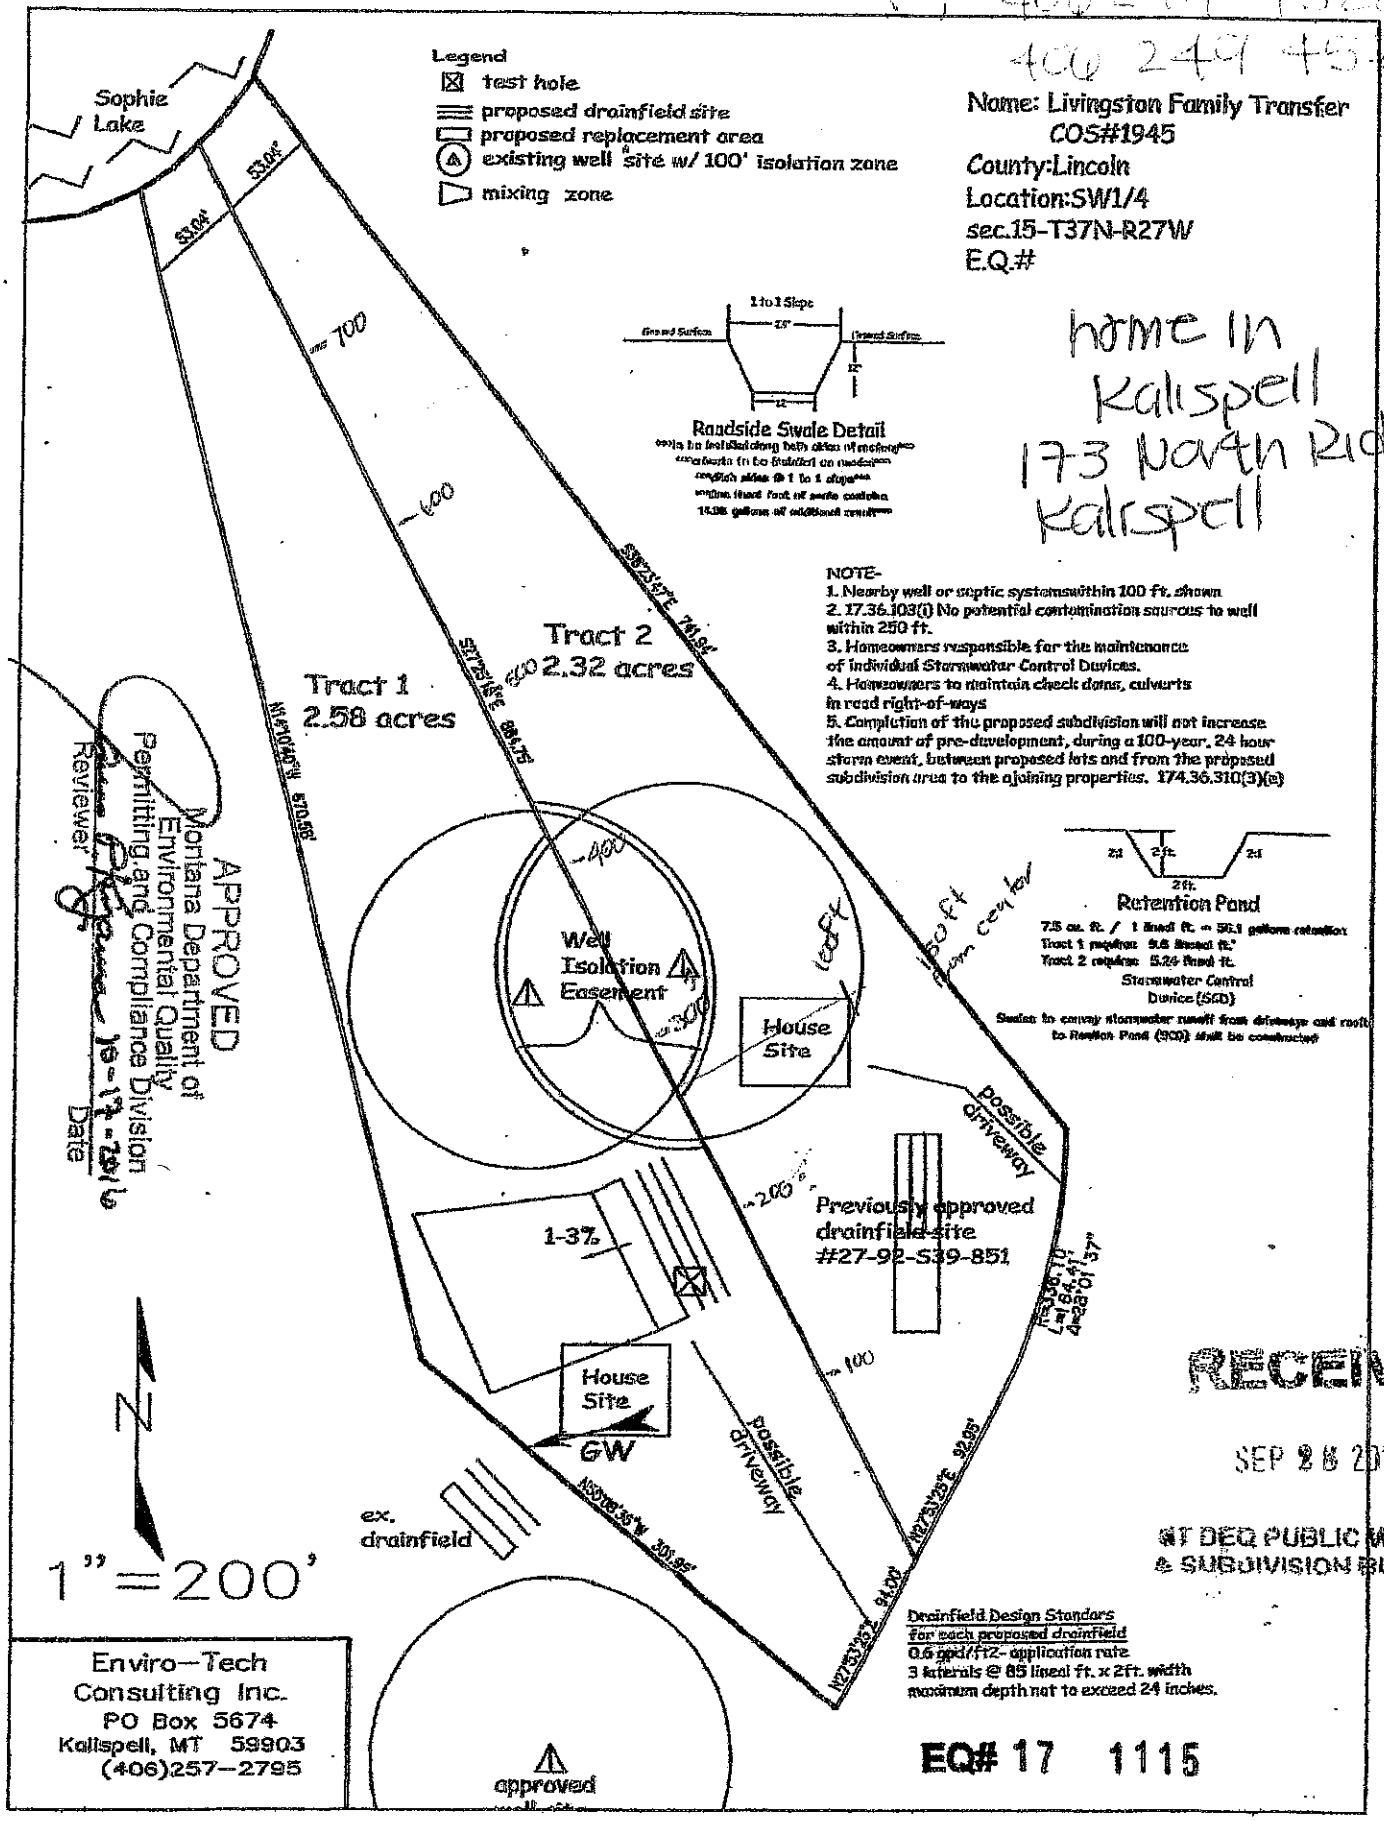

home in Kalispell
173 North Riding Rd
Kalispell

APPROVED
Montana Department of Environmental Quality
Permitting and Compliance Division
Reviewer
Date 10-17-2016

RECEIVED
SEP 28 2016
MT DEQ PUBLIC WATER & SUBDIVISION BUREAU

Enviro-Tech Consulting Inc.
PO Box 5674
Kalispell, MT 59903
(406)257-2795