LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Permit # 23-55448

Issue Date: 07/03/2023 Expiration Date: 07/02/2024

Property Owner: Tracey Huizer

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Bobbie Jo Sprague License #: 182

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of gravity system for one RV.

Parcel Description:

Legal: BLANKERS 93 NORTH, S12, T37 N, R27 W, LOT 3, ACRES 1.578, PM 6853

Property Address: 78 Tanner Ln., Eureka, MT 59917 Assessment Code: 55448

DEQ COSA: EQ#07-2096 Date: 08/09/07

Approved Design Criteria: Installation of new gravity system for one RV Pad.

# of Bedrooms: 1 RV Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 1 Length of Laterals: 100' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, SIT

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 8/14/23

____ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

Blankers 93 North Subdivision
S12 T37N R27W


EQ#07-2076
APPROVED
Montana Department of
Environmental Quality
Permitting and Compliance Division
Barbara Kinsey 8/2/07
Date
By Signed

N

1"=100'

● = Perc + Test hole
= Proposed well w/ 100' isolation Zone
= 200' Mixing Zone
= Stormwater ditch
xxxx = Straw bales
D/W = Driveway
No wells or septics w/in 100'
No floodplane issues
= 20'x30'x2' Retention Pond

LOTS 1-3 Exempt per:
17.36.605.2(6)(i)

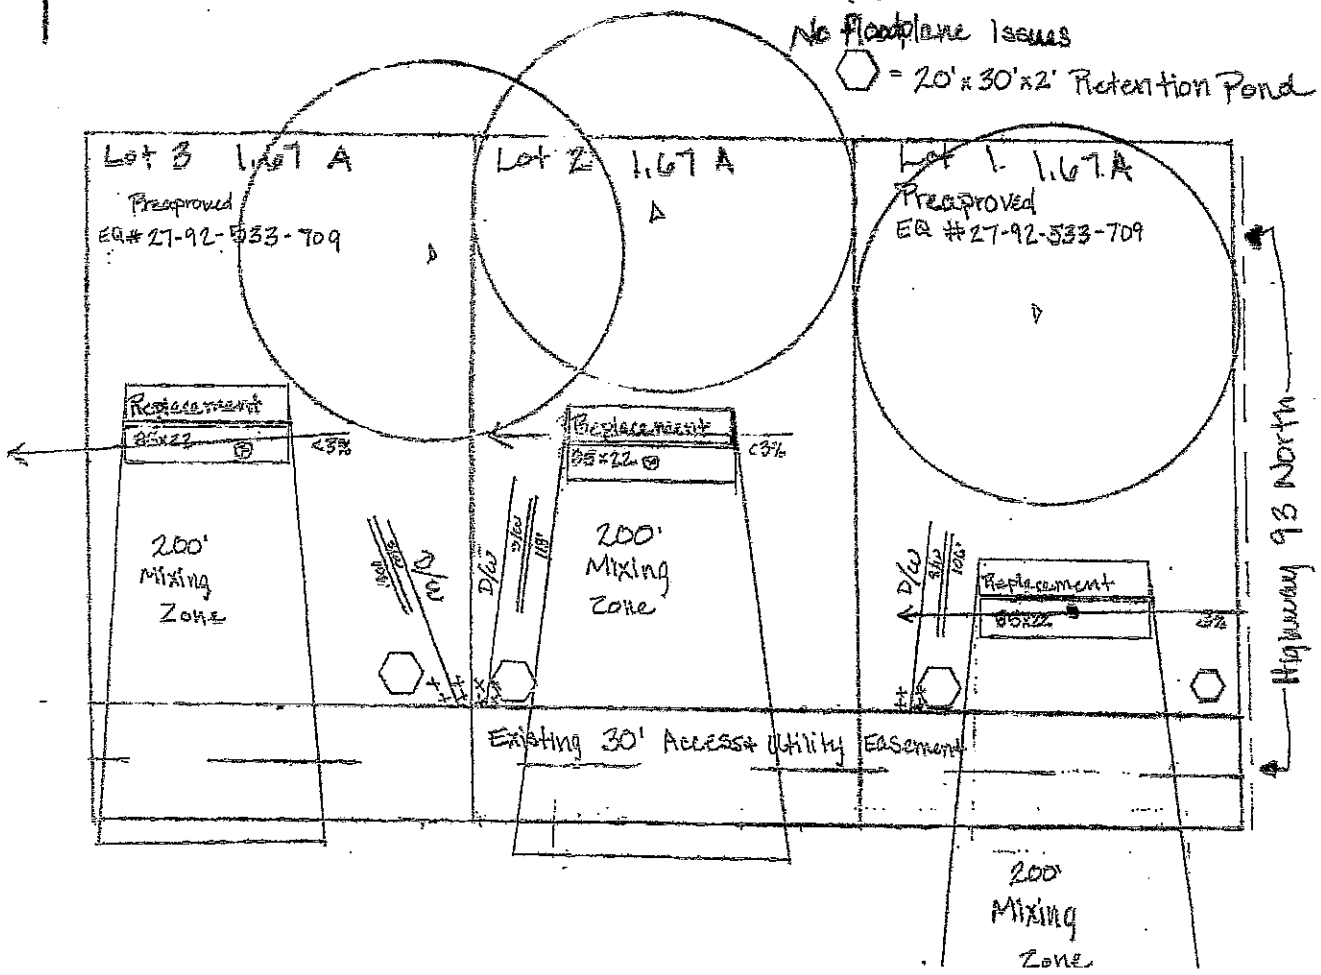

Renkenia² Inc