LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 09/18/2023 Expiration Date: 09/17/2024

Property Owner: John Kaemmerling

Mailing Address: [redacted]

Telephone: [redacted] E-mail:

Installer: Patriot Property Services License #: 196

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of pressure dosed system with 3 laterals@34' and reduction for chambers.

Parcel Description:

Legal: ISLAND LAKE, S31, T29 N, R26 W, LOT1, ACRES 29.493, PM #6241

Property Address: Island Lake Assessment Code: 53985

DEQ COSA: EQ# Date:

Approved Design Criteria: Installation of pressure dosed system with 3 laterals@34' and reduction for chambers. Minimum of 500' from lake.

# of Bedrooms: 2 Septic Tank Size: 1000/500gallon Trench Width: 36"

# of Laterals: 3 Length of Laterals: 34' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, SIT

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

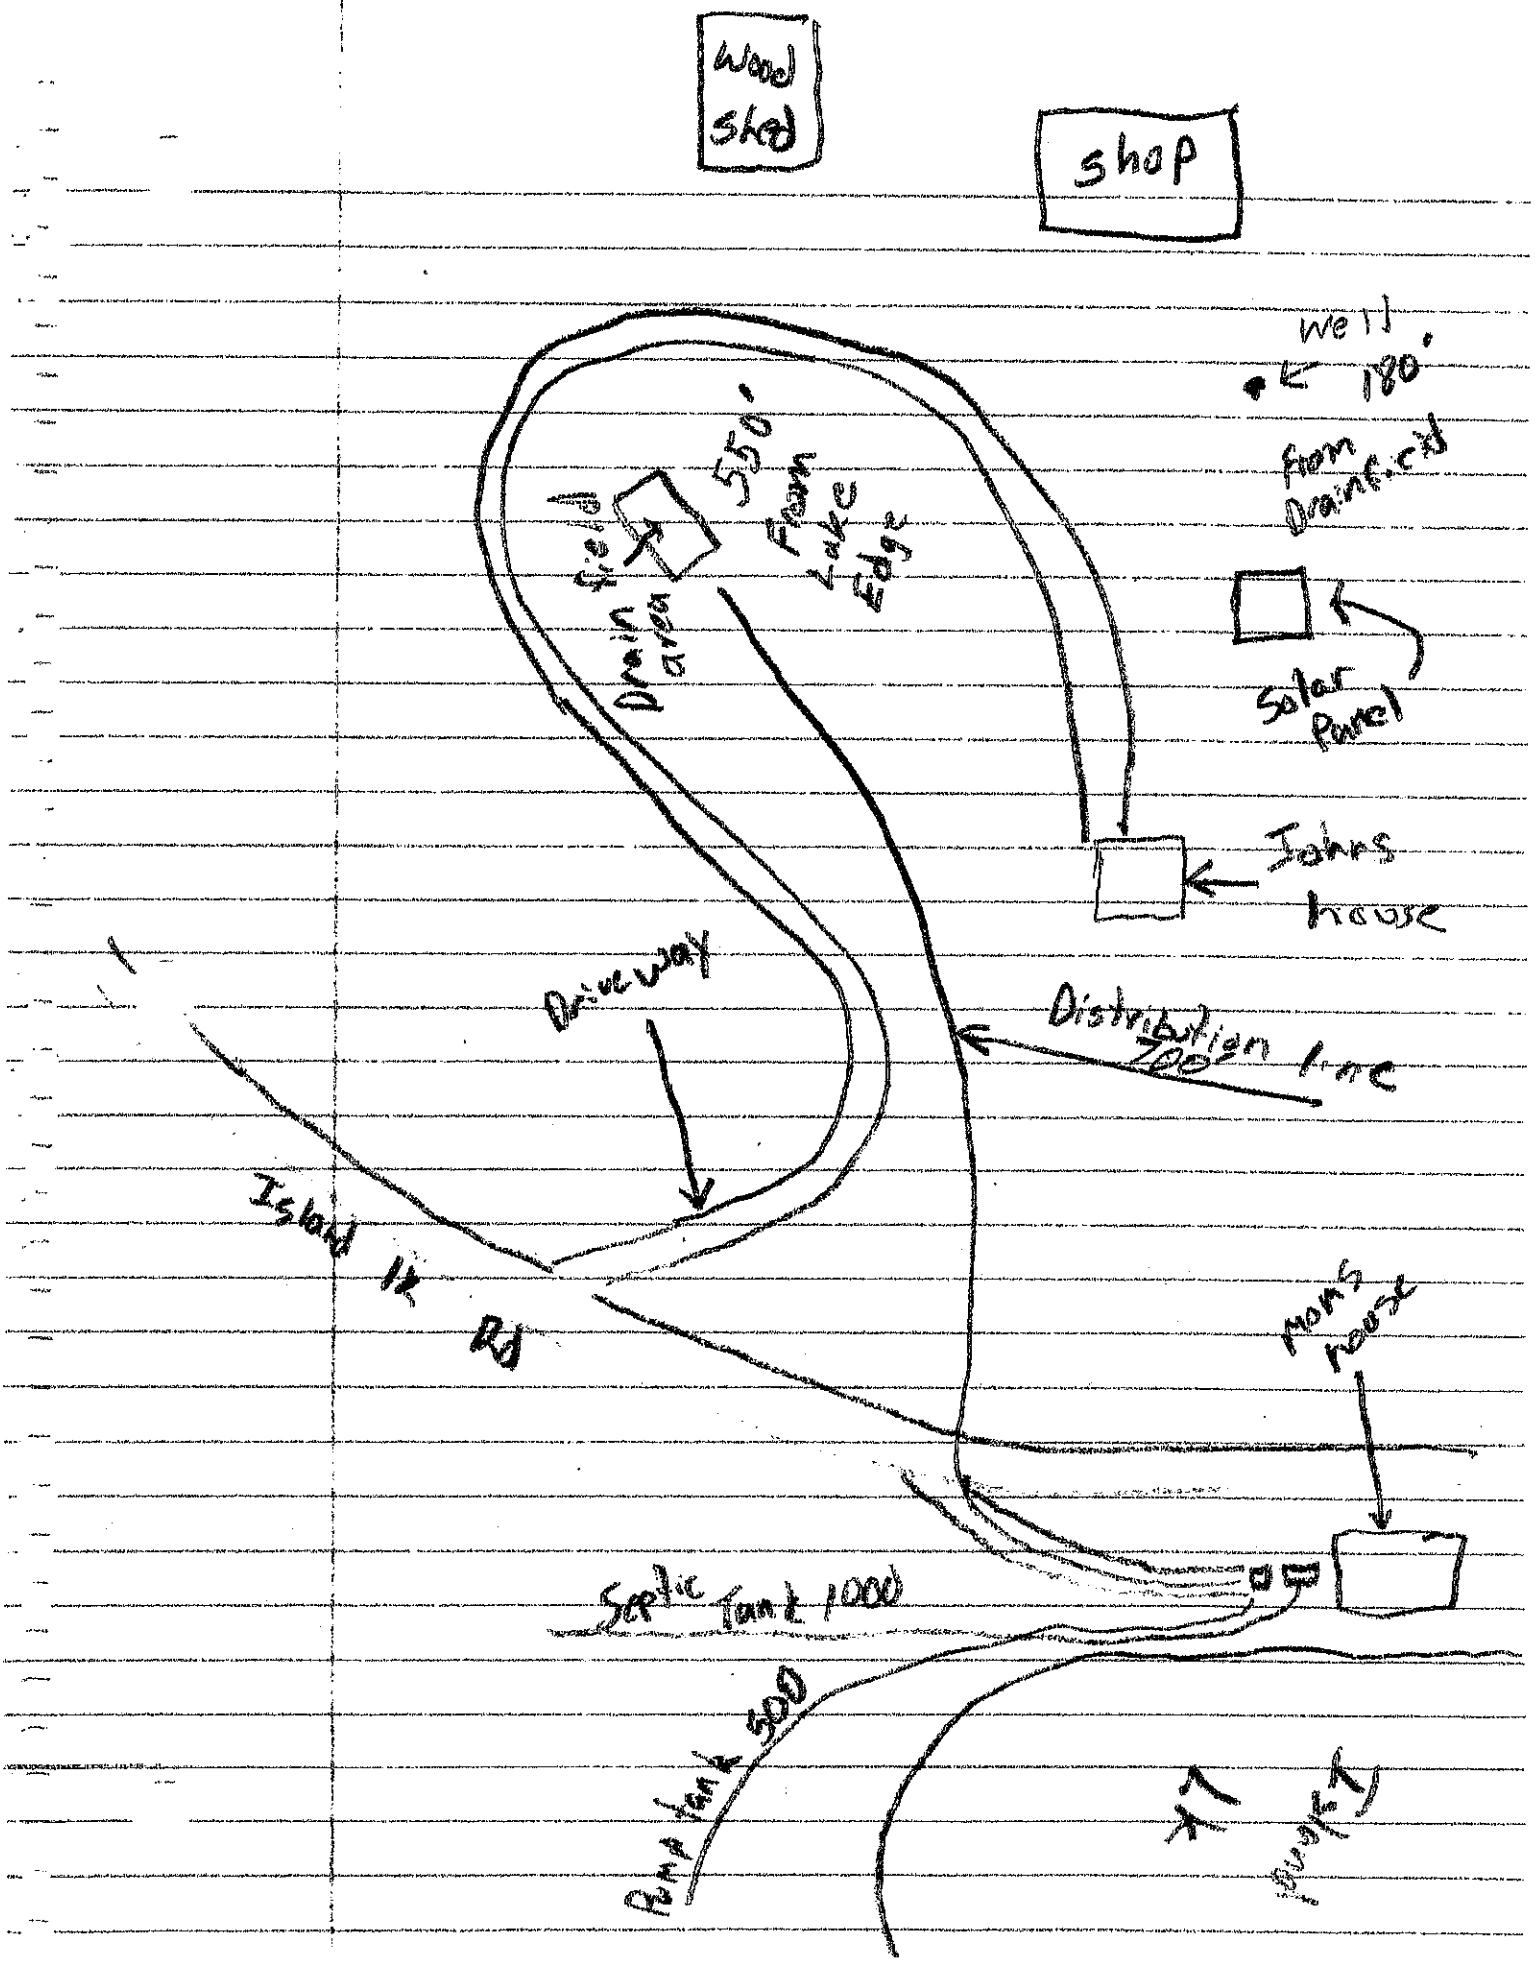
Signed: John Kaemmerling *Date:* 12/21/23

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV


Wood shed
shop
well
180'
from district
550' from Lake Edge
Drain area
Solar Panel
Johns house
Driveway
Distribution Box
Distribution Line
Island Rd
moms room
Septic Tank 1000
Pump tank 500