LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/17/2023 Expiration Date: 08/16/2024

Property Owner: Stephen Kostoff

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Kootenai Sand and Gravel License #: 109

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system.

Parcel Description:

Legal: S12, T36 N, R26 W, COS 4541, PARCEL3A, ACRES 21

Property Address: 315 St. Clair Ridge Rd. Eureka, MT 59917 Assessment Code: 55835

DEQ COSA: EQ# Date:

Approved Design Criteria: Installation of new gravity system with 5 laterals @100'. DF sized to add future 3 bedroom house with existing 1 bedroom cabin.

# of Bedrooms: 4 Septic Tank Size: 1000 gallon Trench Width: 24"

# of Laterals: 5 Length of Laterals: 100' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, SIT

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

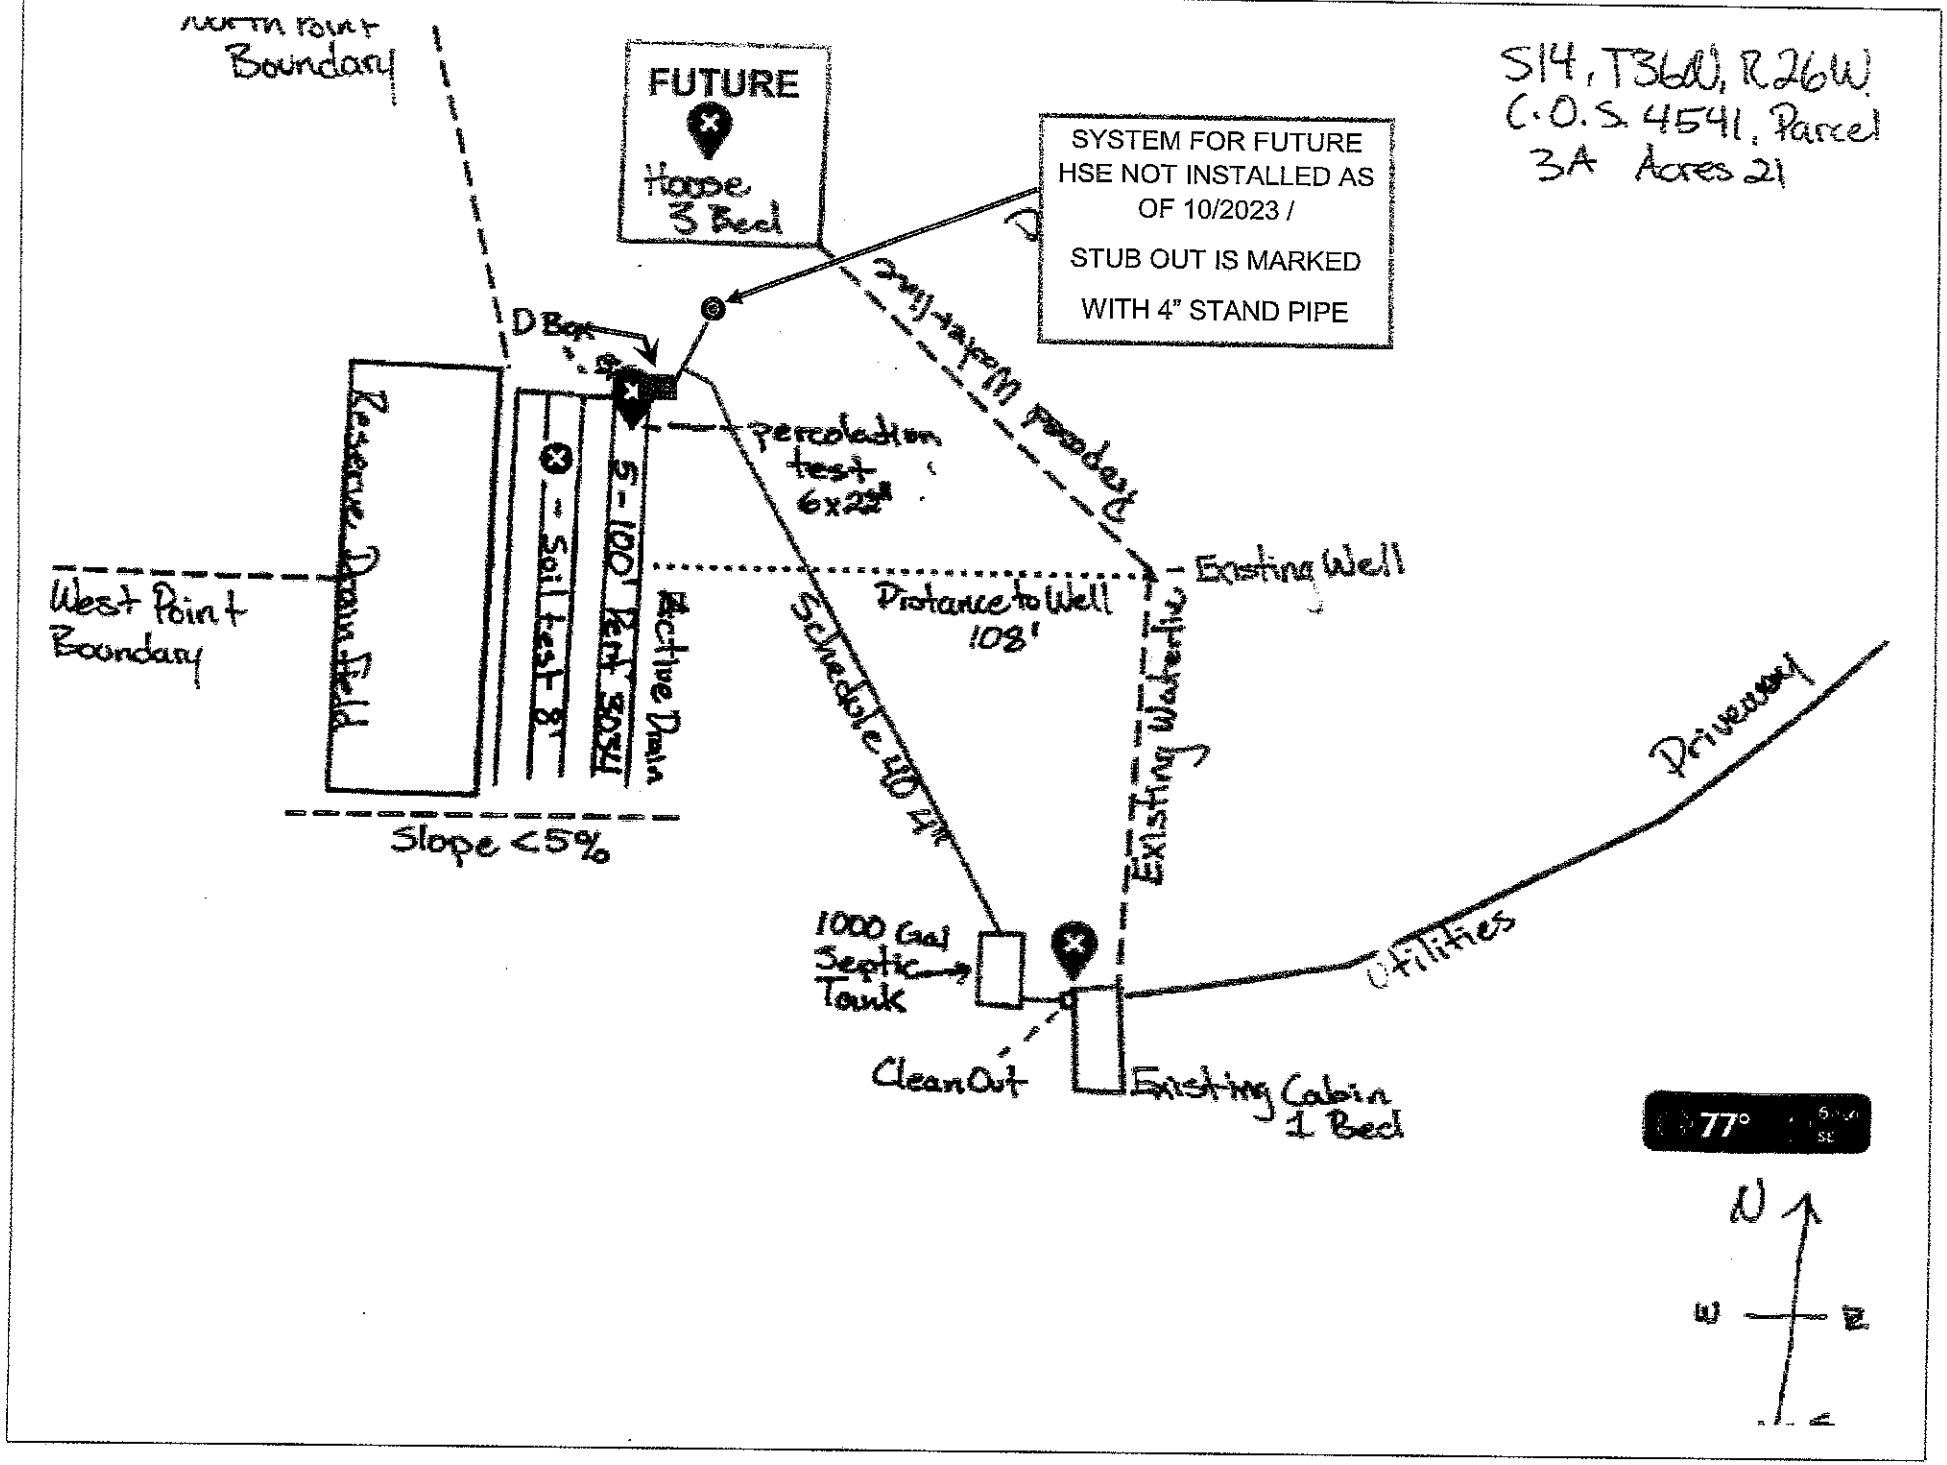
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 10/24/23

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


North Point Boundary
FUTURE
Hoppe 3 Bed
SYSTEM FOR FUTURE HSE NOT INSTALLED AS OF 10/2023 /
STUB OUT IS MARKED WITH 4" STAND PIPE
S14, T36N, R26W
C.O.S. 4541, Parcel 3A Acres 21
D Box
Percolation test 6x22"
Soil test 8'
5-100' Rent 30sq
Reserve Drain Field
Active Drain
West Point Boundary
Slope <5%
Distance to Well 108'
Existing Well
Schedule 40 4"
Existing Waterline
Driveway
1000 Gal Septic Tank
Clean Out
Existing Cabin 1 Bed
Utilities
77°
N
W
E