Permit # 24-54838

LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 03/25/2024 (Renewal Orig. 06/25/2022) Expiration Date: 03/24/2025

Property Owner: Bradley Legassie

Mailing Address: [redacted]

Installer: Gideon Yutzy License #: 113

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Install three 100' laterals using chambers, standard trenches, gravity flow.

Legal: S23, T37 N, R28 W, TAM'S VIEWS LOT 2-B

Property Address: 111 Deer Meadow Lane, Rexford, MT Assessment Code: 54838

DEQ COSA: E.Q.# Date:

Approved Design Criteria:

# of Bedrooms: 3 Septic Tank Size: 1500 gallons Trench Width: 24"

# of Laterals: 3 Length of Laterals: 100' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, RS

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

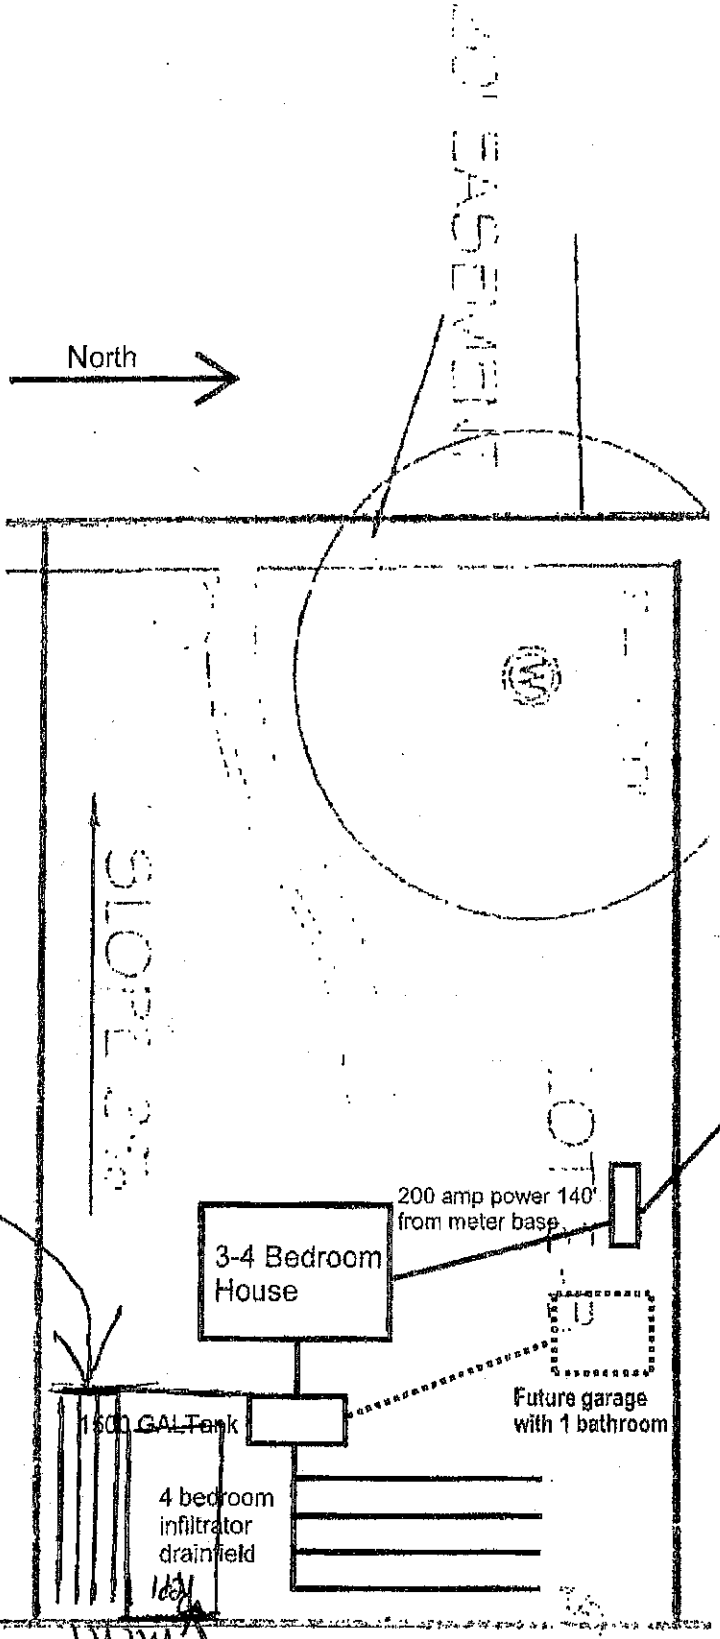
Signed: Robin Blumberg *Date:* 5/10/24

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

LOT LAYOUT


North
3-4 Bedroom House
200 amp power 140' from meter base
Transformer
E
Meter base is 55 feet from transformer
Future garage with 1 bathroom
1500 GAL Tank
4 bedroom infiltrator drainfield
House will be ~ 140 feet from the property edge
1. House to tank = 10 feet
2. From house to first row of north-south drainfield leach lines = 25 feet leaving 115 feet for the install of 3 additional drainfield leachlines as well as ample space for a replacement of 4 - 100 foot trenches.