LINCOLN COUNTY HEALTH DEPARTMENT Permit # 24-54305
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 03/07/2024 Expiration Date: 03/06/2025

Property Owner: Chris Loccisano

Mailing Address: [redacted]

Installer: Logan Munts License #: 160

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system.

Legal: LIBBY CREEK 2, S30, T29 N, R30 W, LOT 3A, ACRES 8.25, PM 6347

Property Address :110 Crazy Moose Crossing, Libby, MT 59923 Assessment Code: 54305

DEQ COSA: E.Q.#96-1952, EQ#01-1748 Date: 06/27/1996, 01/10/2024

Approved Design Criteria: Installation of new pressure dosed system with 3 laterals @ 80'.

# of Bedrooms: 2 Septic Tank Size: 1000/500 gallons Trench Width: 24"

# of Laterals: 3 Length of Laterals: 80' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, RS

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg Date: 3/15/24

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

This permit is not finalized until the system is inspected and the closure statement is signed

This permit is not a guarantee that the system will function properly for a prescribed period of time.

LINCOLN COUNTY, MONTANA

LOT LAYOUT

LIBBY CREEK II, LOT 3A
PLAT NO. 6347
SECTION 30, TWP. 29 N.,
R. 30 W., P.M.M.
FOR: CHRIS LOCCISANO
DATE: MAY 2023

NO KNOW POTENTIAL SOURCES OF CONTAMINATION WITHIN 500' OF PROPOSED WELLS EXCEPT FOR THE PROPOSED AND EXISTING DRAINFIELDS


NO WELLS OR DRAINFIELDS OR MIXING ZONES WITHIN 100' OF LOT BOUNDRY LINES

PROPOSED BUILDING SITES ARE CONCEPTUAL IN NATURE. THIS LOT LAYOUT IN NO WAY PRESENTS A REGULATORY DOCUMENT FOR PROPOSED BUILDINGS SITES.

LEGEND

- PROPOSED PRIMARY DRAINFIELD 3-80' x 24" TRENCHES 10' APART
- PROPOSED REPLACEMENT DRAINFIELD 3-80' x 24" TRENCHES 10' APART
- TP — SOIL PROFILE
- PT — PERCOLATION SITE
- W — WELL SITE (EXISTING)
- O — STORMWATER POND
- SLOPE

DRAINFIELDS ARE SAND-LINED PRESSURE-DOSED ABSORPTION TRENCHES; SEE CIRCULAR DEQ 4 FOR TRENCH CONSTURCTION DETAILS

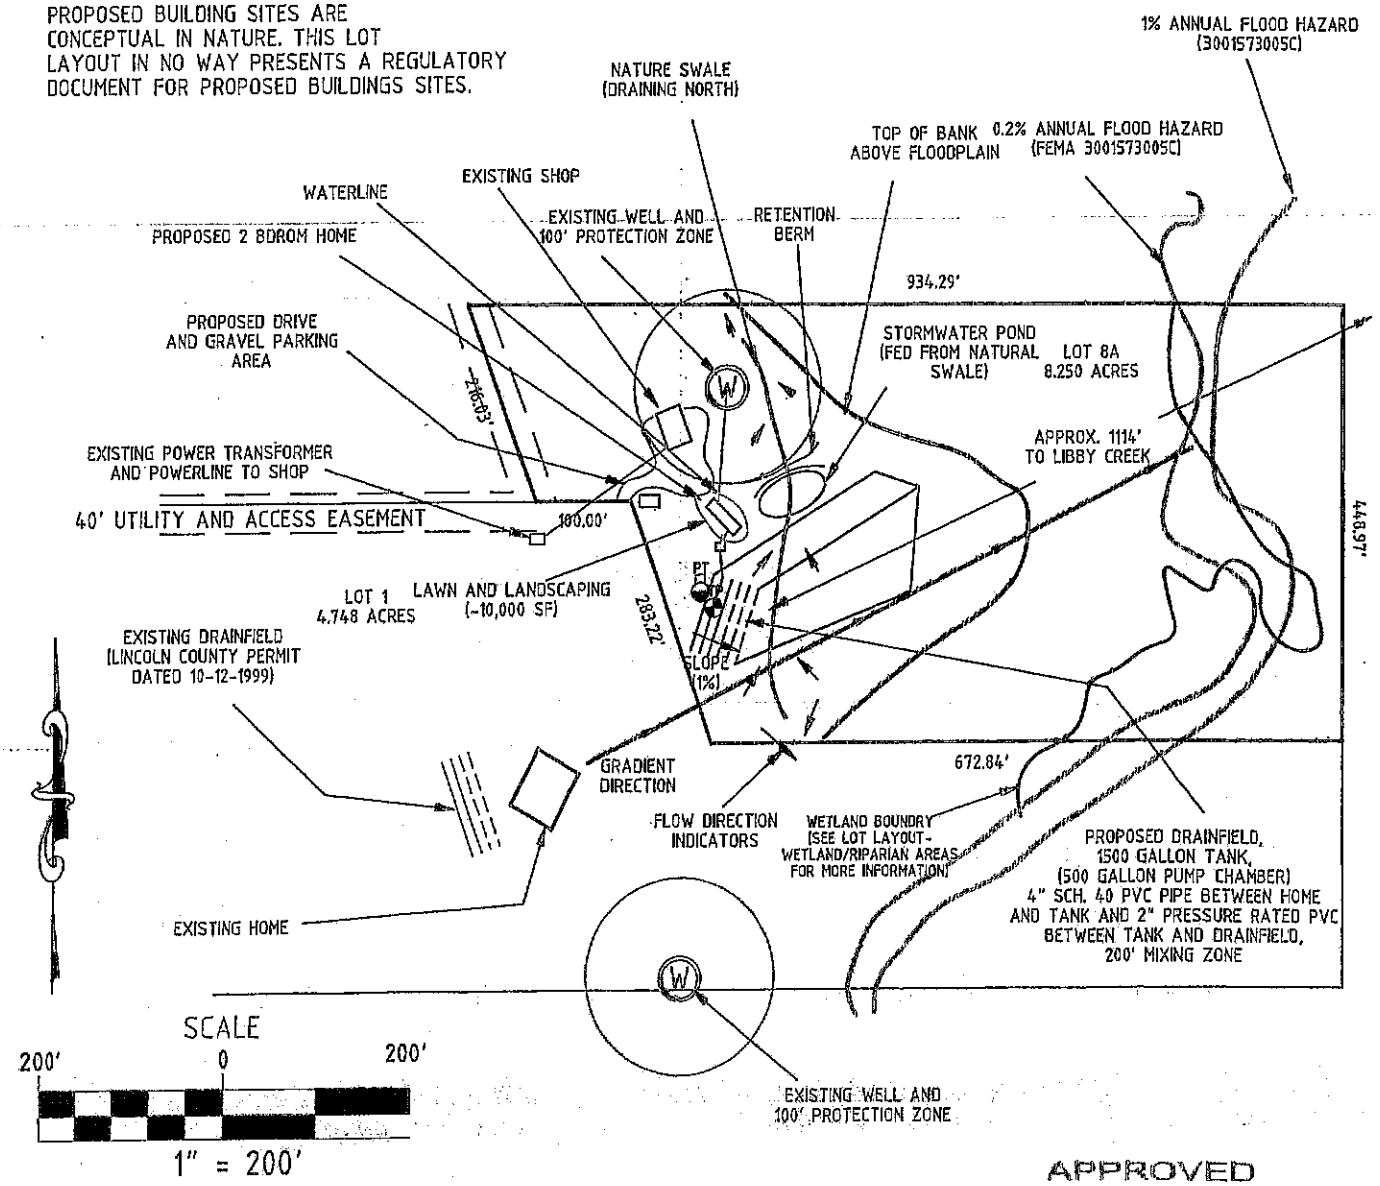

SCALE
200' 0 200'
1" = 200'

APPROVED
Montana Department of Environmental Quality
Reviewer 11/09/2024 Date

DAVIS SURVEYING, INC.
TROY, MT. 406.295.5441

DATE: 05/03/2023
DRAWN BY: KD, PhD

FILE: LOCCISANO_LOT_LAYOUT