LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
AFFIDAVIT OF WASTEWATER TREATMENT AND DISPOSAL SYSTEM COMPLIANCE REVIEW FOR SYSTEM INSTALLED, REPAIRED OR REPLACED WITHOUT A VALID PERMIT

Issue Date: 10/12/2023 -2024

Property Owner: Thomas G & Sherry-Lynn Lundrigan

Mailing Address: [redacted]

Telephone: [redacted] E-Mail:

Who Installed System Being Reviewed: Kootenai Sand and Gravel Inc. Date Installed: 05/2014

Type of System Work Reviewed:

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Use of System: Three bedroom house Assessment Code: 11868

Property Description:

Legal: AIRPARK VILLAGE, S14, T37N, R27W, LOT 7 PM 6910

Address or Location: 38 Aero Village Way, Eureka, MT 59917

Reviewed System Components:

# of Bedrooms: 3	Septic Tank: 1000/500 gallons	Pressure Dosed System
# of Laterals: 2	Length of Laterals: 63'	Trench Width: 36"

Comments: Pressure dosed system using 1000/500 gallon tank and 3' wide trenches. Two laterals are 63' long with chambers and sand lined. Septic tank was pumped on 9/8/2023 and in good condition. System is appropriately sized for wastewater flows of 300 gallons per day. Any future extension, repair, replacement or increase in wastewater flows must be reviewed and permitted by Lincoln County Health Department.

System Review Documentation Statement:

I, Robin Blumberg, *have reviewed the components of this system as listed in the statement of the Licensed Installer and found it to be in compliance with the requirements of A.R.M. Chapter 17.36 Subchapter 9, Circular DEQ-4 and Lincoln County Wastewater Treatment and Disposal Regulation.*

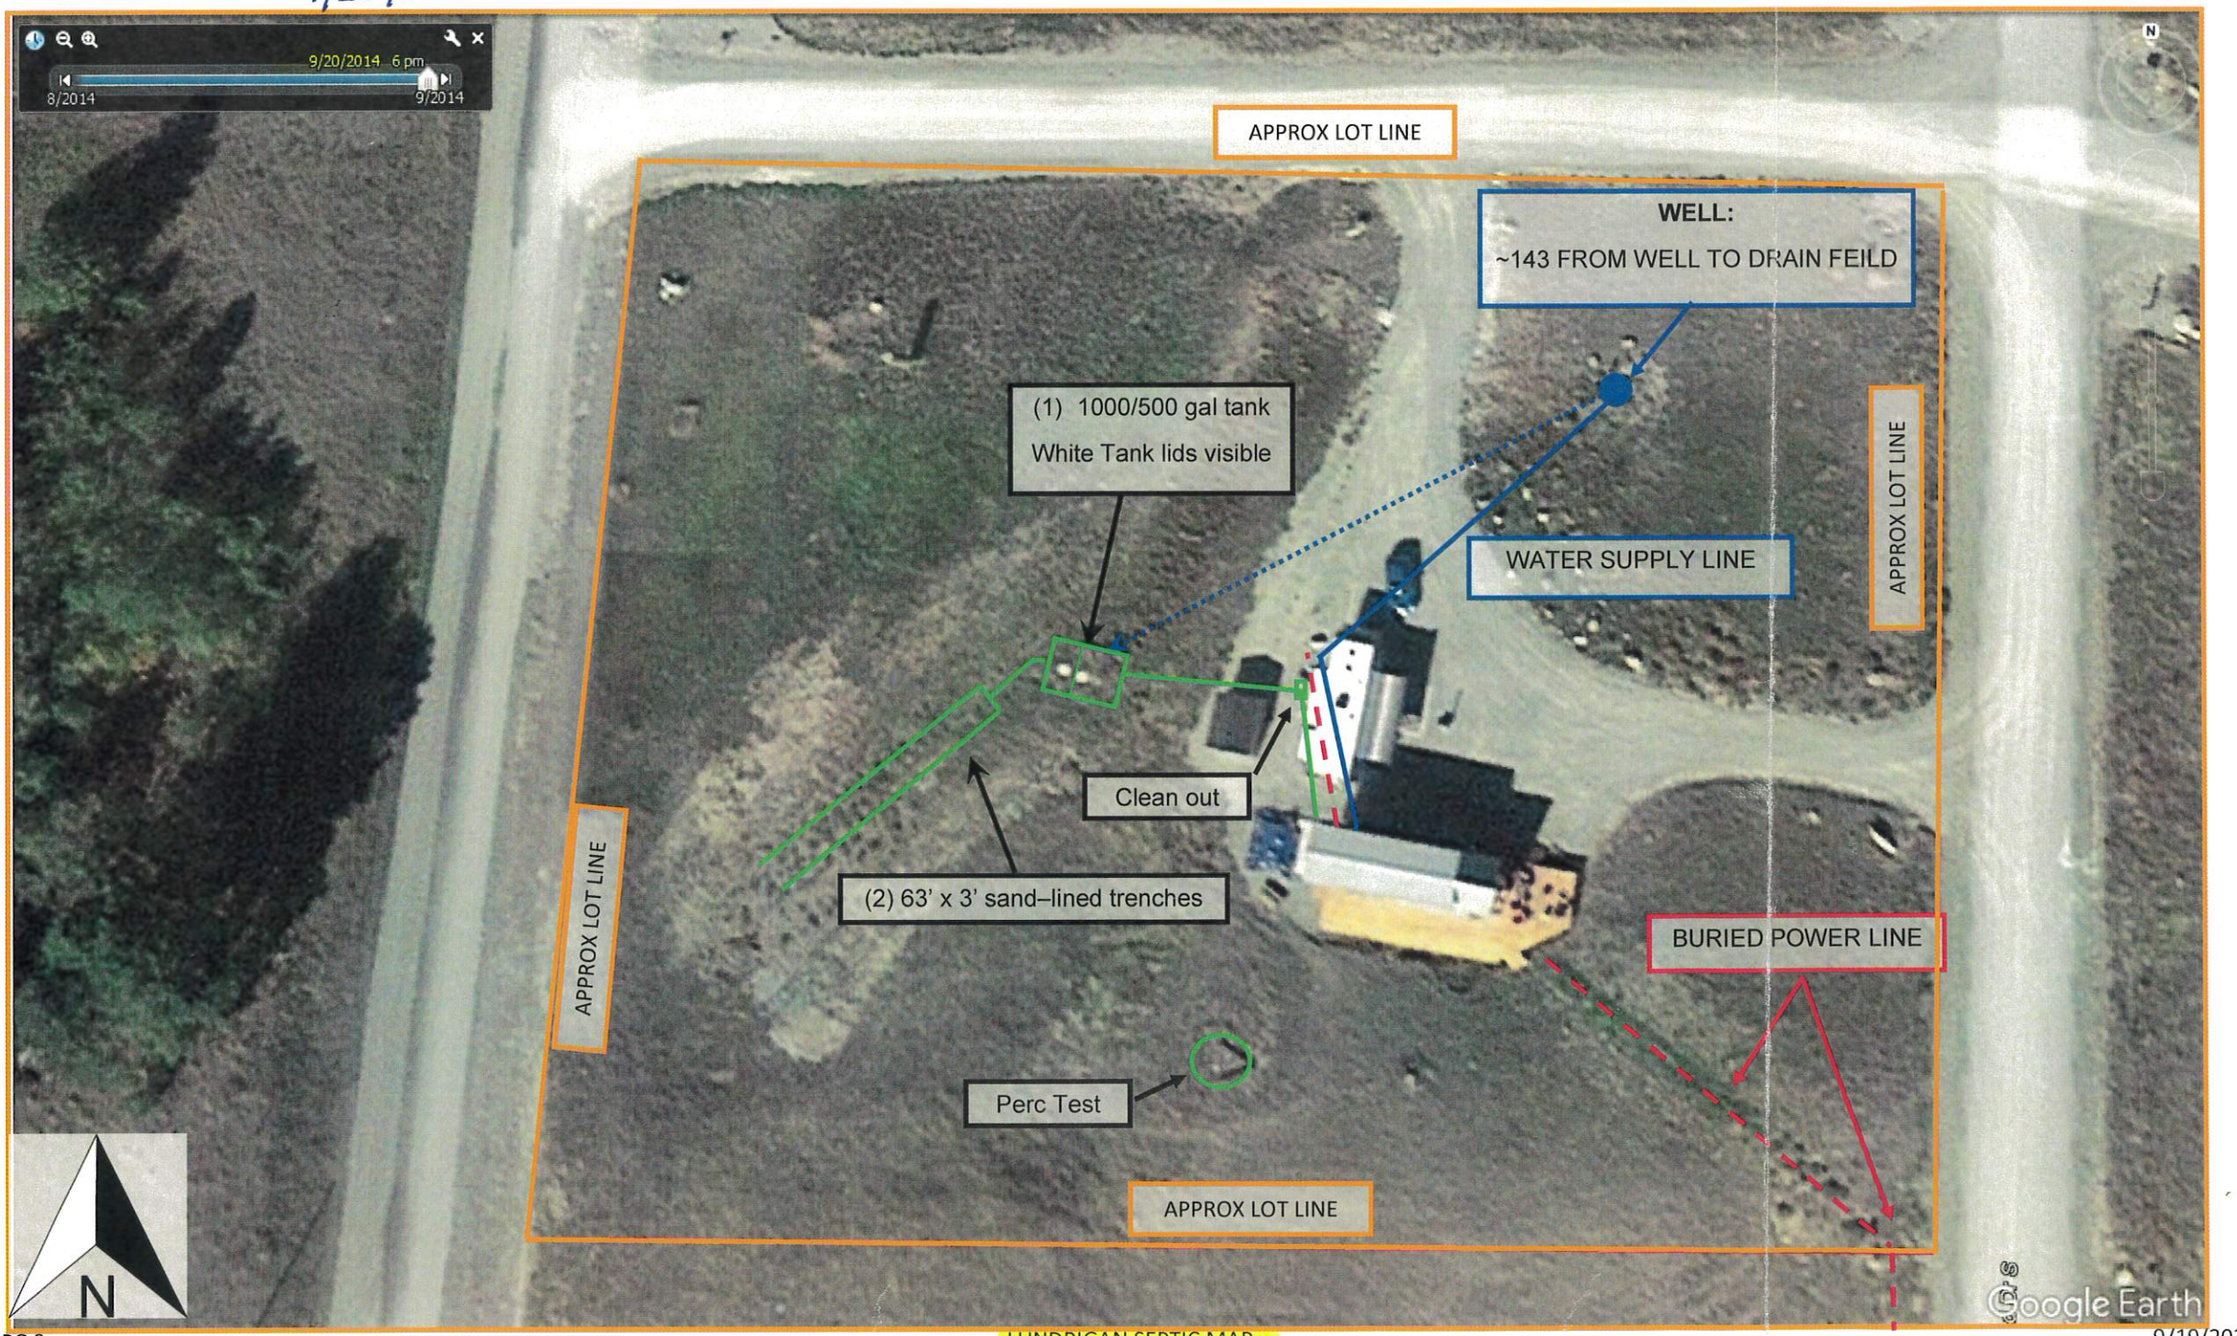
Signed: Robin Blumberg *Date:* 10/16/23

Title: SIT

NOTICE: This document is not a permit for installation, repair or alterations of a wastewater treatment and disposal system. It is a statement that the Department has conducted a review of this system and found it to be in compliance with applicable requirements, making it a legal system for the use described above. The Department does not guarantee that this system will continue to function properly for any period of time.

SV

9/20/2014


9/20/2014 6 pm
8/2014
9/2014
APPROX LOT LINE
WELL:
~143 FROM WELL TO DRAIN FEILD
(1) 1000/500 gal tank
White Tank lids visible
WATER SUPPLY LINE
APPROX LOT LINE
Clean out
(2) 63' x 3' sand–lined trenches
APPROX LOT LINE
BURIED POWER LINE
Perc Test
APPROX LOT LINE
N
Google Earth

Site Services Solutions
PO Box 1079
Eureka, MT 59917
(406) 297-2777
siteservicessolutions@gmail.com

INVOICE

BILL TO
Gretchen Lancaster
Lancaster And Company
PO Box 1612
Eureka, MT 59917

INVOICE # 6190
DATE 09/08/2023
DUE DATE 09/23/2023
TERMS Net 15

SERVICE MONTH
September 2023

DATE	ACTIVITY	DESCRIPTION	QTY	RATE	AMOUNT
	Disposal Fee - Septic	Disposal Fee - Septic	1	20.00	20.00
	Septic Pumping - 10	Septic Pumping - 10	1	350.00	350.00
	Filter Cleaning		1	27.00	27.00

Septic pumping of 1000 gallon tank at 38 Aero Village.
Tank in good condition, the pump to the drain field needs attention.
Cleaned filter.

BALANCE DUE **$397.00**

Thank you for your business!

A late fee of 1.5% will be applied to the account, 15 days beyond due date.
Nonpayment beyond 60 days will be processed with the card on file.