LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Permit # 14322

Issue Date: 07/05/2023 Expiration Date: 07/04/2024

Property Owner: Aaron & Michelle Lynam

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Cory Persson License #: 197

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of pressure dosed system with 3 laterals @84'.

Parcel Description:

Legal: KHAZ, S25, T35 N, R26 W, LOT 2, ACRES 1, PM6960

Property Address: 75 Khaz Rd., Fortine, MT 59918 Assessment Code: 14322

DEQ COSA: EQ#08-1652 Date: 11/3/08

Approved Design Criteria: Installation of pressure dosed system with 3 laterals @ 84'.

# of Bedrooms: 3 Septic Tank Size: 1000/500 gallons Trench Width: 36"

# of Laterals: 3 Length of Laterals: 84' Trench Depth: 36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, SIT

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

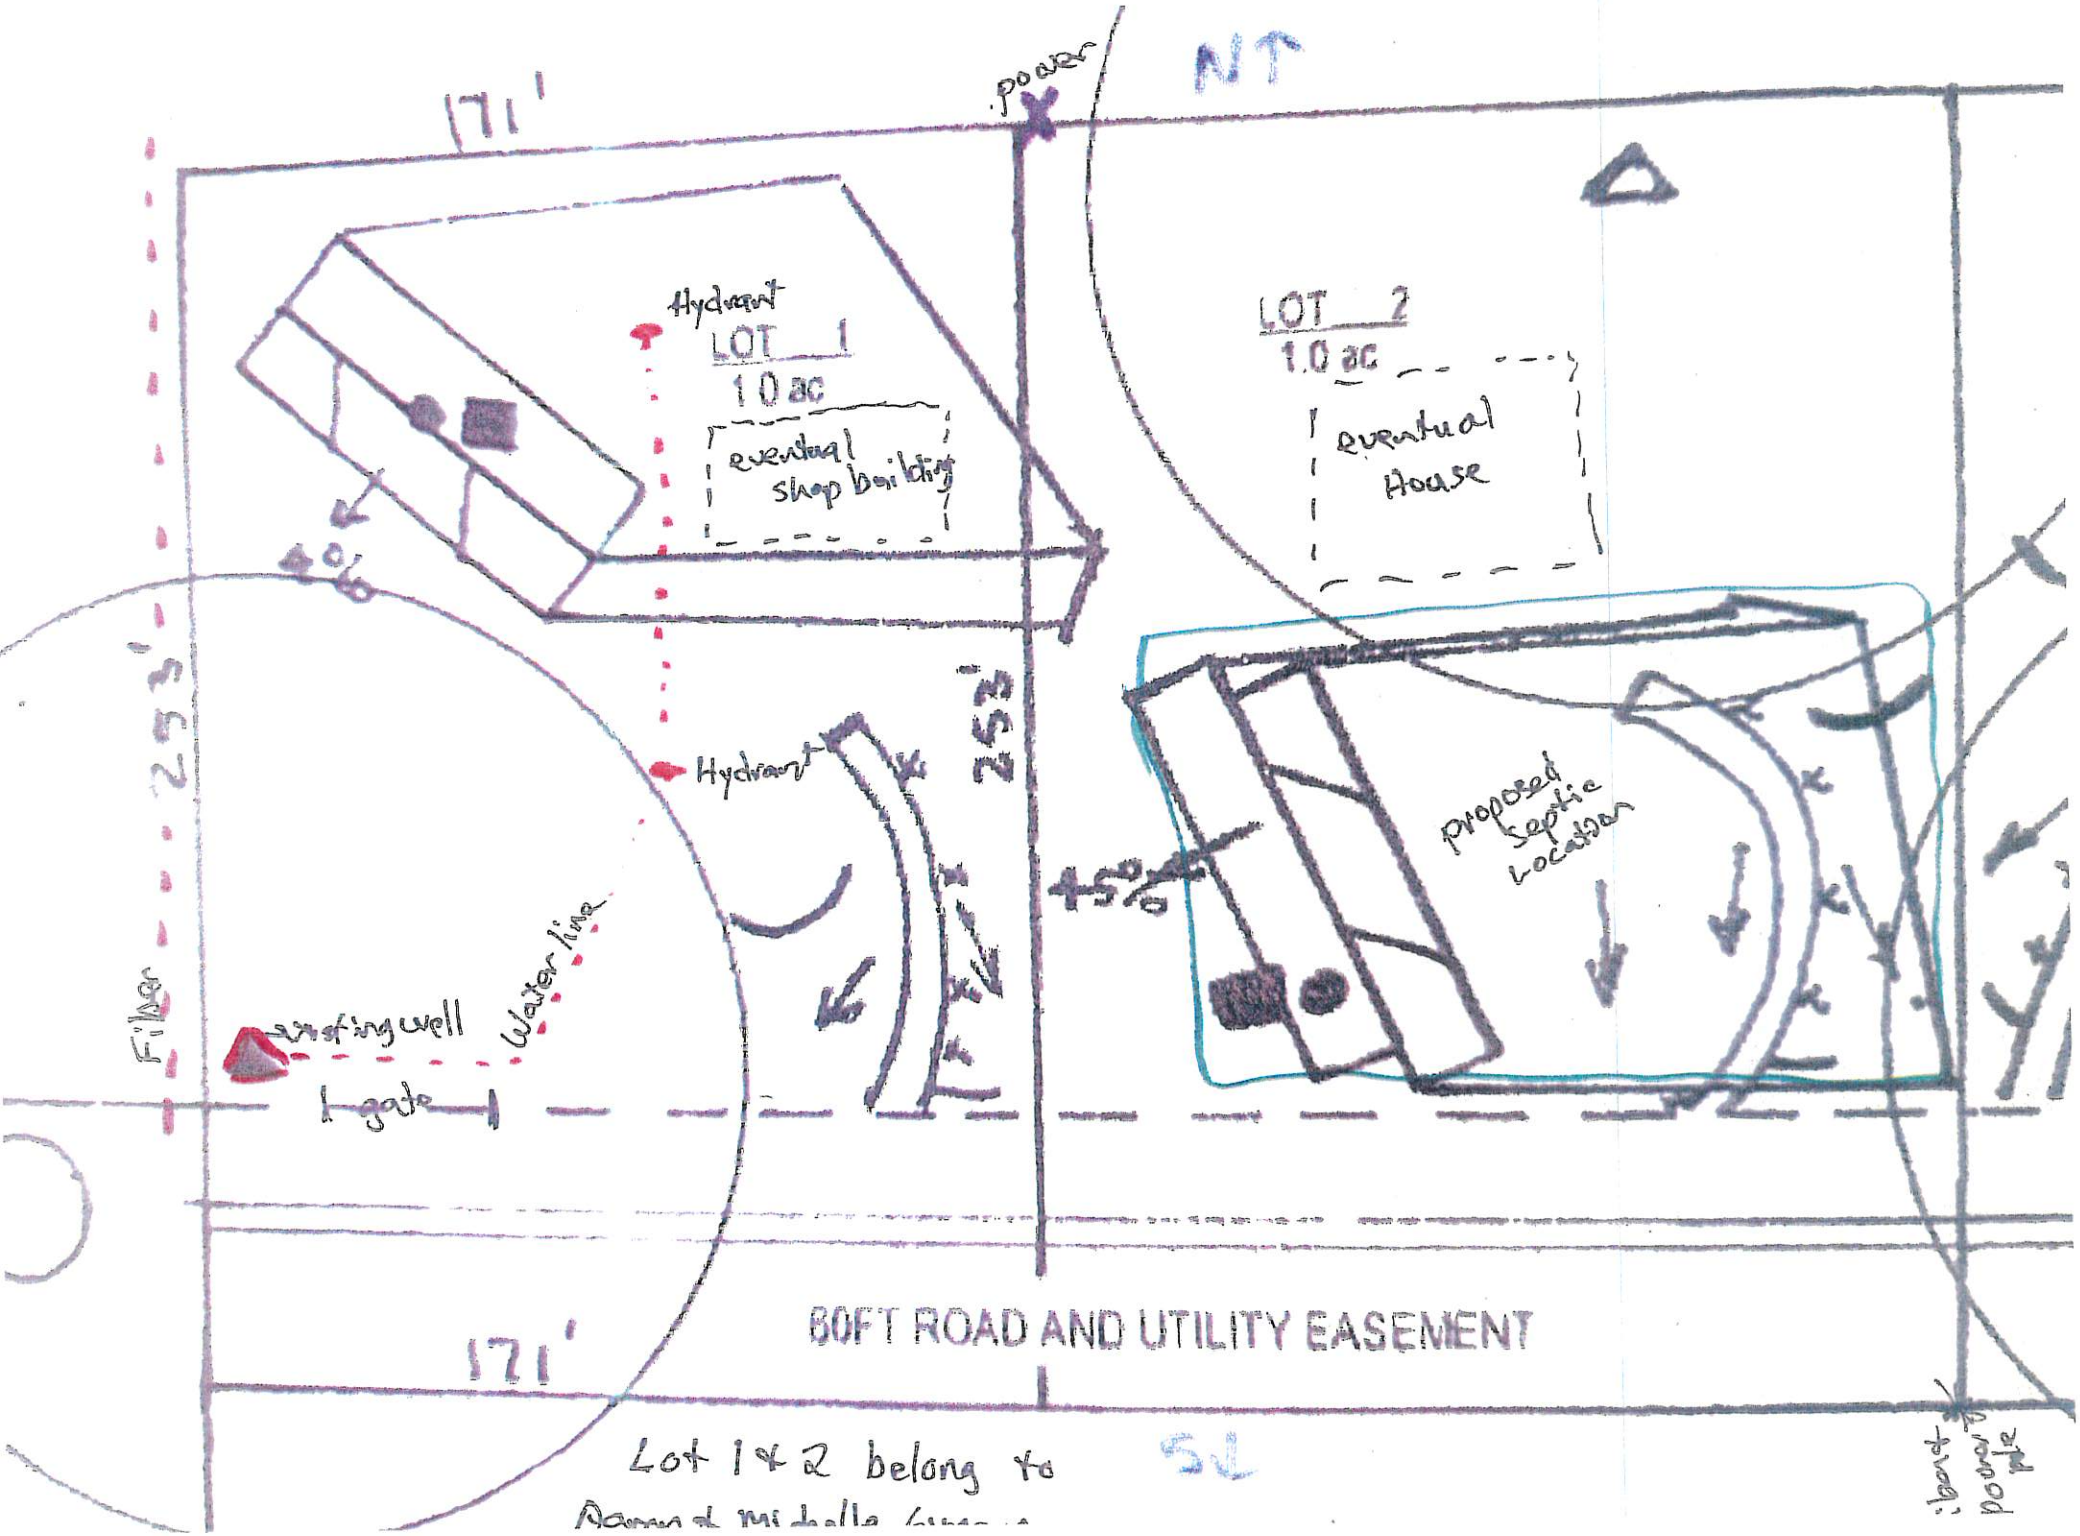
Signed: Robin Blumberg *Date:* 5/28/24

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV


NT
171'
power
Hydrant
LOT 1
1.0 ac
eventual shop building
LOT 2
1.0 ac
eventual House
40'
253'
Hydrant
253'
45°
proposed Septic Location
Filler
existing well
Water line
gate
60FT ROAD AND UTILITY EASEMENT
171'
Lot 1 & 2 belong to
SL