LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Permit # 24-6154

Issue Date: 06/05/2024 Expiration Date: 06/04/2025

Property Owner: Joseph Marshaleck

Mailing Address: [redacted]

Installer: Logan Munts License #: 160

Approved Work: (Check One) ☐ New Installation ☒ Existing System

☒ Replace Drainfield ☒ Replace Tank ☐ Extension

Describe: Installation of gravity system 2 Laterals @ 100' w/ unfinished basement

Legal: S30, T32 N, R33 W, C.O.S. 606, ACRES 2.429, TR 4A1 IN HES 1057 IN SESE

Property Address: 2323 Rabbit Creek Rd Troy, MT 59935 Assessment Code: 6154

DEQ COSA: E.Q.# Date:

Approved Design Criteria: Installation of replacement for gravity system, 2 Laterals @ 100' with reduction for chambers. Noted: 2 bedroom with Unfinished Basement

# of Bedrooms: 2 Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 2 Length of Laterals: 100' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Kathi Hooper, RS

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

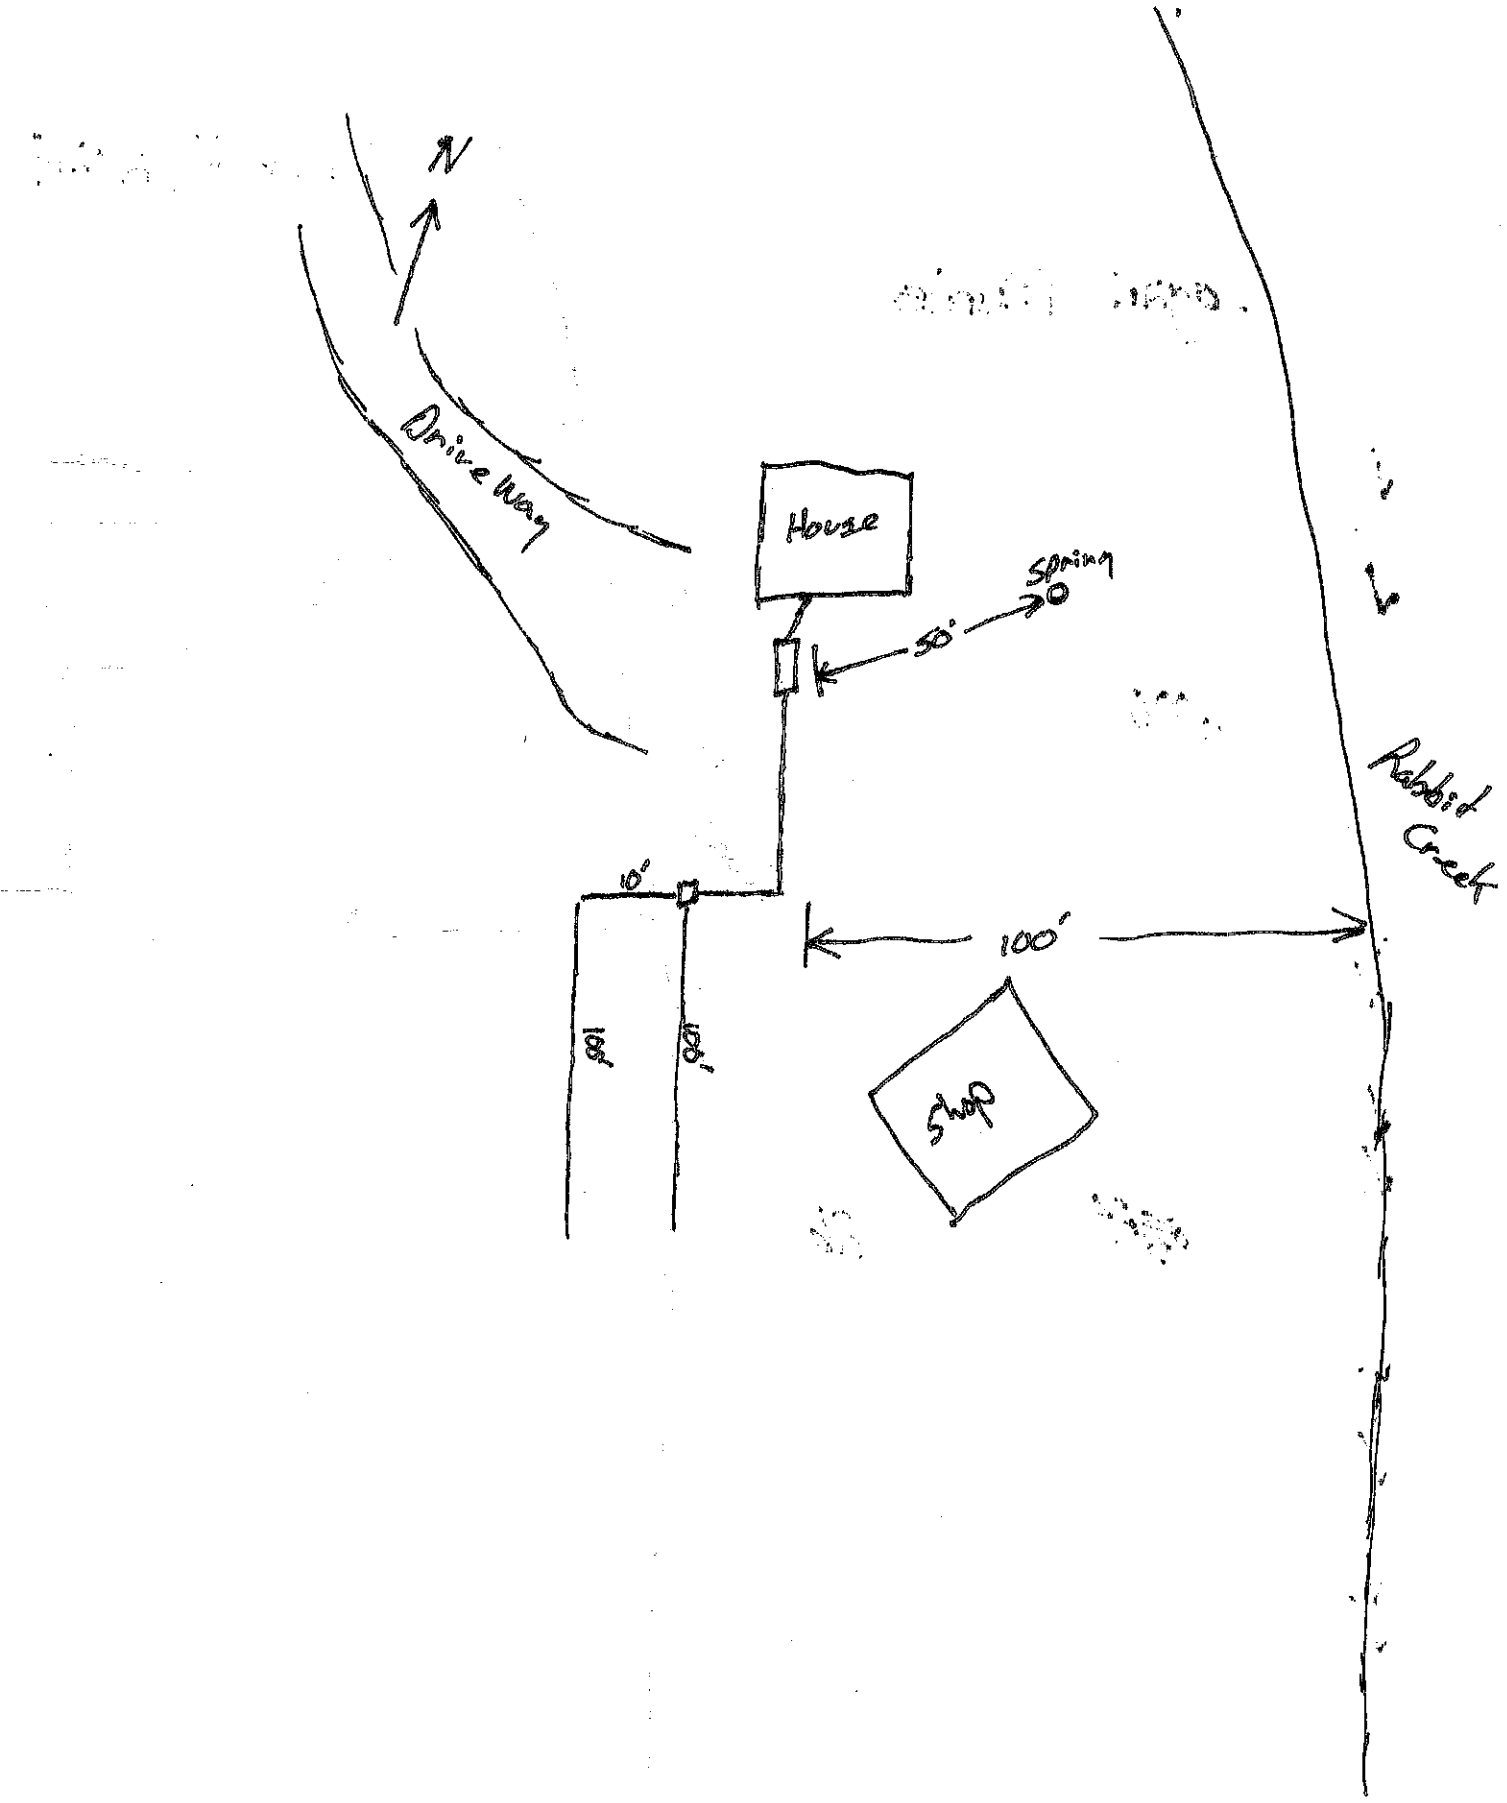
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Dolin Blumley Date: 6/7/24

✓ Lincoln County Health Department (LCHD) _____ Licensed Installer w/ approval of LCHD

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


N
Drive way
House
Spring
50'
Rabbit Creek
10'
100'
18'
18'
Shop