LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 11/27/2023 Expiration Date: 11/26/2024

Property Owner: Mattera Scott W & Kevin J

Mailing Address: [redacted]

Telephone: 406-249-0231 E-mail: darwin@earthworksmt.com

Installer: Darwin Pluid License #: 164

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system.

Parcel Description:

Legal: VELVET GROVE 5, S23, T37 N, R27 W, ACRES 5.03, LOT 15 PM 7218

Property Address: LOT 15 Royal Antler Ln. Eureka, MT 59917 Assessment Code: 59882

DEQ COSA: EQ# 19-1827 Date: 08/28/2019

Approved Design Criteria: Installation of new pressure dosed system.

# of Bedrooms: 2 Septic Tank Size: 1000/500 gallon Trench Width: 36"

# of Laterals: 2 Length of Laterals: 65' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, SIT

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

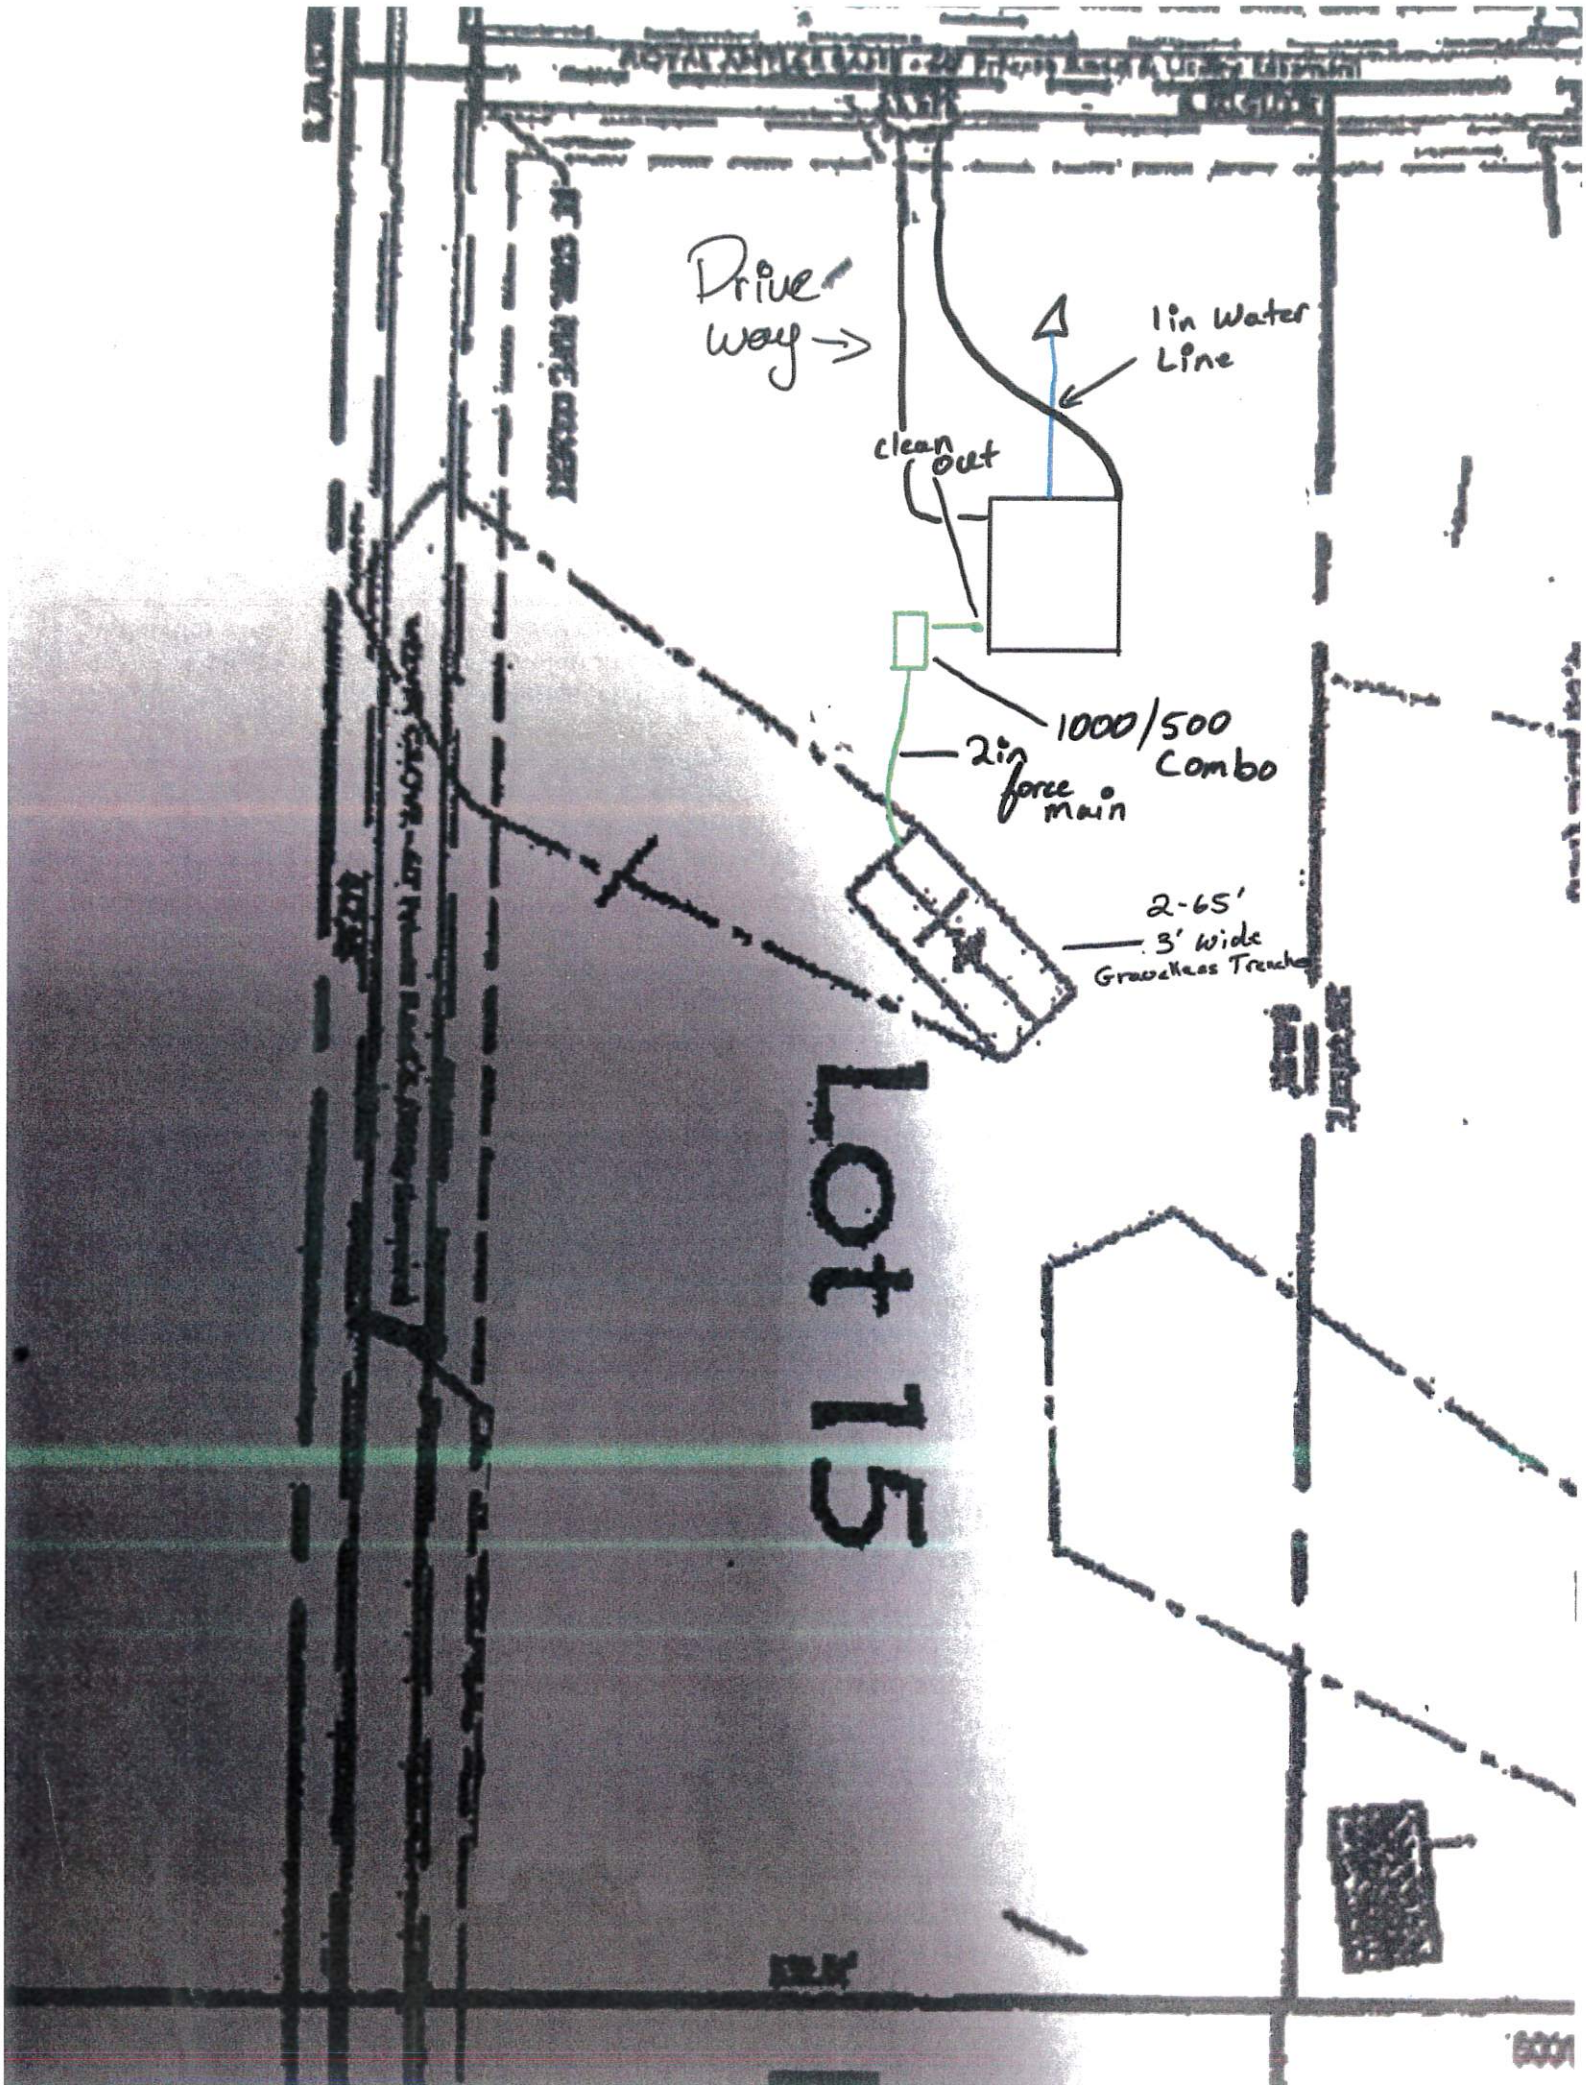
Signed: Robin Blumberg *Date:* 6/28/24

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV


Driveway
1in Water Line
clean out
1000/500 Combo
2in force main
2-65'
3' wide Gravelless Trench
Lot 15