Permit # 23-54964

LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/27/2023 Expiration Date: 07/26/2024

Property Owner: Mike McAdon

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: D&H Hauling License #: 135

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed septic system.

Parcel Description:

Legal: EUREKA HILLS PH 1, S26, T36 N, R27 W, LOT 9, ACRES 3.419, PM 6823

Property Address: 84 Galton Range Rd. Eureka, MT 59917 Assessment Code: 54964

DEQ COSA: EQ# 07-2095 Date: 09/28/07

Approved Design Criteria: Installation of new pressure dosed septic system.

# of Bedrooms: 3 Septic Tank Size: 1500/500 Trench Width: 36"

# of Laterals: 3 Length of Laterals: 76' Trench Depth: 36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, S97

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.


Signed: Brad Schumacher *Date:* 1/26/24

_____ Lincoln County Health Department (LCHD) _____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV

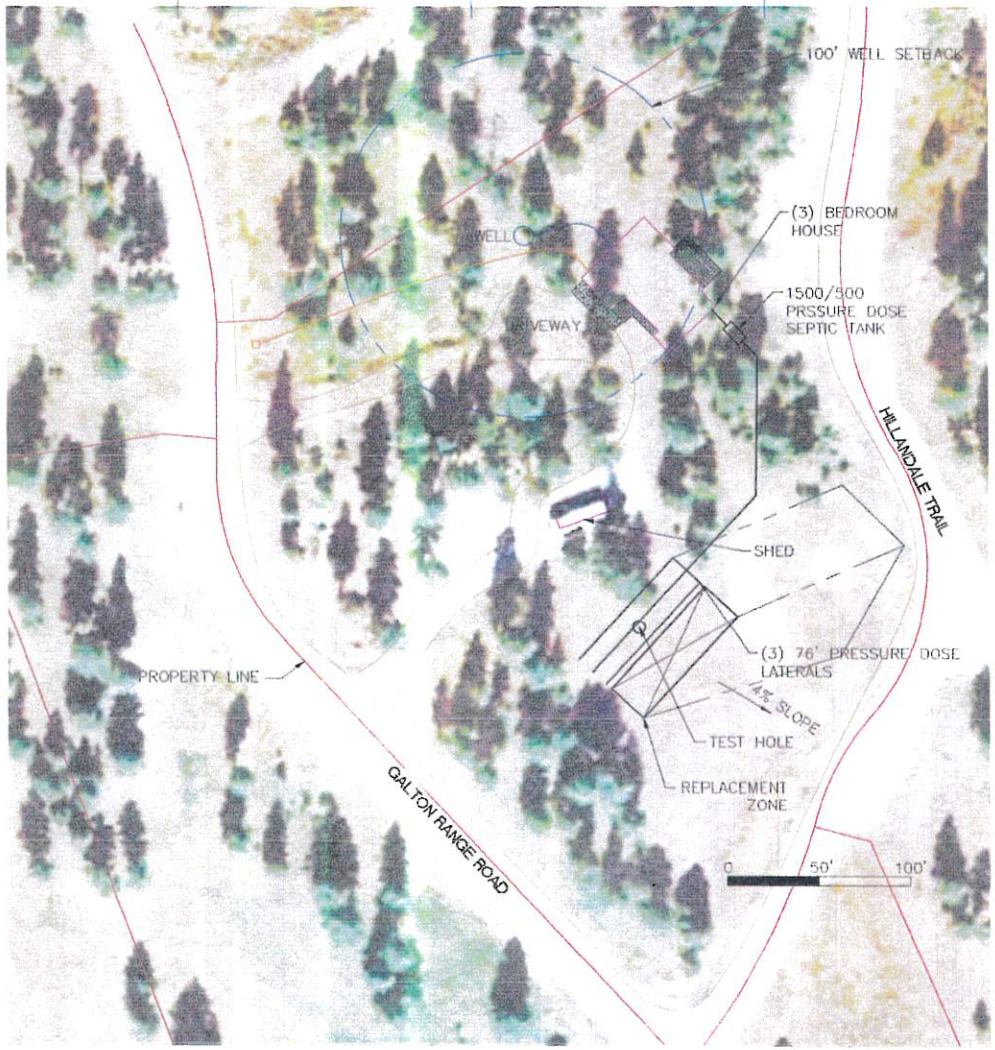

MIKE MCADON SITE MAP

REV	DESCRIPTION	BY/DATE	APPD/DATE

DRAINFIELD SIZING

(3) BEDROOM= 300 GPD
300 GPD/0.4 APP= 750 SQFT
750 SQ FT/3' CHAMBERS= 250 LF
250 LF/ 3 LATERALS= 84'
REDUCTION FOR 0.4 APP= 10%
250' X 0.9= (3)-76' LATERALS

LOT 9

3.419 ACRES
84 GALTON RANGE ROAD, EUREKA, MT 59917
S26, T36N, R27W, PM 6823
ASSESSMENT #0000054964
GEO 56-4823-26-4-01-13-0000

THIS DRAWING IS PROPERTY OF D&H WATER CONTRACT AND HAS BEEN SECURED BETWEEN OWNER & D&H. IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM D&H MANAGEMENT

REV	DATE	COMPANY	SCALE	ADDRESS / PHONE	D & H HAULING MCADON SEPTIC PERMIT
		D/H	1/16 = NOTED	P.O. BOX 1855, EUREKA, MT 59917 406-882-4181	SITE LAYOUT
		CONTRACT	DATE	GRID TOLERANCES	
		VERBAL	5/2023		5/15/23
		PLOT FILE	WEIGHT	FINISH	D. FLUID 5/15/23
		PML-0001			MCADON 1