LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/01/2023 Expiration Date: 04/30/2024

Property Owner: John Mee

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Terry Oedewaldt License #: 002

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system with chambers.

Parcel Description:

Legal: SNOWY VIEW, S35, T30 N, R31 W, ACRES 2.003, PM 6449 LOT 2B

Property Address: 51 Snowy View Dr. Libby, MT, 59923 Assessment Code: 53587

DEQ COSA: EQ#03-2055 Date: 03/18/2003

Approved Design Criteria: Gravity system with chambers 2 Laterals@ 100'.

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 2 Length of Laterals: 100' Trench Depth: 24-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. Reduction given for chambers. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, SIT*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* 5/5/2023


____ Lincoln County Health Department (LCHD) ✓ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV

JOHN MEE SEPTIC PERMIT 5/5/2023

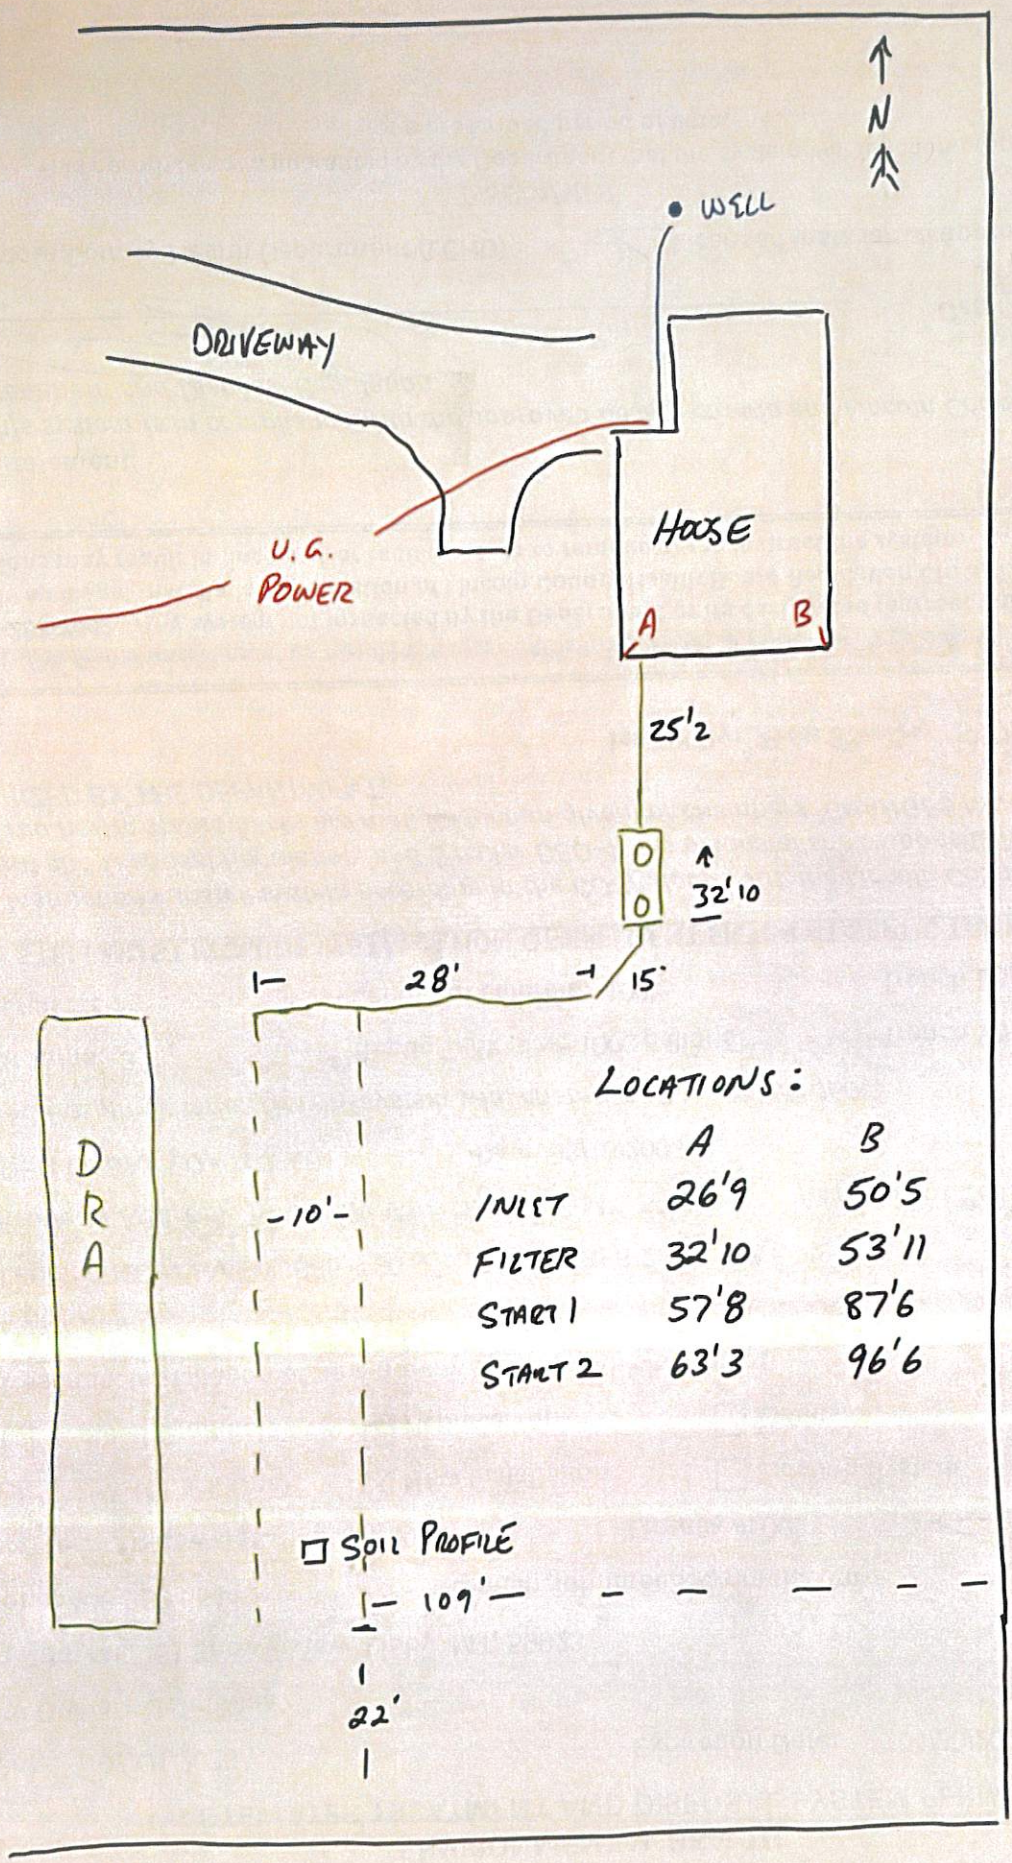

LOCATIONS:

	A	B
INLET	26'9	50'5
FILTER	32'10	53'11
START 1	57'8	87'6
START 2	63'3	96'6