LINCOLN COUNTY Permit # 24-16431

DEPARTMENT OF ENVIRONMENTAL HEALTH

AFFIDAVIT OF WASTEWATER TREATMENT AND DISPOSAL SYSTEM COMPLIANCE REVIEW FOR SYSTEM INSTALLED, REPAIRED OR REPLACED WITHOUT A VALID PERMIT

Issue Date: 03/08/2024

Property Owner: Chance Meridith

Mailing Address: [redacted]

Name of Person Who Installed System Being Reviewed: Tom Cole Tally Ho

Type of System Work Reviewed:

_x_ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: New installation of gravity system with 3 laterals @ 85'

Property Description:

Legal: S24, T29 N, R31 W, COS 1991, PARCEL A, ACRES 9.57, OR TR 2IN E2NE OF HWY 2

Address or Location: 42031 US HWY 2, Libby, MT 59923

Reviewed Design Components: Tom Cole

Wastewater Flows: 300 GPD Septic Tank: 1000 Gallon Effluent Filter: Yes

Dosing or Lift Tank: No Drainfield Size: 3@85' Trench Depth: 36" Trench Width: 24"

Hydraulic Function: yes

Comments:

System Review Documentation Statement:

I, Robin Blumberg, have reviewed the components of this system as listed above and found it to be in compliance with the sizing, construction, orientation and operating requirements of Chapter 17, Subchapter 9 A.R.M., Circular DEQ-4 and Lincoln County Wastewater Regulation #3.

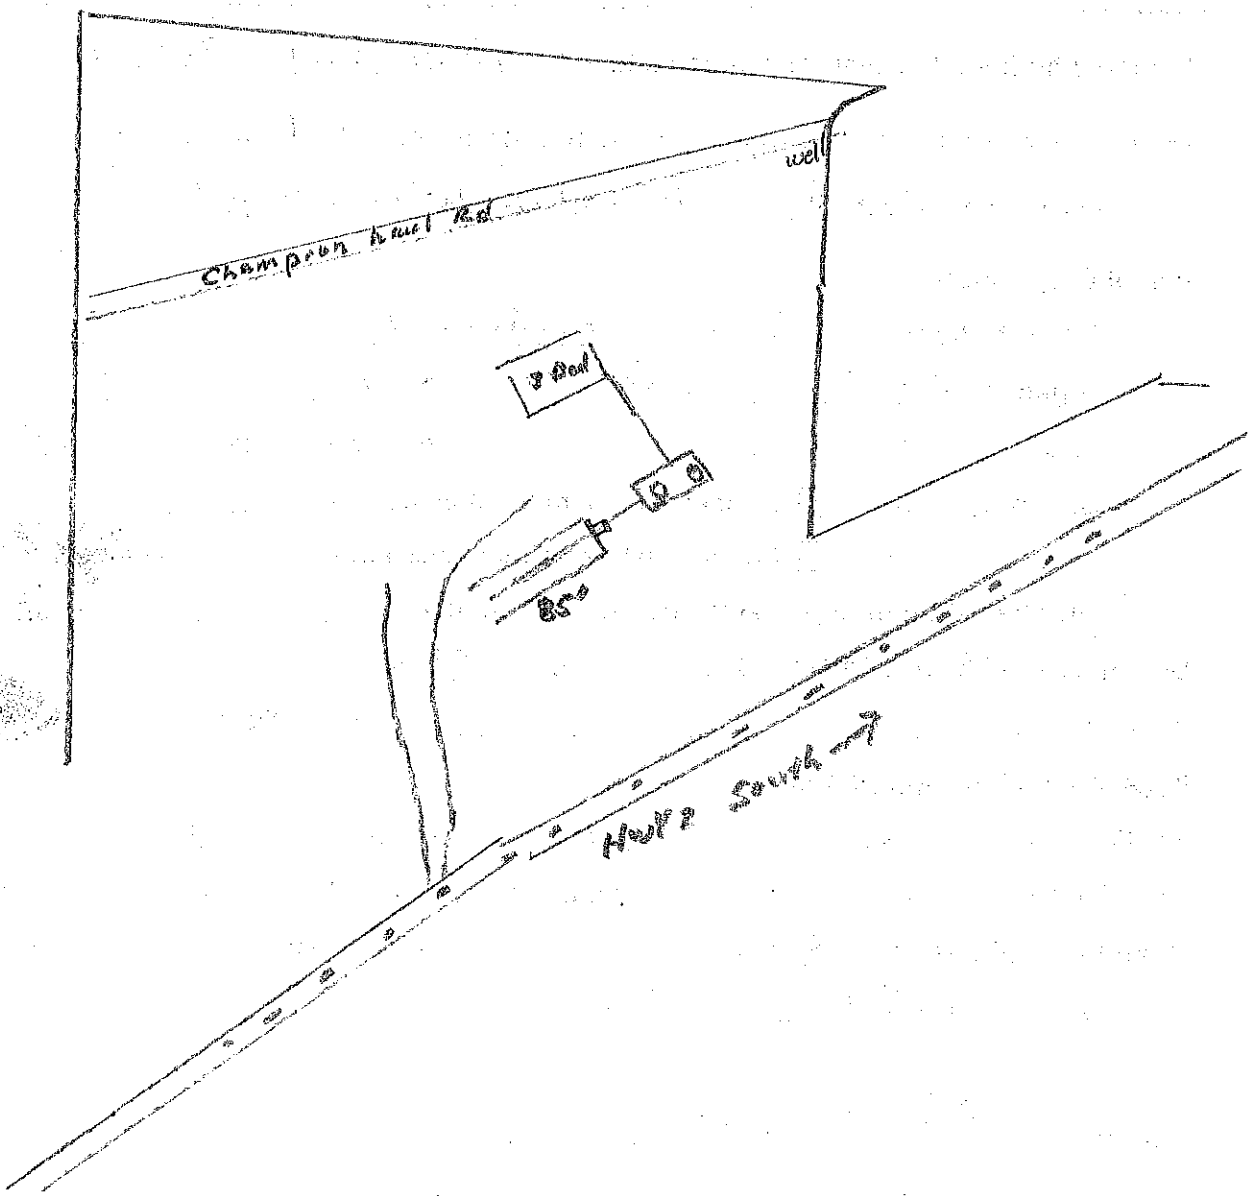
Signed: Robin Blumberg *Date:* 03/08/2024

Title: R.S.

NOTICE: This document is not a permit for installation, repair or alterations of a wastewater treatment system. It is merely a statement of affirmation that the Department has conducted an on-site review of an otherwise illegal system and found it to be in compliance with all applicable requirements for that system. This affidavit effectively removes the illegal installation status on this system.

DISCLAIMER

This affidavit of review is not a guarantee by the Department that the system will continue to function properly for any prescribed period of time.


N
Champion Road
well
3 Bed
BS
Hedge