Permit # 00-12612

LINCOLN COUNTY
DEPARTMENT of ENVIRONMENTAL HEALTH
Wastewater Treatment and Disposal System
PERMIT

Issue Date: 05/26/00 Expiration Date: 05/27/01

Property Owner: Carol Miller c/o: _____

Address: [redacted]

Telephone: (Home) [redacted] (Work) _____

Installer: Koocanusa Plumbing License No. 8

_____ New Installation XX Existing System

_____ Repair XX Replacement _____ Extension _____ Other

Describe: Replacing outhouse for cabin.

Parcel Description:

Legal: S 1/2 S12 & N 1/2 S13 T36 R28

Address or Location: 500 Madden Lake Road

Approved Design Criteria:

Bedrooms 1 Septic Tank Size: 1000 gallons Drainfield Size: 130 lineal feet

INSTALL SYSTEM ACCORDING TO LOT LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3.

Special Instructions: ***ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, Michael B Nelson *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Michael B Nelson *Date:* 13 Sept 2000

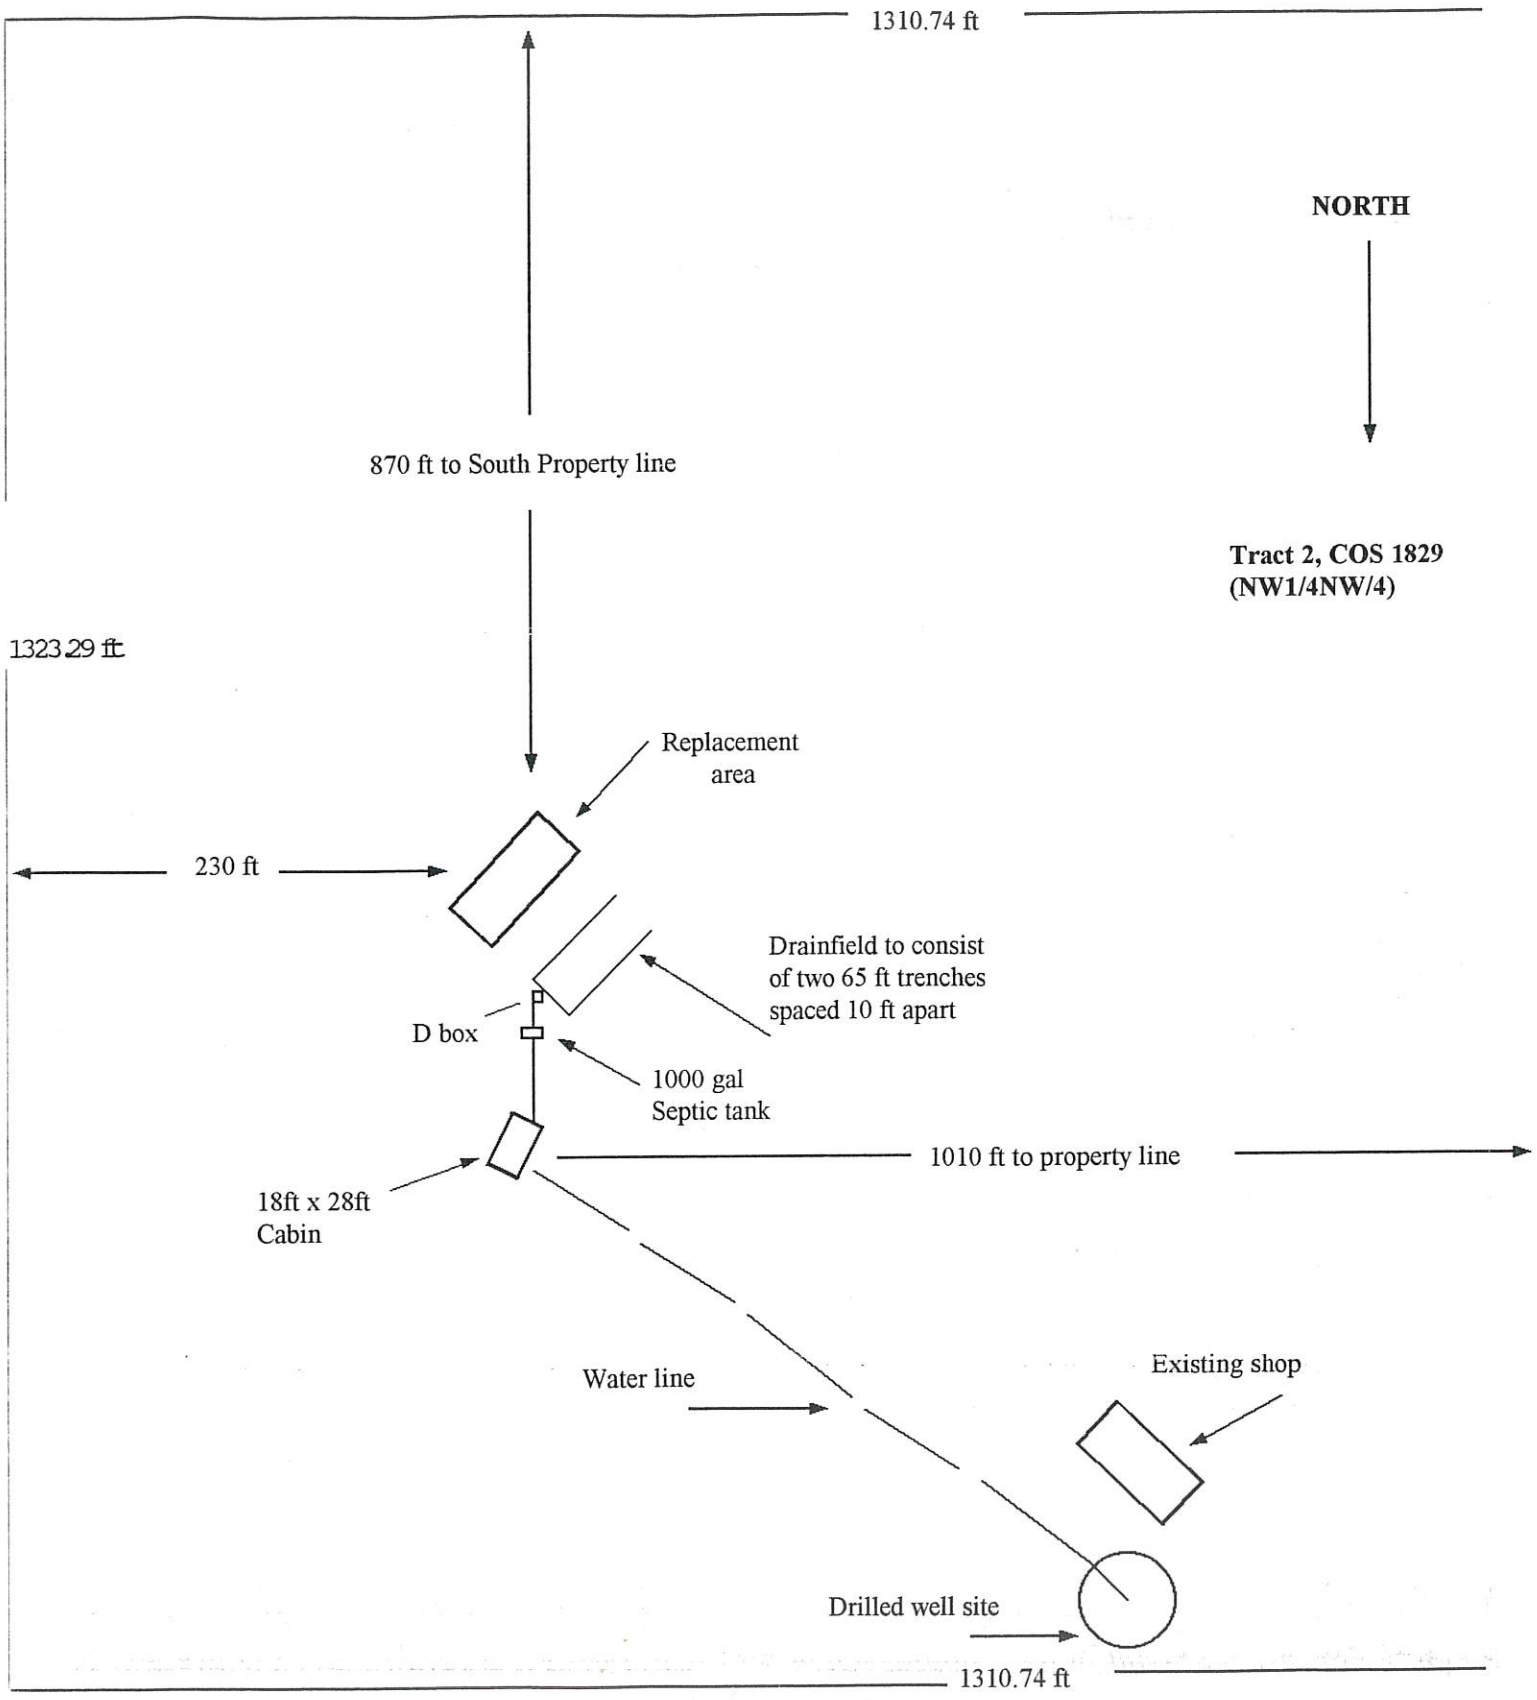
Title: Septic Tank Installer #8

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


1310.74 ft
NORTH
870 ft to South Property line
Tract 2, COS 1829
(NW1/4NW/4)
1323.29 ft
Replacement
area
230 ft
Drainfield to consist
of two 65 ft trenches
spaced 10 ft apart
D box
1000 gal
Septic tank
1010 ft to property line
18ft x 28ft
Cabin
Water line
Existing shop
Drilled well site
1310.74 ft