LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/15/2023 Expiration Date: 05/14/2024

Property Owner: David Murphey

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Caldwell License #: 171

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity septic system.

Parcel Description:

Legal: AJ ESTATES, S14, T37 N, R27 W, LOT 19, ACRES 1.46, PM 6477

Property Address: 126 Luciano dr., Eureka, MT 59917 Assessment Code: 54422

DEQ COSA: E.Q.# 02-1071 Date: 03/26/2003

Approved Design Criteria: Installation of new gravity system with 3 70' Laterals

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 5 Length of Laterals: 42' Trench Depth: 24-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. Reduction given for chambers. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, SIT

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

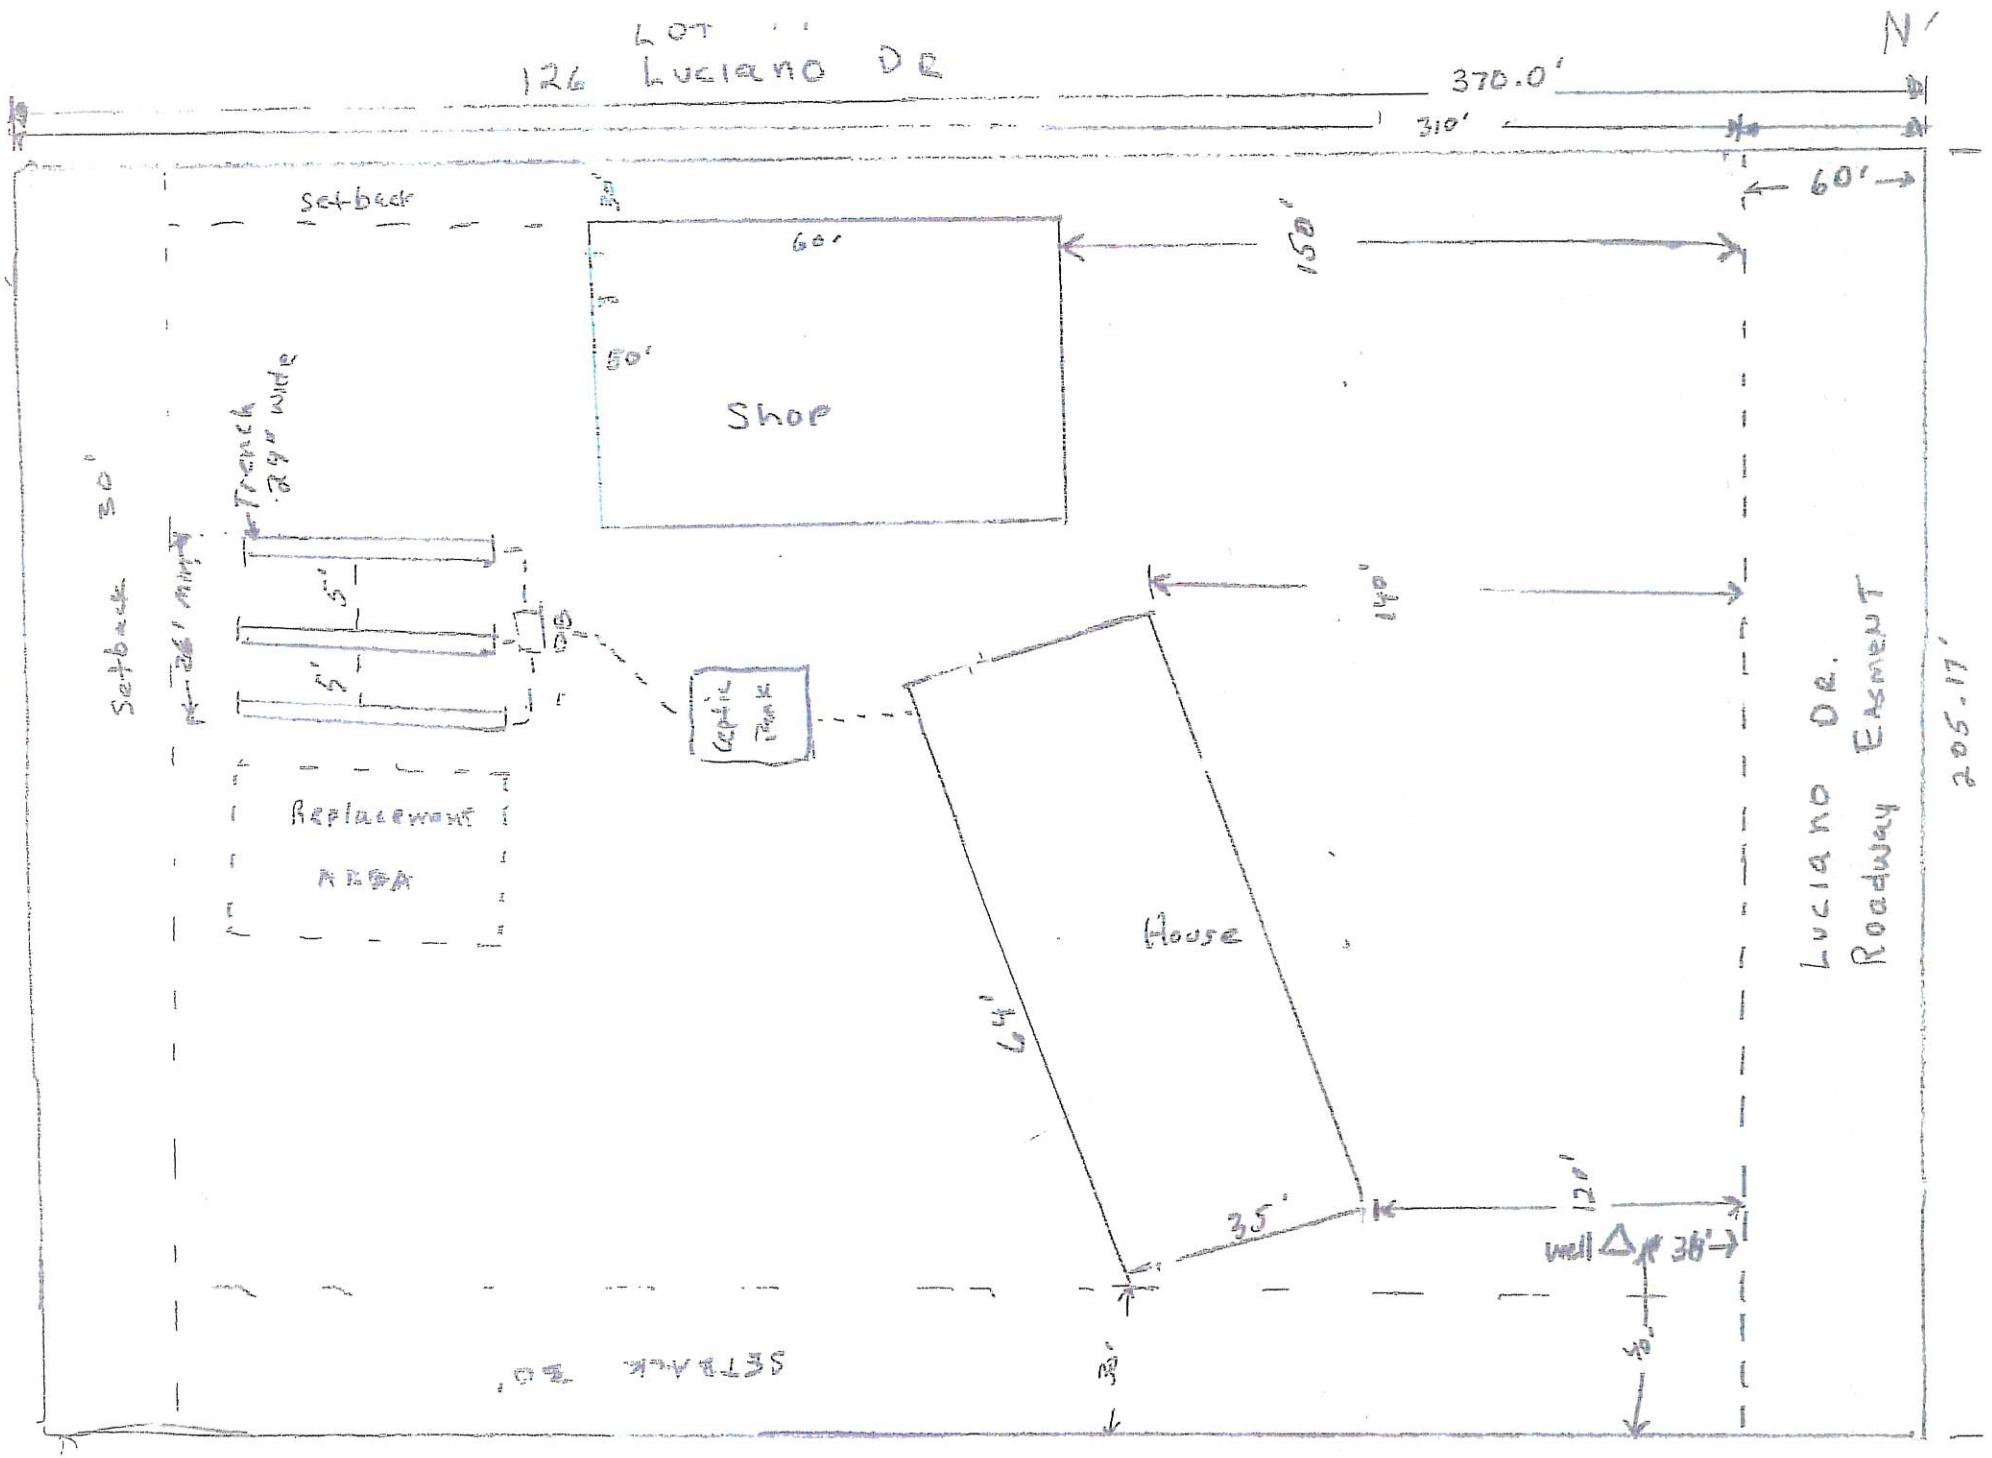
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: [signature] *Date:* 7/25/23

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


LOT
126 Luciano Dr
N
370.0'
310'
60'
Setback
30'
60'
150'
50'
Shop
Setback 30'
36' Alley
Tractor 8'6" wide
5'
5'
5'
Septic Tank
Replacement Area
140'
House
64'
35'
120'
well
36'
Luciano Dr.
Roadway Easement
205.17'
SETBACK 30'
3'