LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/24/2023 Expiration Date: 10/23/2024

Property Owner: Pat Neils

Mailing Address: [redacted]

Telephone: 808-348-3011 E-mail: patneils5@yahoo.com

Installer: Terry Oedewaldt License #: 2

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new septic system.

Parcel Description:

Legal: EDGEWATER ESTATES PH 2, S35, T31 N, R31 W, LOT 26, ACRES 1.026, PM 4936

Property Address: 404 Edgewater Dr. Libby, MT 59923 Assessment Code: 13196

DEQ COSA: EQ# 27-93-L1-72 Date: 07/28/1993

Approved Design Criteria: Installation of new pressure dosed septic system with 3 laterals @60'.

# of Bedrooms: 4 Septic Tank Size: 1500/500 Trench Width: 36"

# of Laterals: 3 Length of Laterals: 60' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, SIT

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

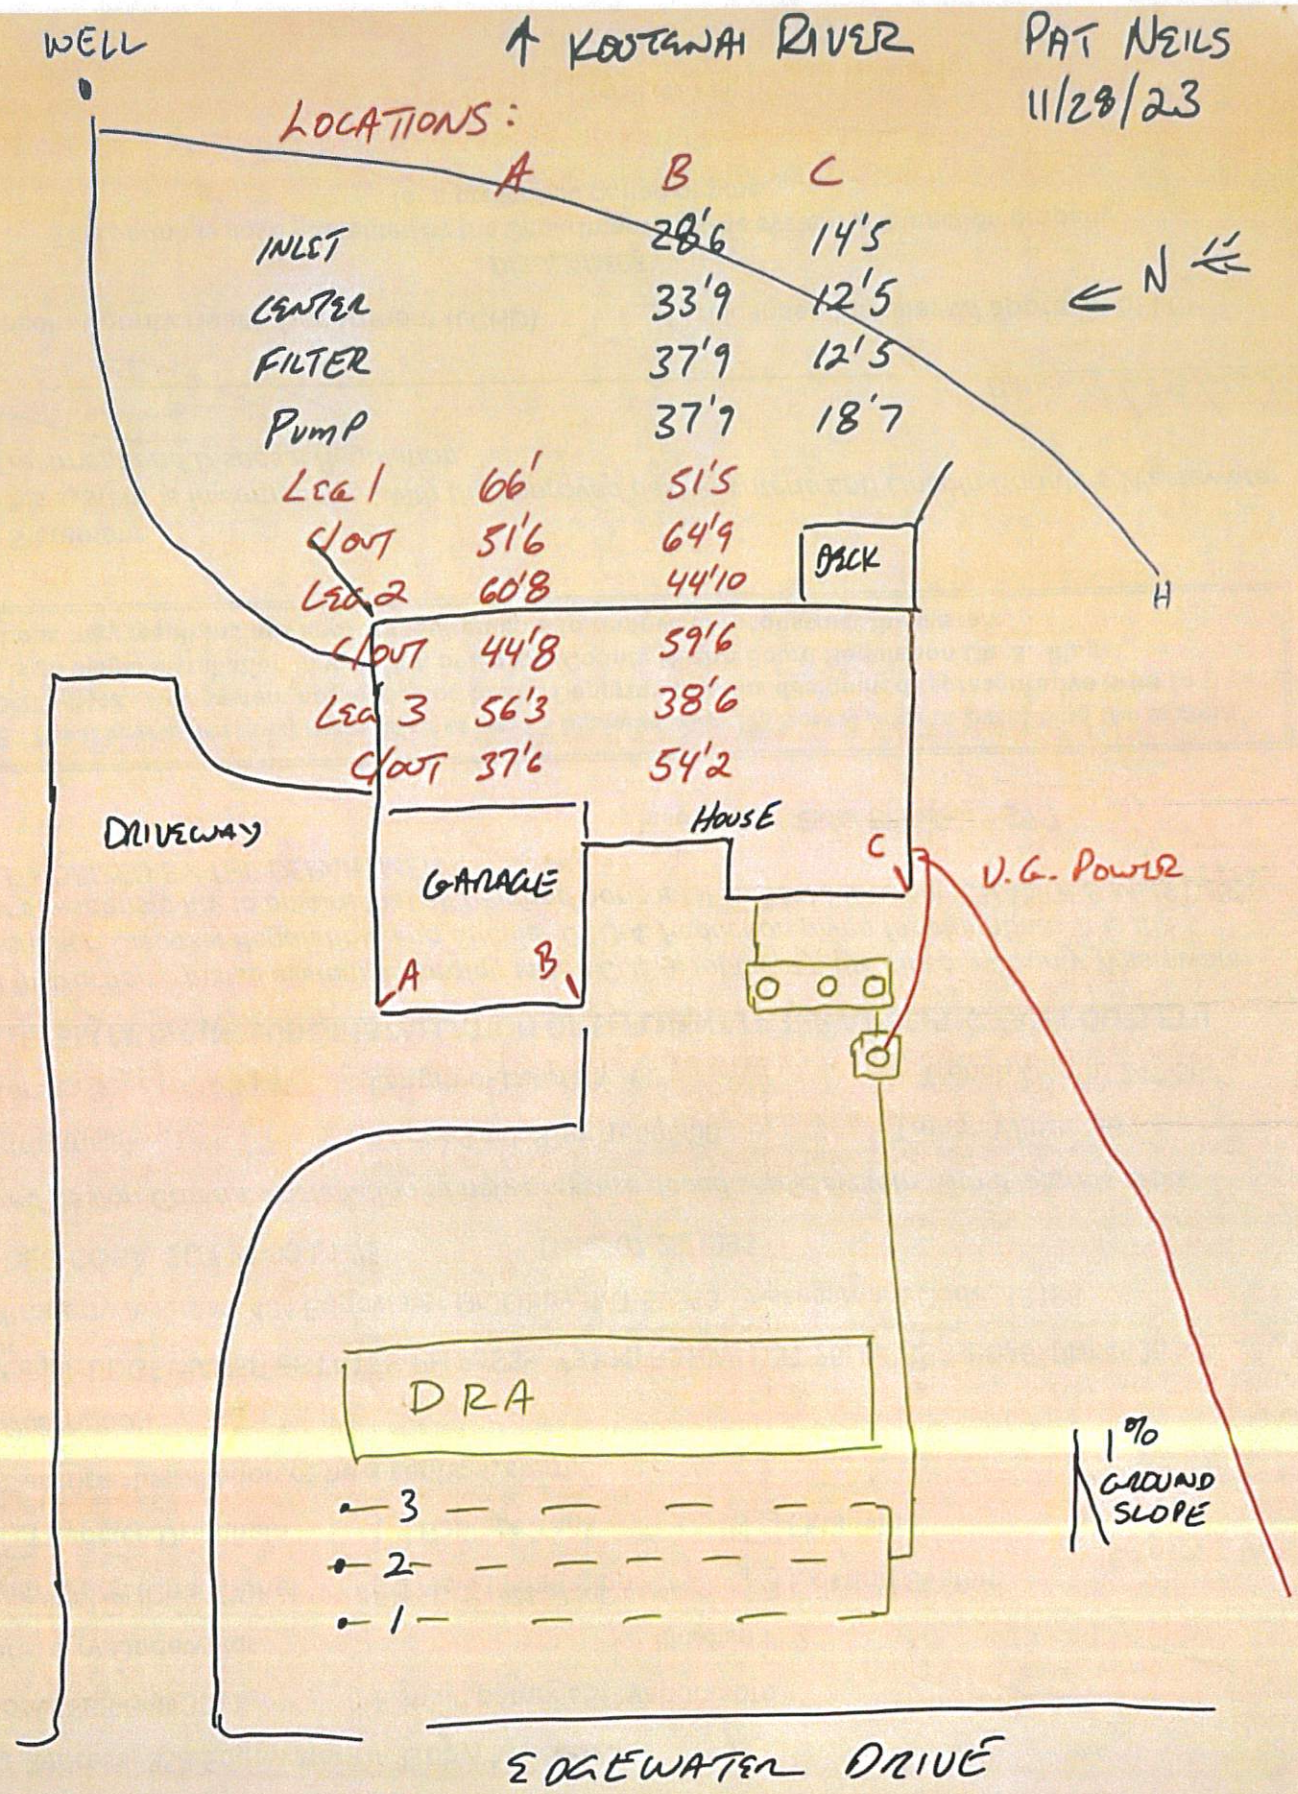
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* 11/28/2023

____ Lincoln County Health Department (LCHD) ✓ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


WELL
↑ KOOTENAI RIVER
PAT NEILS
11/28/23
LOCATIONS:
A
B
C
INLET
28'6
14'5
CENTER
33'9
12'5
FILTER
37'9
12'5
PUMP
37'9
18'7
Leg 1
66'
51'5
C/OUT
51'6
64'9
Leg 2
60'8
44'10
C/OUT
44'8
59'6
Leg 3
56'3
38'6
C/OUT
37'6
54'2
N
BACK
H
DRIVEWAY
GARAGE
HOUSE
A
B
C
U.G. POWER
DRA
3
2
1
1% GROUND SLOPE
EDGEWATER DRIVE