Permit # 24-53301

LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 12/15/2023 Expiration Date: 12/14/2024

Property Owner: Rick and Kristy Nielson

Mailing Address: [redacted]

Installer: Billie Gardner License #: 177

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity septic system.

Parcel Description:

Legal: SWEDE BLUFF ESTATES, S25, T30 N, R31 W, LOT 19, ACRES 5.007, PM 5822

Property Address: 1617 Swede Mountain Rd. Libby, MT 59923 Assessment Code: 53301

DEQ COSA: EQ#27-95-L3-49 Date: 01/10/1995

Approved Design Criteria: Installation of new gravity septic system with 3 Laterals @ 74'.

# of Bedrooms: 2	Septic Tank Size: 1000 gallon	Trench Width: 24"
# of Laterals: 3	Length of Laterals: 74'	Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

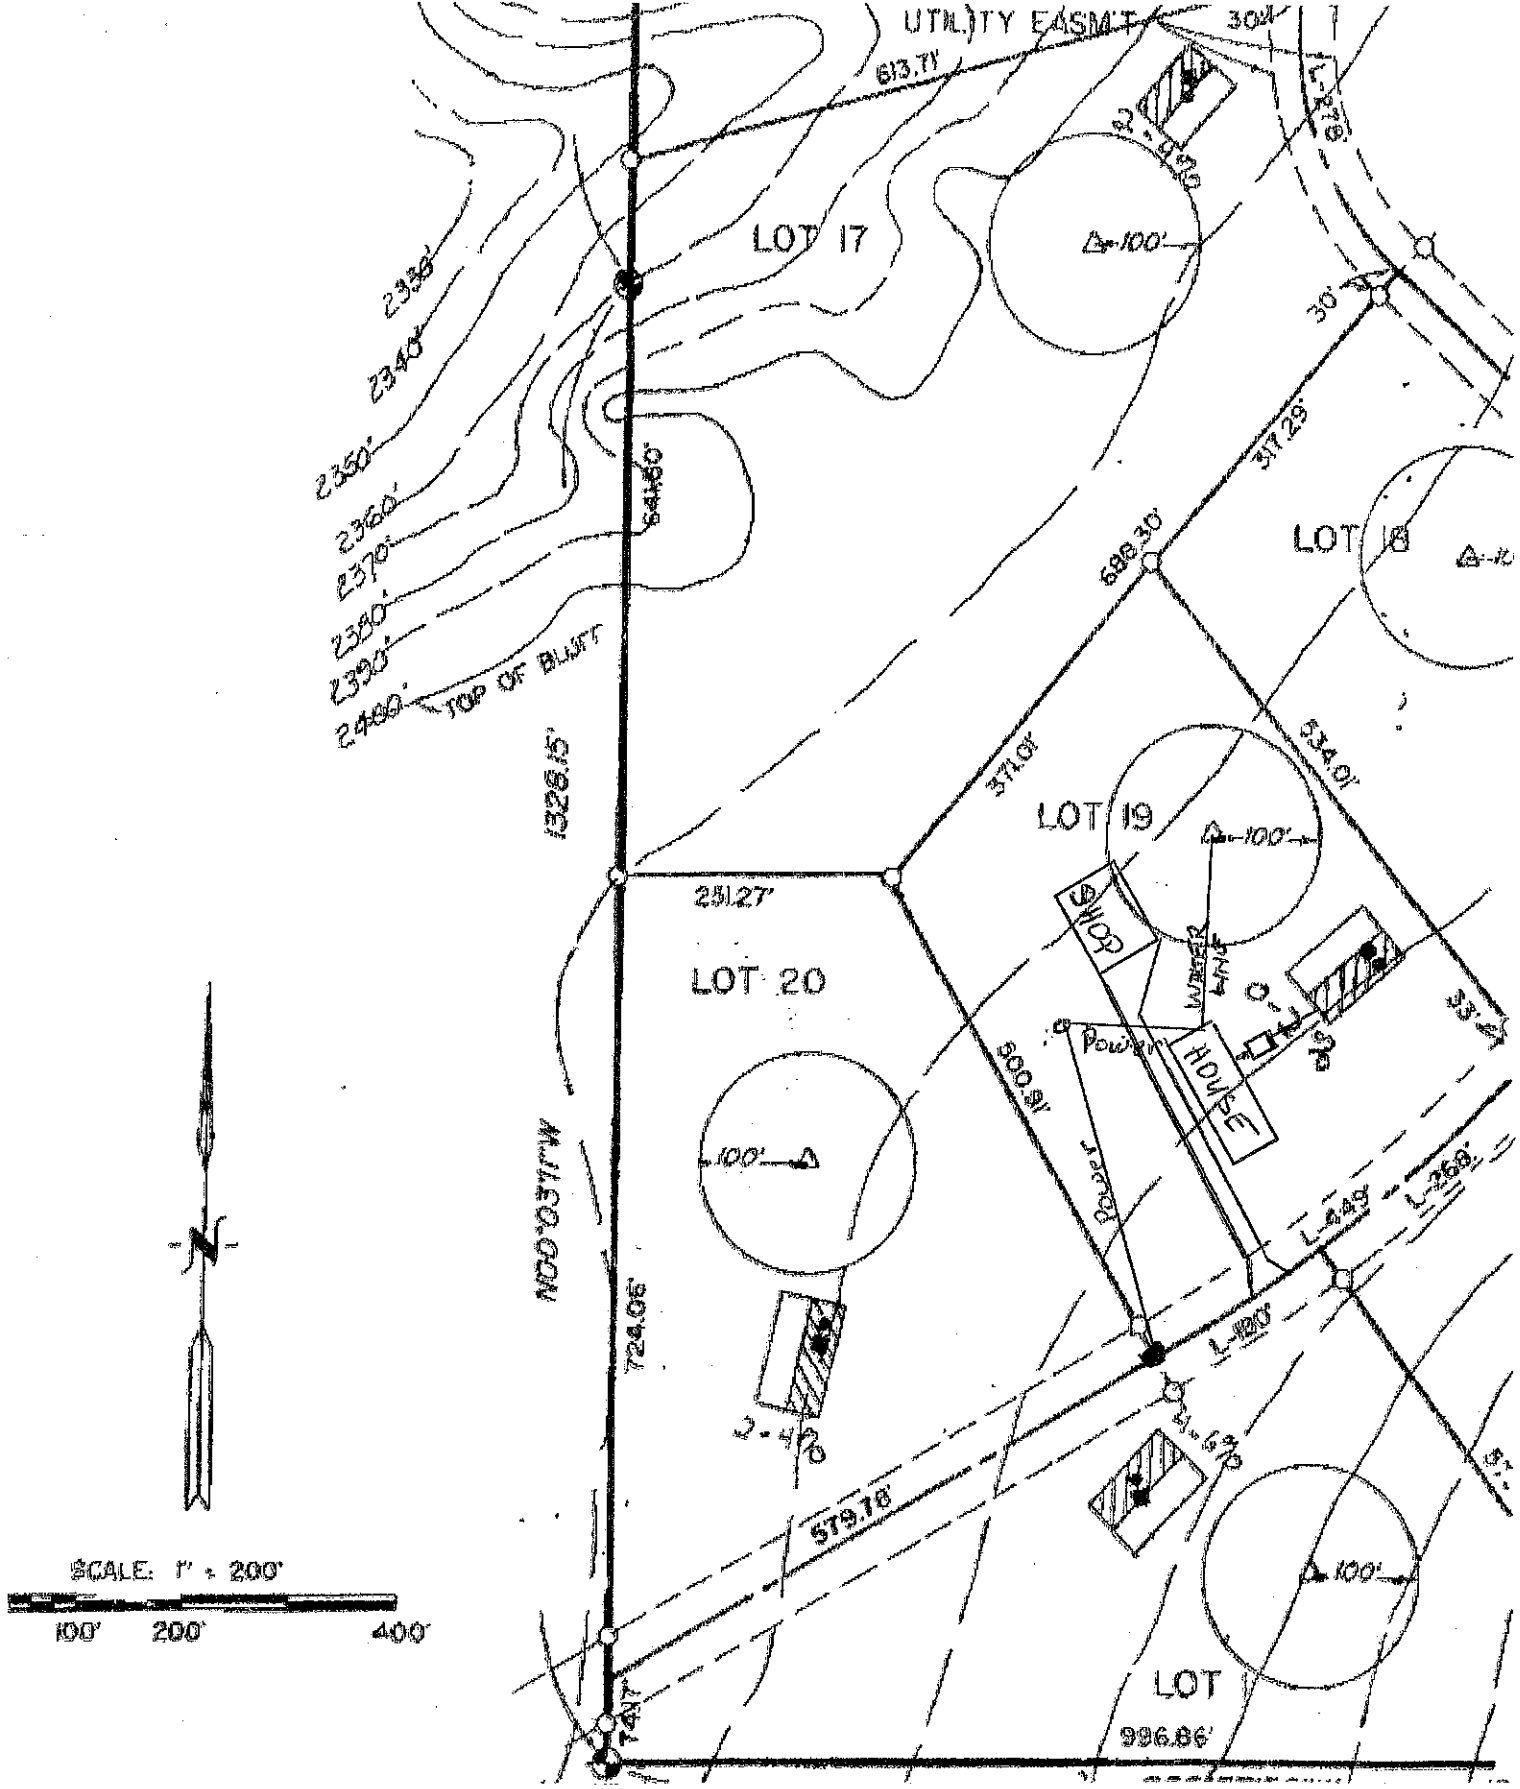
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 2/28/24

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


UTILITY EASM'T
613.71'
LOT 17
LOT 18
LOT 19
LOT 20
LOT
2356'
2340'
2350'
2360'
2370'
2380'
2390'
2400'
TOP OF BLUFF
1328.15'
N00°03'11"W
724.06'
644.50'
698.30'
317.29'
371.01'
534.01'
251.27'
600.91'
579.18'
996.86'
100'
30'
HOUSE
Power
WATER LINE
L=449'
L=268'
L=180'
SCALE: 1" = 200'
100' 200' 400'
N