LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/18/2023 Expiration Date: 08/17/2024

Property Owner: Peggy Jane Ousley

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Kootenai Sand & Gravel License #: 109

Approved Work: (Check One) ☐ New Installation ☐ Existing System

☒ Replace Drainfield ☒ Replace Tank ☐ Extension

Describe: Installation of replacement tank and drainfield.

Parcel Description:

Legal: S33, T37 N, R27 W, COS 804, ACRES 10

Property Address: 2056 Sophie Lake Rd., Eureka, MT 59917 Assessment Code: 6870

DEQ COSA: EQ#27-80-S33-K272 Date: 07/07/80

Approved Design Criteria: Installation of replacement tank and drainfield with 2 laterals@90'.

# of Bedrooms: 3 Septic Tank Size: 1000 gallon Trench Width: 24"

# of Laterals: 2 Length of Laterals: 90' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, SIT

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

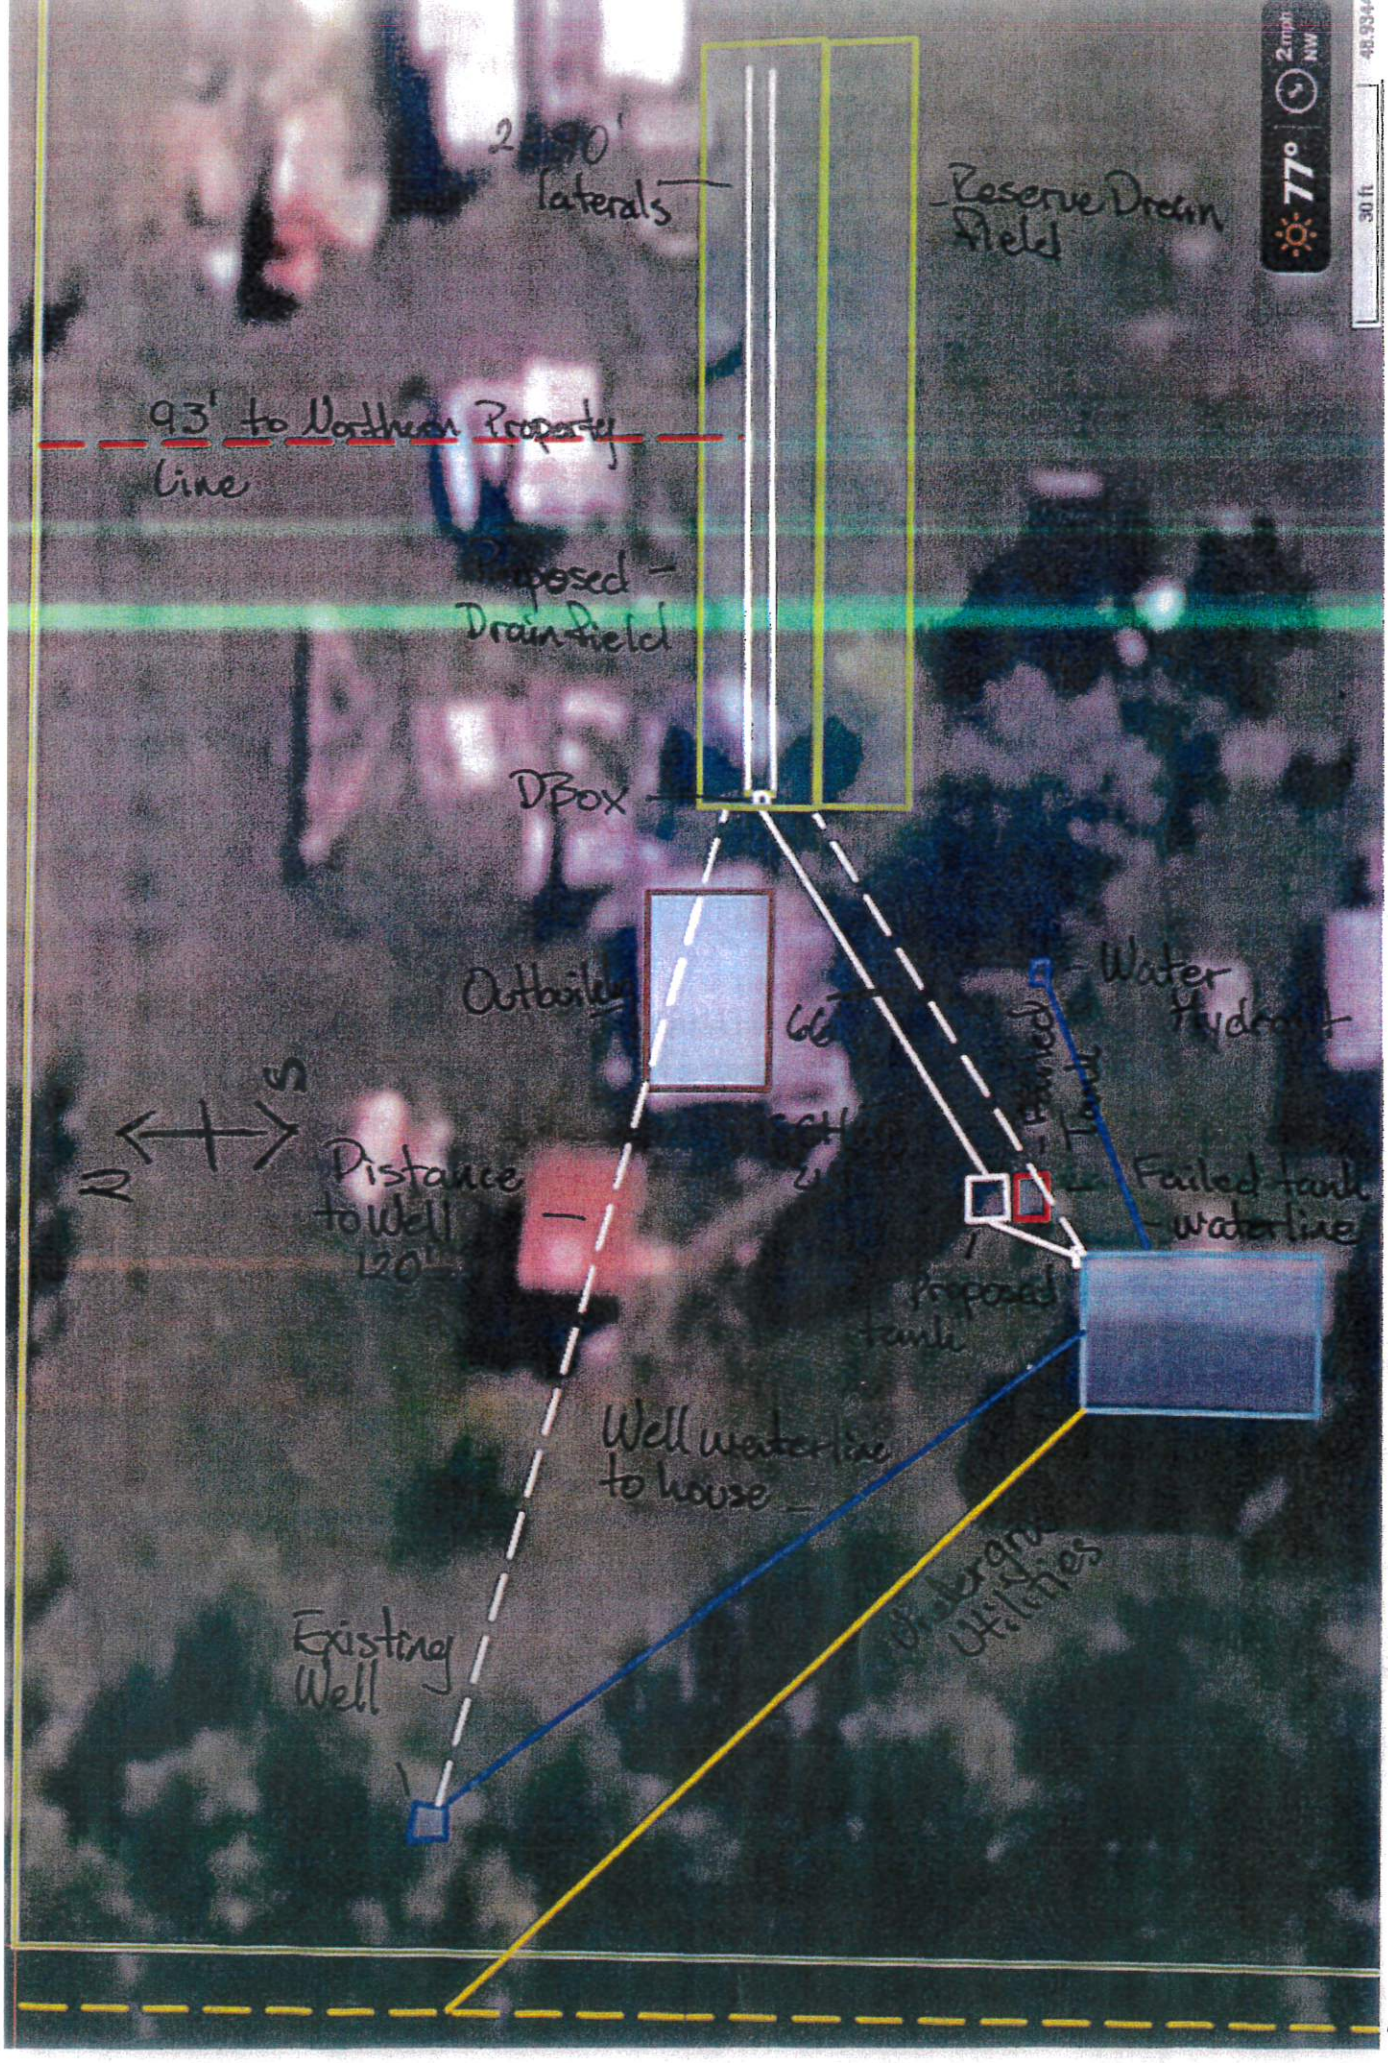
Signed: [signature] Date: 10/3/23

____ Lincoln County Health Department (LCHD) X Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

5


2 [illegible]0'
laterals
Reserve Drain Field
93' to Northern Property line
Proposed Drain field
DBox
Outbuilding
Water Hydrant
Planted Lawn
Failed tank waterline
Distance to well 120'
Proposed tank
Well waterline to house
Existing Well
Underground Utilities
77°
2 mph NW
30 ft