LINCOLN COUNTY HEALTH DEPARTMENT Permit # 23-8493
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 09/07/2023 Expiration Date: 09/06/2024

Property Owner: Steve Parker

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Patriot Property Services License #: 196

Approved Work: (Check One) ☐ New Installation ☒ Existing System

☒ Replace Drainfield ☒ Replace Tank ☐ Extension

Describe: Installation of replacement system with upgrade to pressure dosed system.

Parcel Description:

Legal: S26, T31 N, R31 W, COS 4183, PARCEL A, ACRES 1.33, IN NWNWSW

Property Address: 451 Sheldon Flats Rd., Libby, MT 59923 Assessment Code: 8493

DEQ COSA: EQ#13-1311 Hansen Family Transfer Date: 10/26/2012

Approved Design Criteria: Installation of replacement pressure dosed system for failing and undersized system.

# of Bedrooms: 5 Septic Tank Size:1500/500 Trench Width: 36"

# of Laterals: 3 Length of Laterals: 44' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, SIT

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

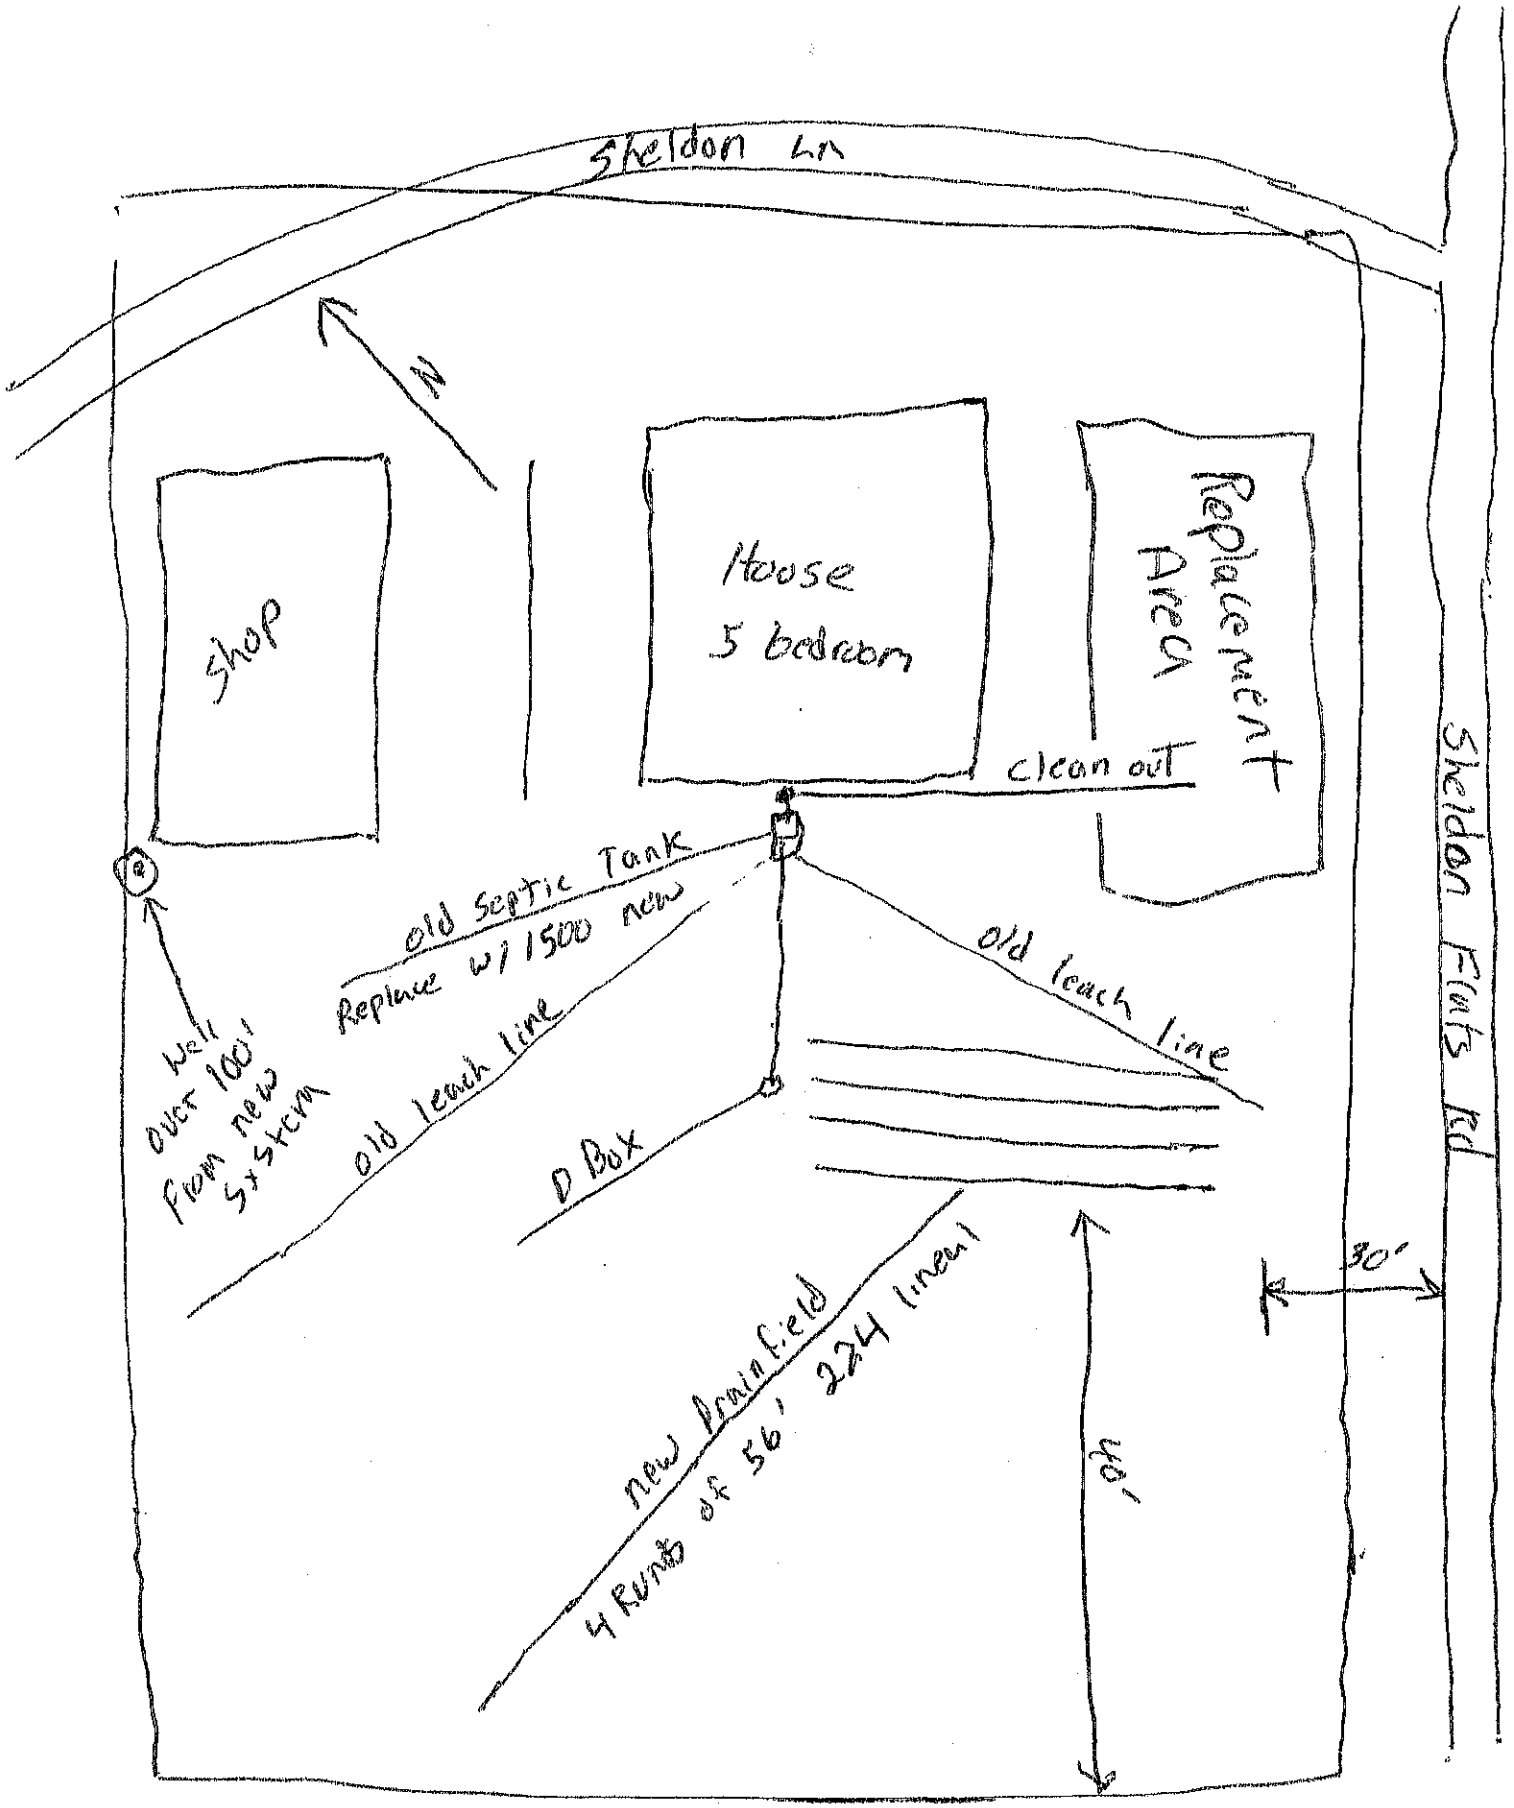
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 9/15/23

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Sheldon Ln
N
shop
House
5 bedroom
Replacement
Area
clean out
Sheldon Flats Rd
old Septic Tank
Replace w/ 1500 new
old leach line
old leach line
Well
over 100'
From new
System
D Box
new Drainfield
4 Runs of 56' 224 (new)
30'
40'