LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/15/2023 Expiration Date: 06/14/2024

Property Owner: Jonathan Peltier

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Charley Follensbee License #: 96

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system with chambers.

Parcel Description:

Legal: BRIMSTONE CREEK, S30, T34 N, R25 W, LOT 1, ACRES 3.02, PM 7046

Property Address: 1903 Fortine Creek Rd., Trego, MT 59934 Assessment Code: 52626

DEQ COSA: EQ#09 2175 Brimstone Creek Subdivision Date: 7/29/09

Approved Design Criteria: Installation of new gravity system with chambers and 4 Laterals@84' with end caps.

# of Bedrooms: 5	Septic Tank Size: 1500 gallons	Trench Width: 24"
# of Laterals: 4	Length of Laterals: 84'	Trench Depth: 36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, SIT

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 9/6/23

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


GRAPHIC SCALE

100 0 50 100

(IN FEET)

1 inch = 100 ft.



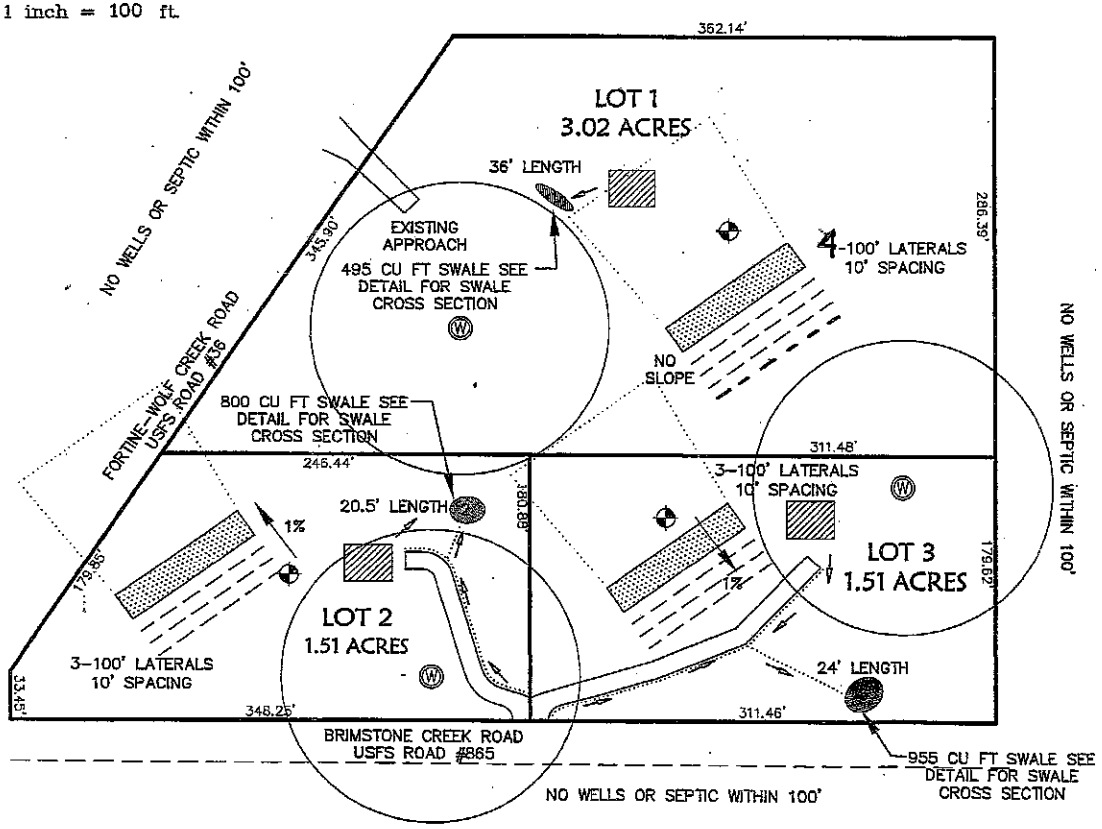


STORM STRUCTURES OPERATION AND MAINTENANCE

1. DRAINAGE SWALES ON EACH LOT WILL BE OWNED AND MAINTAI BY EACH RESPECTIVE INDIVIDUAL LOT OWNER.
2. THE DRIVEWAY DITCHES WILL BE MAINTAINED BY EACH INDIVIDU LOT OWNER.


NOTE: IT IS THE RESPONSIBILITY OF THE LOT OWNER TO KEEP THI STORMWATER STRUCTURES (INCLUDING THE DRIVEWAY DITCH AND STORM RETENTION SWALE) ON THE LOT CLEAR OF DEBRIS AND INSPECTED ANNUALLY TO ASSURE FUNCTIONAL WORKING ORDER.

Driveway Ditch Cross Sec

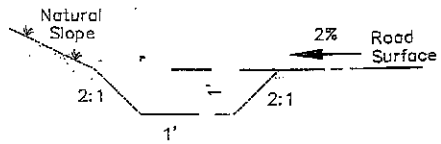


y the Local Reviewing Authority
Under contract with the
ment of Environmental Quality/ PCD

Typical Retention Swale Lot 1

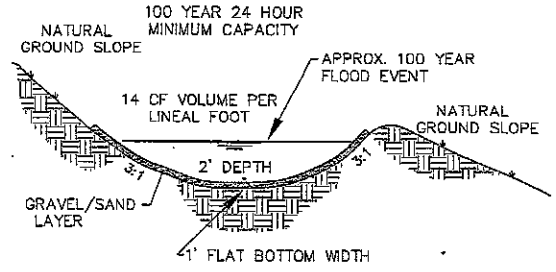

Typical Retention Swale Lot 2 and Lot 3

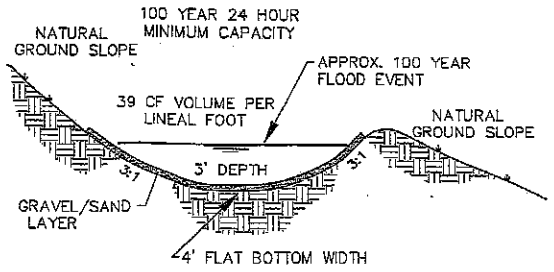

LEGEND

- P- HOMESITE
- P- PROPOSED WELL
- P- DRAINFIELD AND
- P- MIXING ZONE
- P- LOT BOUNDARY
- P- EXTERIOR LOT BO
- P- DRIVEWAY LIMITS
- P- STORM RETENTIO
- SOILS PROFILE LOCA
- SURFACE DRAINAGE