LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 09/07/2023 Expiration Date: 09/06/2024

Property Owner: Ronald Pinzker

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Licensed Lincoln County Installer License #:

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system for shop with bathroom.

Parcel Description:

Legal: S11, T37 N, R27 W, COS 4888, PARCEL C, ACRES 5.07

Property Address: 127 Horse Collar Ln., Eureka, MT 59917 Assessment Code: 17953

DEQ COSA: EQ#23-2455 Date: 08/18/2023

Approved Design Criteria: Installation of new gravity system with 2lateral@36' with reduction for chambers.

# of Bedrooms: 1	Septic Tank Size: 1000	Trench Width: 24"
# of Laterals: 2	Length of Laterals: 36'	Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, S97

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.


Signed: Robin Blumberg Date: 10/23/23

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV

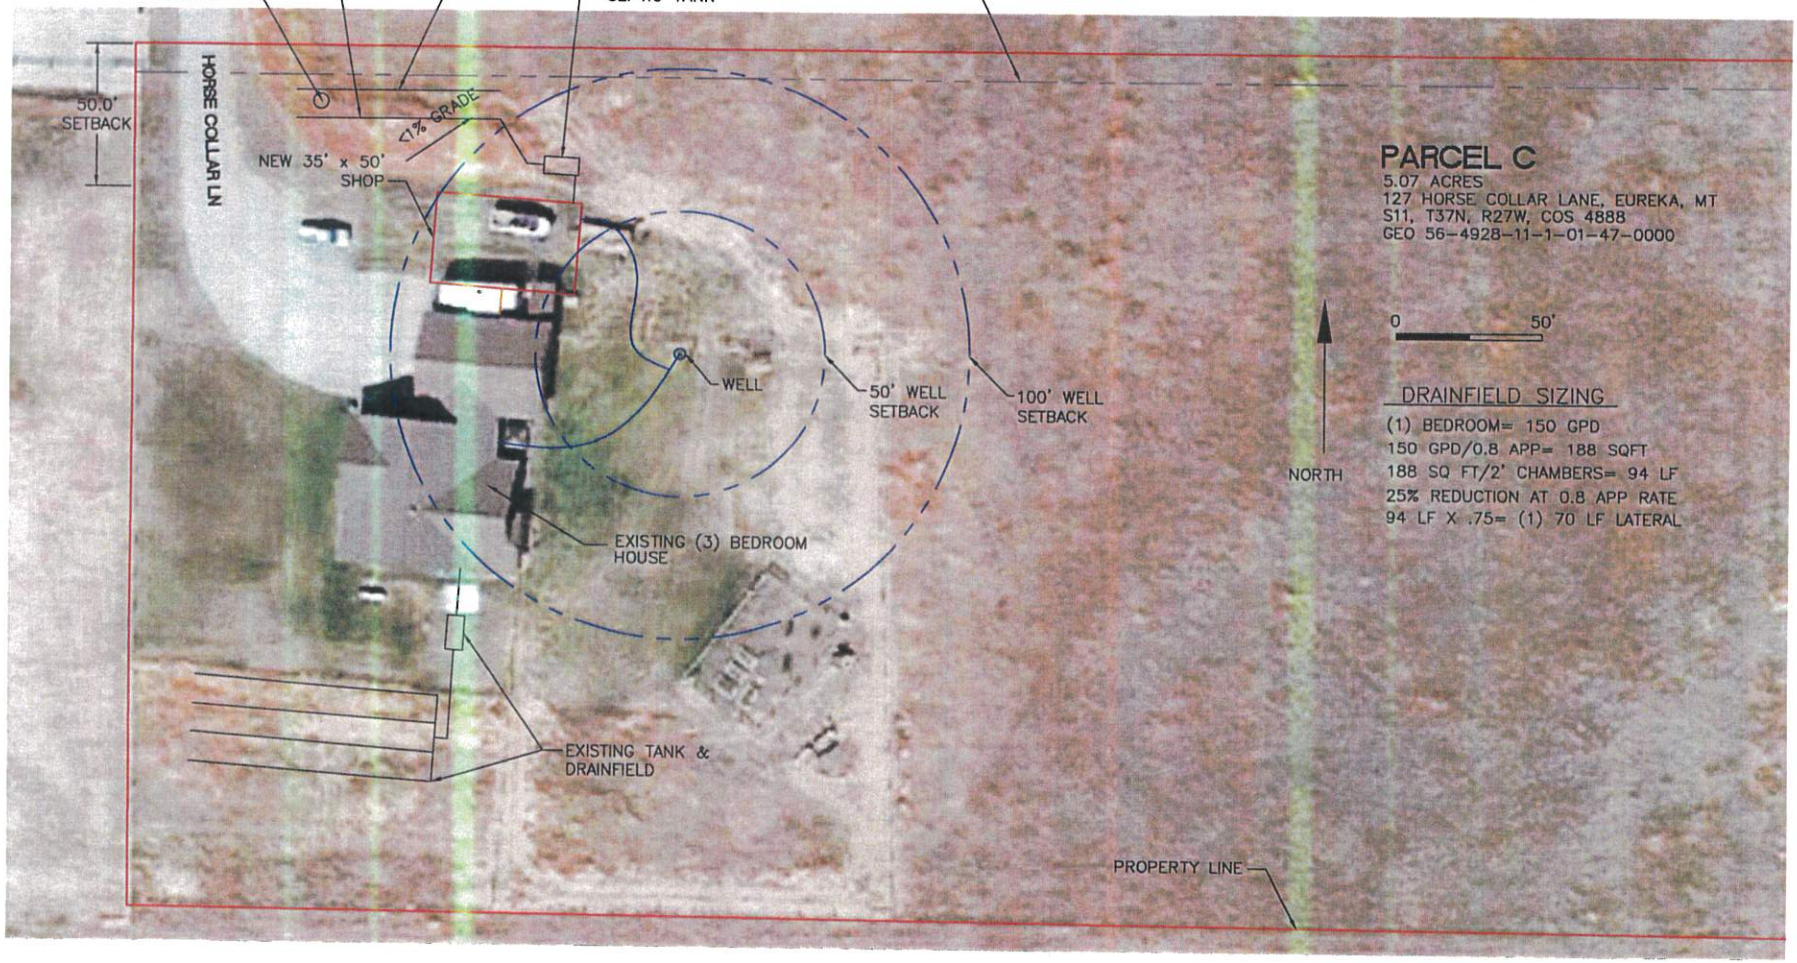

RON PINZKER SITE MAP

REV	DESCRIPTION	BY/DATE	APRD/DATE

REV	DATE	COMPANY	SCALE:		SCHMIDT HAULING & EXCAVATION PINZKER SEPTIC
		DSHE	1/16 = NOTED		SITE LAYOUT
		CONTRACT:	DATE:	DWG TOLERANCES:	SCHEMATIC 3/15/23
		VERBAL	3/2023		
		PLOT FILE:	WEIGHT	FINISH	D. SCHMIDT 3/15/23
		PHL-0001	----		402-001 1

THIS DRAWING IS PROPERTY OF SCHMIDT UNDER CONTRACT HAS BEEN SECURED BETWEEN OWNER & SCHMIDT IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM MDS MANAGEMENT