LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/15/2023 Expiration Date: 08/14/2024

Property Owner: Carl and Carmen Pollock

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Clasen License #: 181

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system.

Parcel Description:

Legal: BORDER MEADOWS, S11, T37 N, R27 W, LOT 3, ACRES 5.022, PM #5856

Property Address: 5946 Airport Rd. Eureka, MT 59917 Assessment Code: 50272

DEQ COSA: EQ#97-1002 Date: 06/27/2023

Approved Design Criteria: Installation of pressure dosed system with chambers..

# of Bedrooms: 3 Septic Tank Size: 1000/500 gallon Trench Width: 36"

# of Laterals: 2 Length of Laterals: 68' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, SIT

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.


Signed: _____ *Date:* _____

_____ Lincoln County Health Department (LCHD) _____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

Border Meadow Sub.
WATER & SEWER PLAN
6-5-96

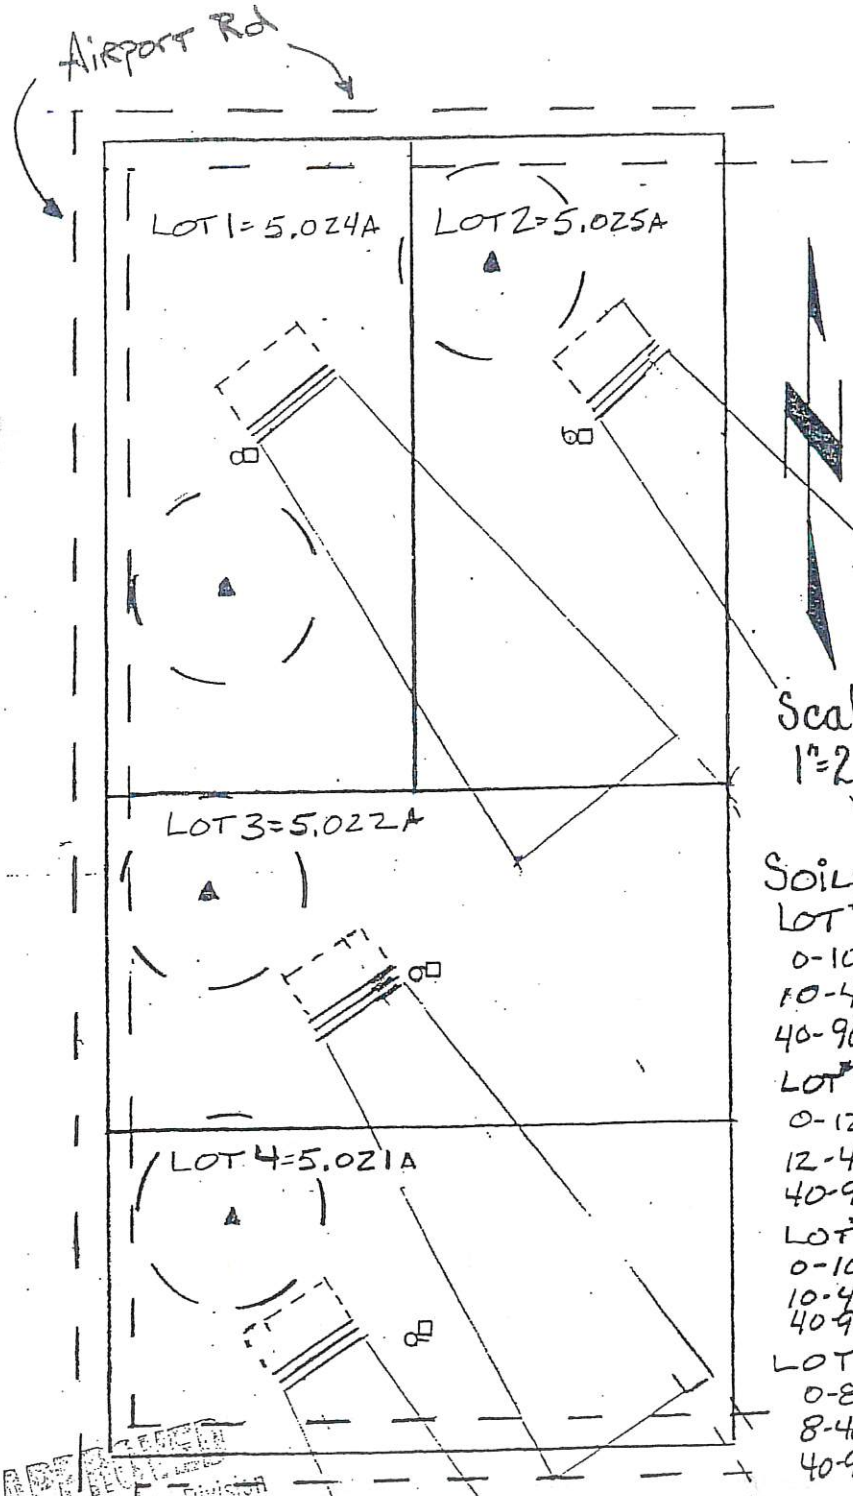

Legend:
- O - perc test
- □ - test hole
- (Δ) - well site w/100' isolation zone
- ═══ - Drainfield
- - - - - replacement site

* ALL SITES NEARLY LEVEL

Perc Rates:
LOT 1 = 13 MIN/INCH
LOT 2 = 5 MIN/INCH
LOT 3 = 10 MIN/INCH
LOT 4 = 3½ MIN/INCH

Scale 1" = 200'

Soils:

LOT #1
0-10" - Top soil
10-40 - loamy gravel
40-96 - gravel w/cobbles

LOT #2
0-12" - Top soil
12-40 - Sandy GRAVEL
40-96 - GRAVEL

LOT #3
0-10" - TOP SOIL
10-40 - loamy GRAVEL
40-96 - GRAVEL

LOT 4
0-8" - TOP SOIL
8-40" - GRAVELLY SAND
40-96 - GRAVEL w/COARSE SAND

No evidence of groundwater or bedrock
Estimated depth to groundwater is greater than 7 feet.

No existing septic systems or wells within 100' of boundaries

APPROVED
Water Quality Division
Montana Department of
Environmental Quality
7/9/96
Date
RAP
Project Officer

RECEIVED
JUL 01 1996
MONTANA
DEPT. OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION