LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/30/2023 Expiration Date: 10/29/2024

Property Owner: AlauraAnn Rapley & Ryan Wood

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Anderson Excavating License #: 175

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system with 3 laterals @ 76'.

Parcel Description:

Legal: MAJESTIC MOUNTAIN VIEWS, S35, T30 N, R31 W, LOT 4, ACRES 1.8, PM 6922

Property Address: 145 Majestic Mountain Rd. Libby, MT 59923 Assessment Code: 50120

DEQ COSA: EQ# 08-1859 Majestic Mountain Views Date: 05/02/2008

Approved Design Criteria: Installation of new gravity system with 3 laterals @ 76' with reduction for chambers.

# of Bedrooms: 4 Septic Tank Size: 1500 gallons Trench Width: 24"

# of Laterals: 3 Length of Laterals: 84' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, S97

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 1/10/24

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV

K.E.D.
Lg# 08-1859


LINCOLN COUNTY, MONTANA
LOT LAYOUT
MAJESTIC MOUNTAIN VIEWS
IN THE SE1/4 SE1/4OF SECTION 35,
TWP. 30 N., R. 31 W., P.M.M.
FOR: JACOBY DEVELOPMENT L.L.C. DATE: JANUARY 2007



ALONG THE UPPER DITCH LINES OF APPROACH ROADS

NO WELLS OR SEPTICS WTIHIN 100' OF PROPERTY BOUNDARIES

RECEIVED
MAR 1 8 2008
MT DEQ PUBLIC WATER & SUBDIVISIONS BUREAU

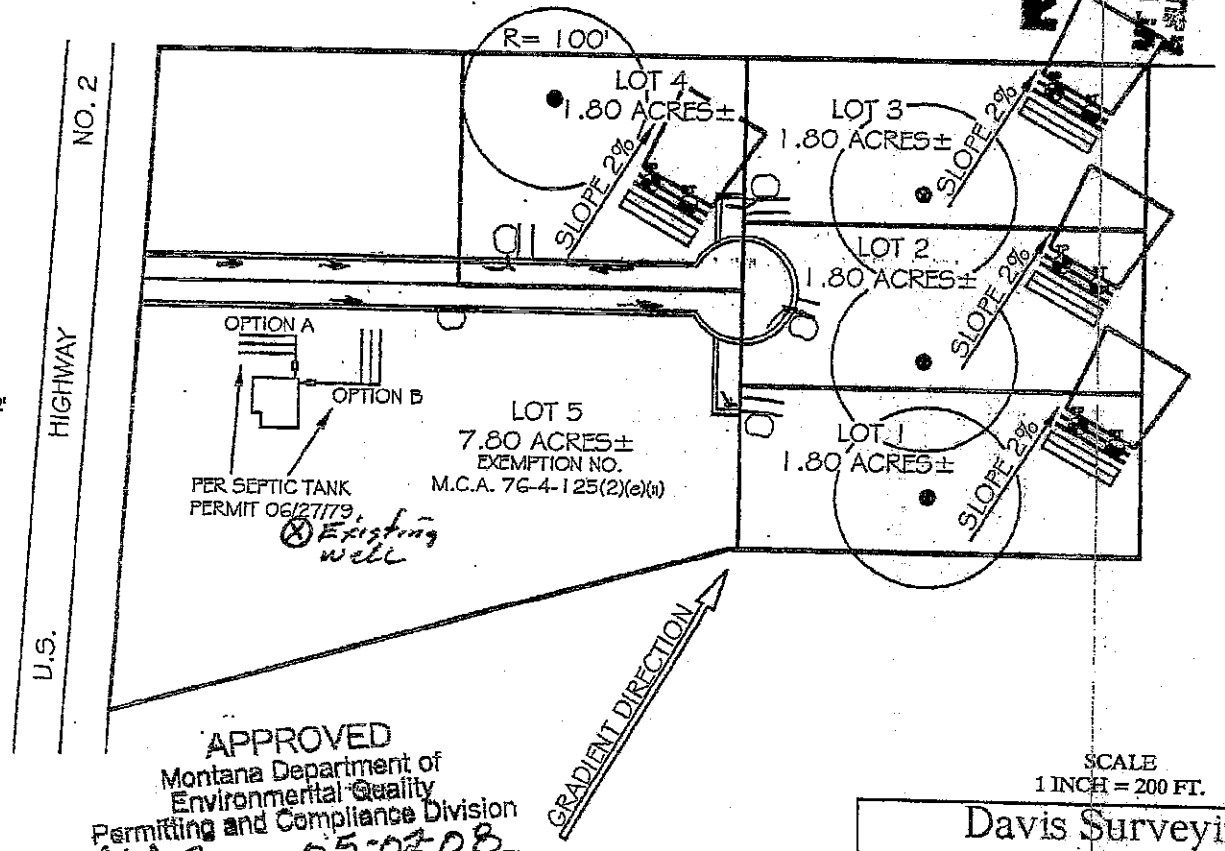

LEGEND

- SOILS PROFILE
- PERCOLATION SITE
- PROPOSED WELL SITE
- STORMWATER POND 20'X30'X2'
- SLOPE
- GRADIENT DIRECTION
- PROPOSED SEPTIC SITE 3-85' TRENCHES 10' APART
- REPLACEMENT SITE 3-85' TRENCHES 10' APART
- 100' MIXING ZONE

APPROVED
Montana Department of Environmental Quality
Permitting and Compliance Division
MAS 05-02-08
Reviewer Date

SCALE
1 INCH = 200 FT.

Davis Surveying Inc.
TROY MONTANA, (406)295-5441

DATE: 01/03/07	
DRAWN BY: MDM	FILE: T30R31S35.DWG