LINCOLN COUNTY HEALTH DEPARTMENT Permit #24-1351
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/19/2024 Expiration Date: 04/18/2025

Property Owner: Larry and Judy Russell

Mailing Address: [redacted]

Installer: Noel Duram License #: 186

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity wastewater system.

Legal: S11, T33 N, R26 W, ACRES 40, SESW OR TR-4

Property Address: 6278 Fortine Creek Rd., Trego, MT 59934 Assessment Code: 1351

DEQ COSA: E.Q.# Date:

Approved Design Criteria: Installation of new gravity system with 3 Laterals @ 84' with reduction for chambers. Minimum of 400' from Fortine Creek. Maximum trench width 24" Minimum 5' of natural soil between trenches. Maximum trench depth 36".

# of Bedrooms: 3 Septic Tank Size: 1000gallons Trench Width: 24"

# of Laterals: 3 Length of Laterals: 84' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, RS

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 7/12/24


✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

SV

LOT LAYOUT

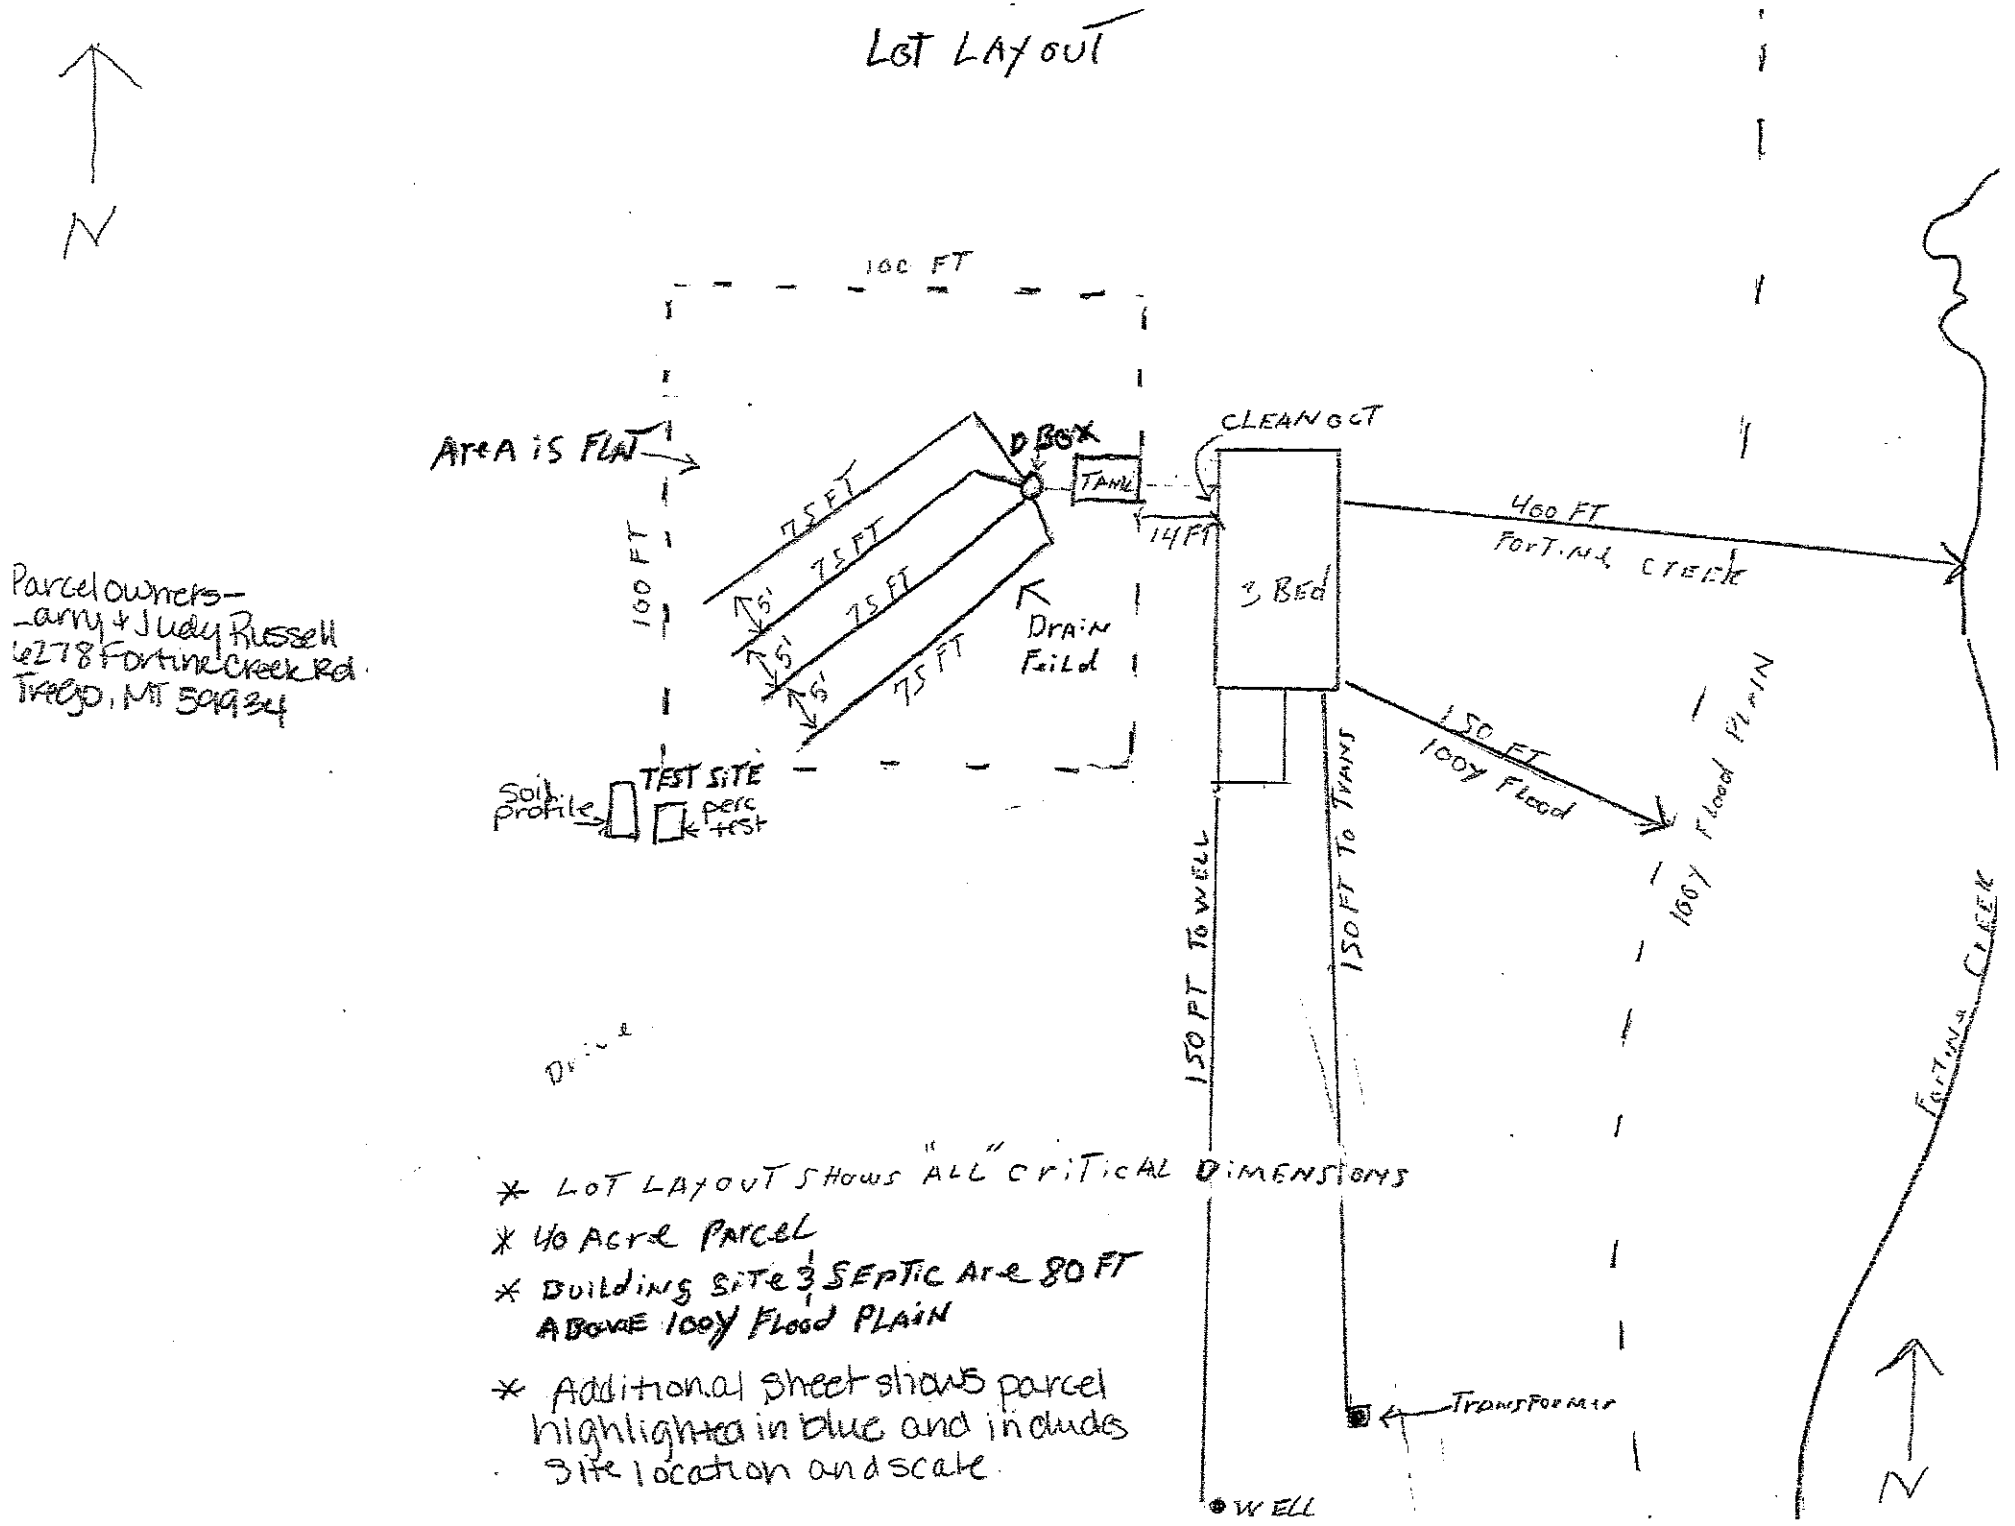

Parcel owners—
—amy + Judy Russell
6278 Fortine Creek Rd.
Trego, MT 59934

* LOT LAYOUT SHOWS "ALL" CRITICAL DIMENSIONS
* 40 Acre Parcel
* BUILDING SITE 3/4 SEPTIC ARE 80 FT ABOVE 100Y FLOOD PLAIN
* Additional sheet shows parcel highlighted in blue and includes site location and scale.