LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/02/2023 Expiration Date: 05/01/2024

Property Owner: SPP Montana LLC

Mailing Address: [redacted]

Telephone: [redacted] E-mail:

Installer: Brian Anderson License #: 175

Approved Work: (Check One) ☐ New Installation ☒ Existing System

☒ Replace Drainfield ☒ Replace Tank ☐ Extension

Describe: Replace and upgrade existing system with pressure dosed sand lined system with chambers.

Parcel Description:

Legal: S27, T30 N, R27 W, ACRES 134.96, TR A1 IN W2W2

Property Address: 15337 Wolf Creek Rd, Libby, MT, 59923 Assessment Code: 11591

DEQ COSA: Date:

Approved Design Criteria: Pressure dosed system, sand lined, chambers, 2 lateral @56'

# of Bedrooms: 4 Septic Tank Size: 1000/500 gallons Trench Width: 36"

# of Laterals: 2 Length of Laterals: 56' Trench Depth: 24-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. Reduction given for chambers. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, SIT*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

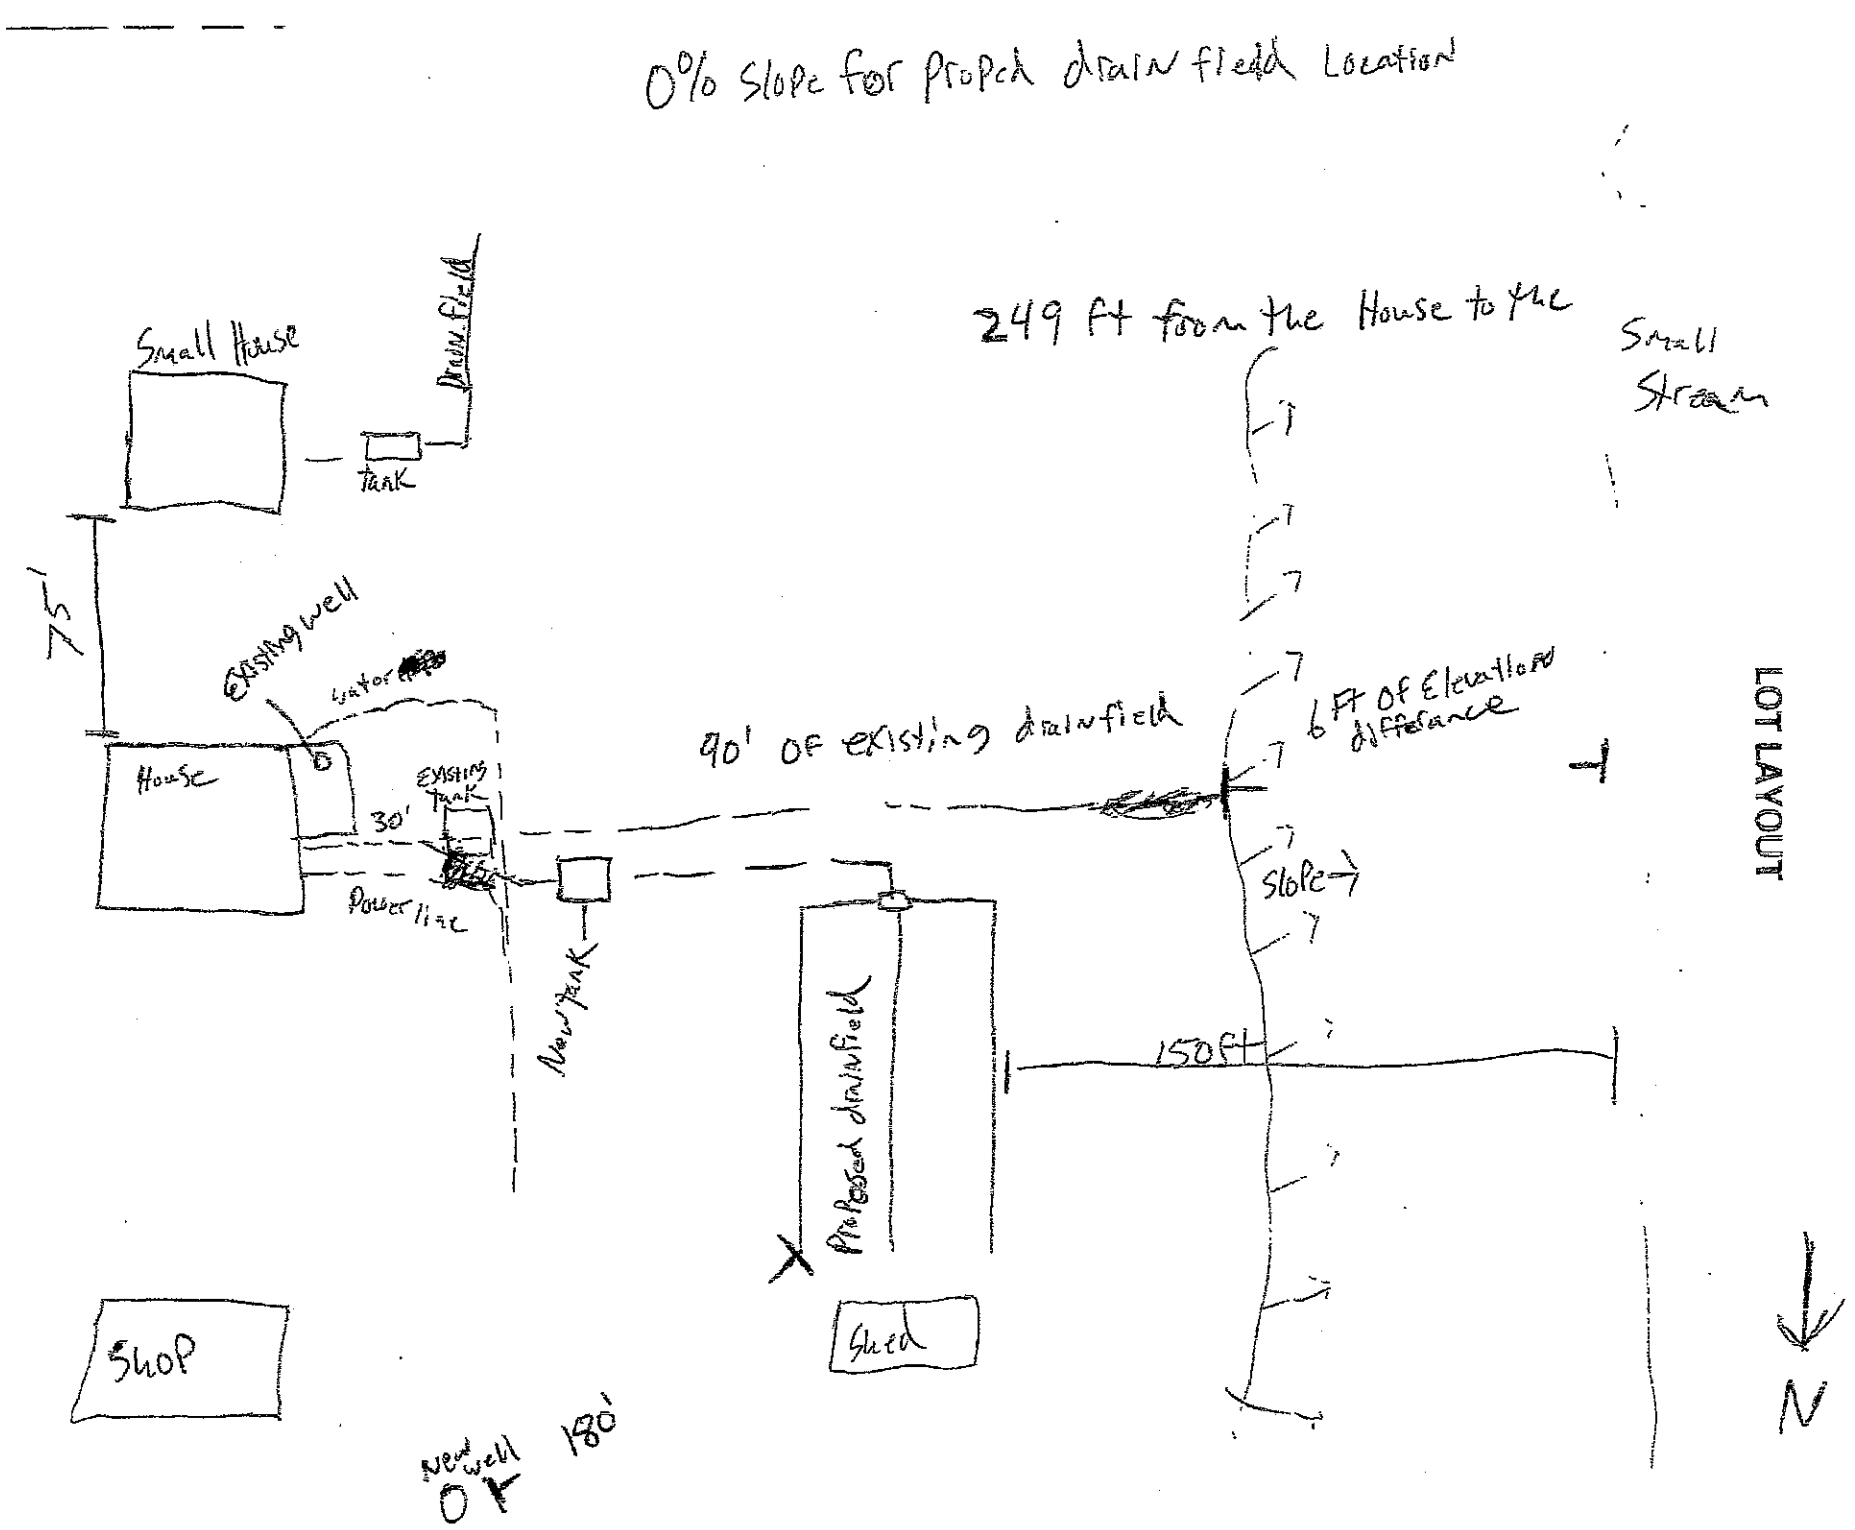
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 6/16/23

__✓__ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


0% Slope for Propch drain field Location
Small House
Drain field
Tank
75'
Existing well
House
30'
Existing Tank
Power line
New Tank
90' of existing drainfield
249 ft from the House to the Small Stream
6 FT of Elevation difference
Slope
150ft
Proposed drainfield
Shed
Shop
New well
180'
LOT LAYOUT
N