LINCOLN COUNTY HEALTH DEPARTMENT Permit # 23-607
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/26/2023 Expiration Date: 07/25/2024

Property Owner: Patrick and Marieta Smith

Mailing Address: [redacted]

Telephone: E-mail:

Installer: Noel Duram License #: 186

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new septic system with reduction given for chambers.

Parcel Description:

Legal: S10, T35 N, R26 W, C.O.S. 2104, PARCEL A, ACRES 10.075, OR TR-3B2 IN NENE *607*

Property Address: Assessment Code: 0607

DEQ COSA: ES# 27-93-S64-1355 Date: 07/11/23

Approved Design Criteria: Installation of new septic system with chambers.

# of Bedrooms: 4 Septic Tank Size: 1500 gallon Trench Width: 24"

# of Laterals: 4 Length of Laterals: 76' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, SIT

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: John Blumberg *Date:* 8/14/23

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD


DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

PATRICK O. SMITH
+
MARIETTA N. SMITH

PARCEL "A" - COS No. 2104
10.075 ACRES
E½ E½ NE¼ NE¼
LINCOLN COUNTY
* REVISED LOT LAYOUT

DRAWING BY
NOEL R. DURHAM

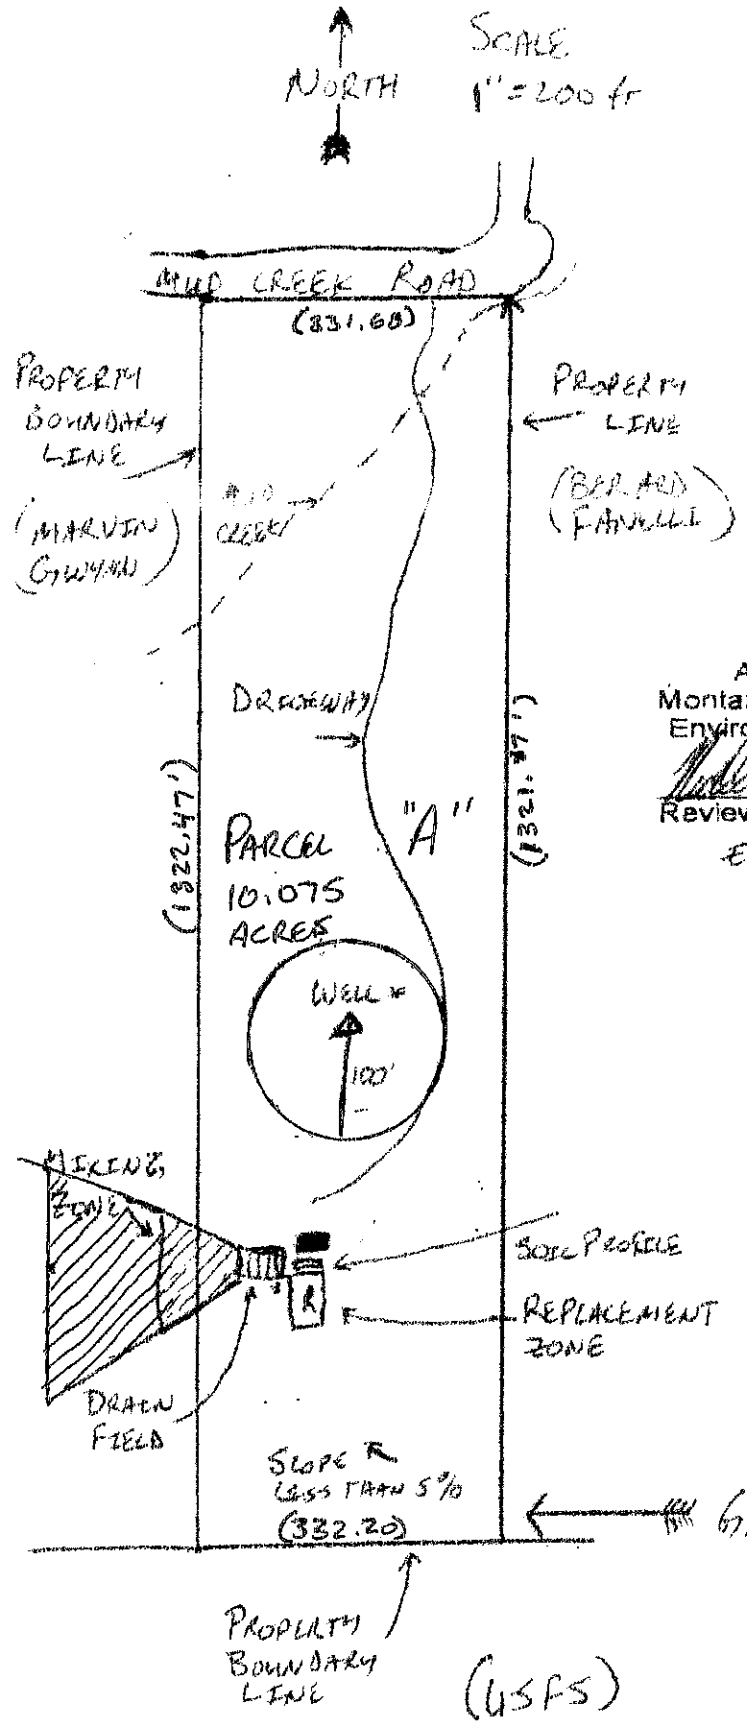

ES # 27-93-564-1355

APPROVED
Montana Department of
Environmental Quality

Reviewer 12/7/2023
Date

ES# 27-93-564-1355

LEGEND

- Δ - PROPOSED WELL LOCATION
- O - PERC TEST LOCATION
- ■ - PROPOSED 1500 GALLON SEPTIC TANK
- ▥ - DRAIN FIELD & PROPOSED
- ▱ - MIXING ZONE FOR DRAIN FIELD
- [R] - REPLACEMENT AREA
- ▭ - SOIL PROFILE LOCATION