LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/30/2023 Expiration Date: 05/29/2024

Property Owner: William Stebe

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Unknown License #:

Approved Work: (Check One) ☐ New Installation ☒ Existing System

☐ Replace Drainfield ☐ Replace Tank ☒ Extension Additional tank

Describe: Addition of 1000 gallon tank.

Parcel Description:

Legal: S02, T37 N, R27 W, C.O.S. 2011, PARCEL A, ACRES 20

Property Address: 658 Revere Rd. Eureka, MT 59917 Assessment Code: 16835

DEQ COSA: EQ# Date:

Approved Design Criteria: Addition of 1000 gallon tank in combination with existing 1000 Gallon tank.

# of Bedrooms: 3 Septic Tank Size: 2 1000 gallon tanks Trench Width: 24"

# of Laterals: 3 Length of Laterals: 65' Trench Depth: 36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Issued By: *Robin Blumberg, S97*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

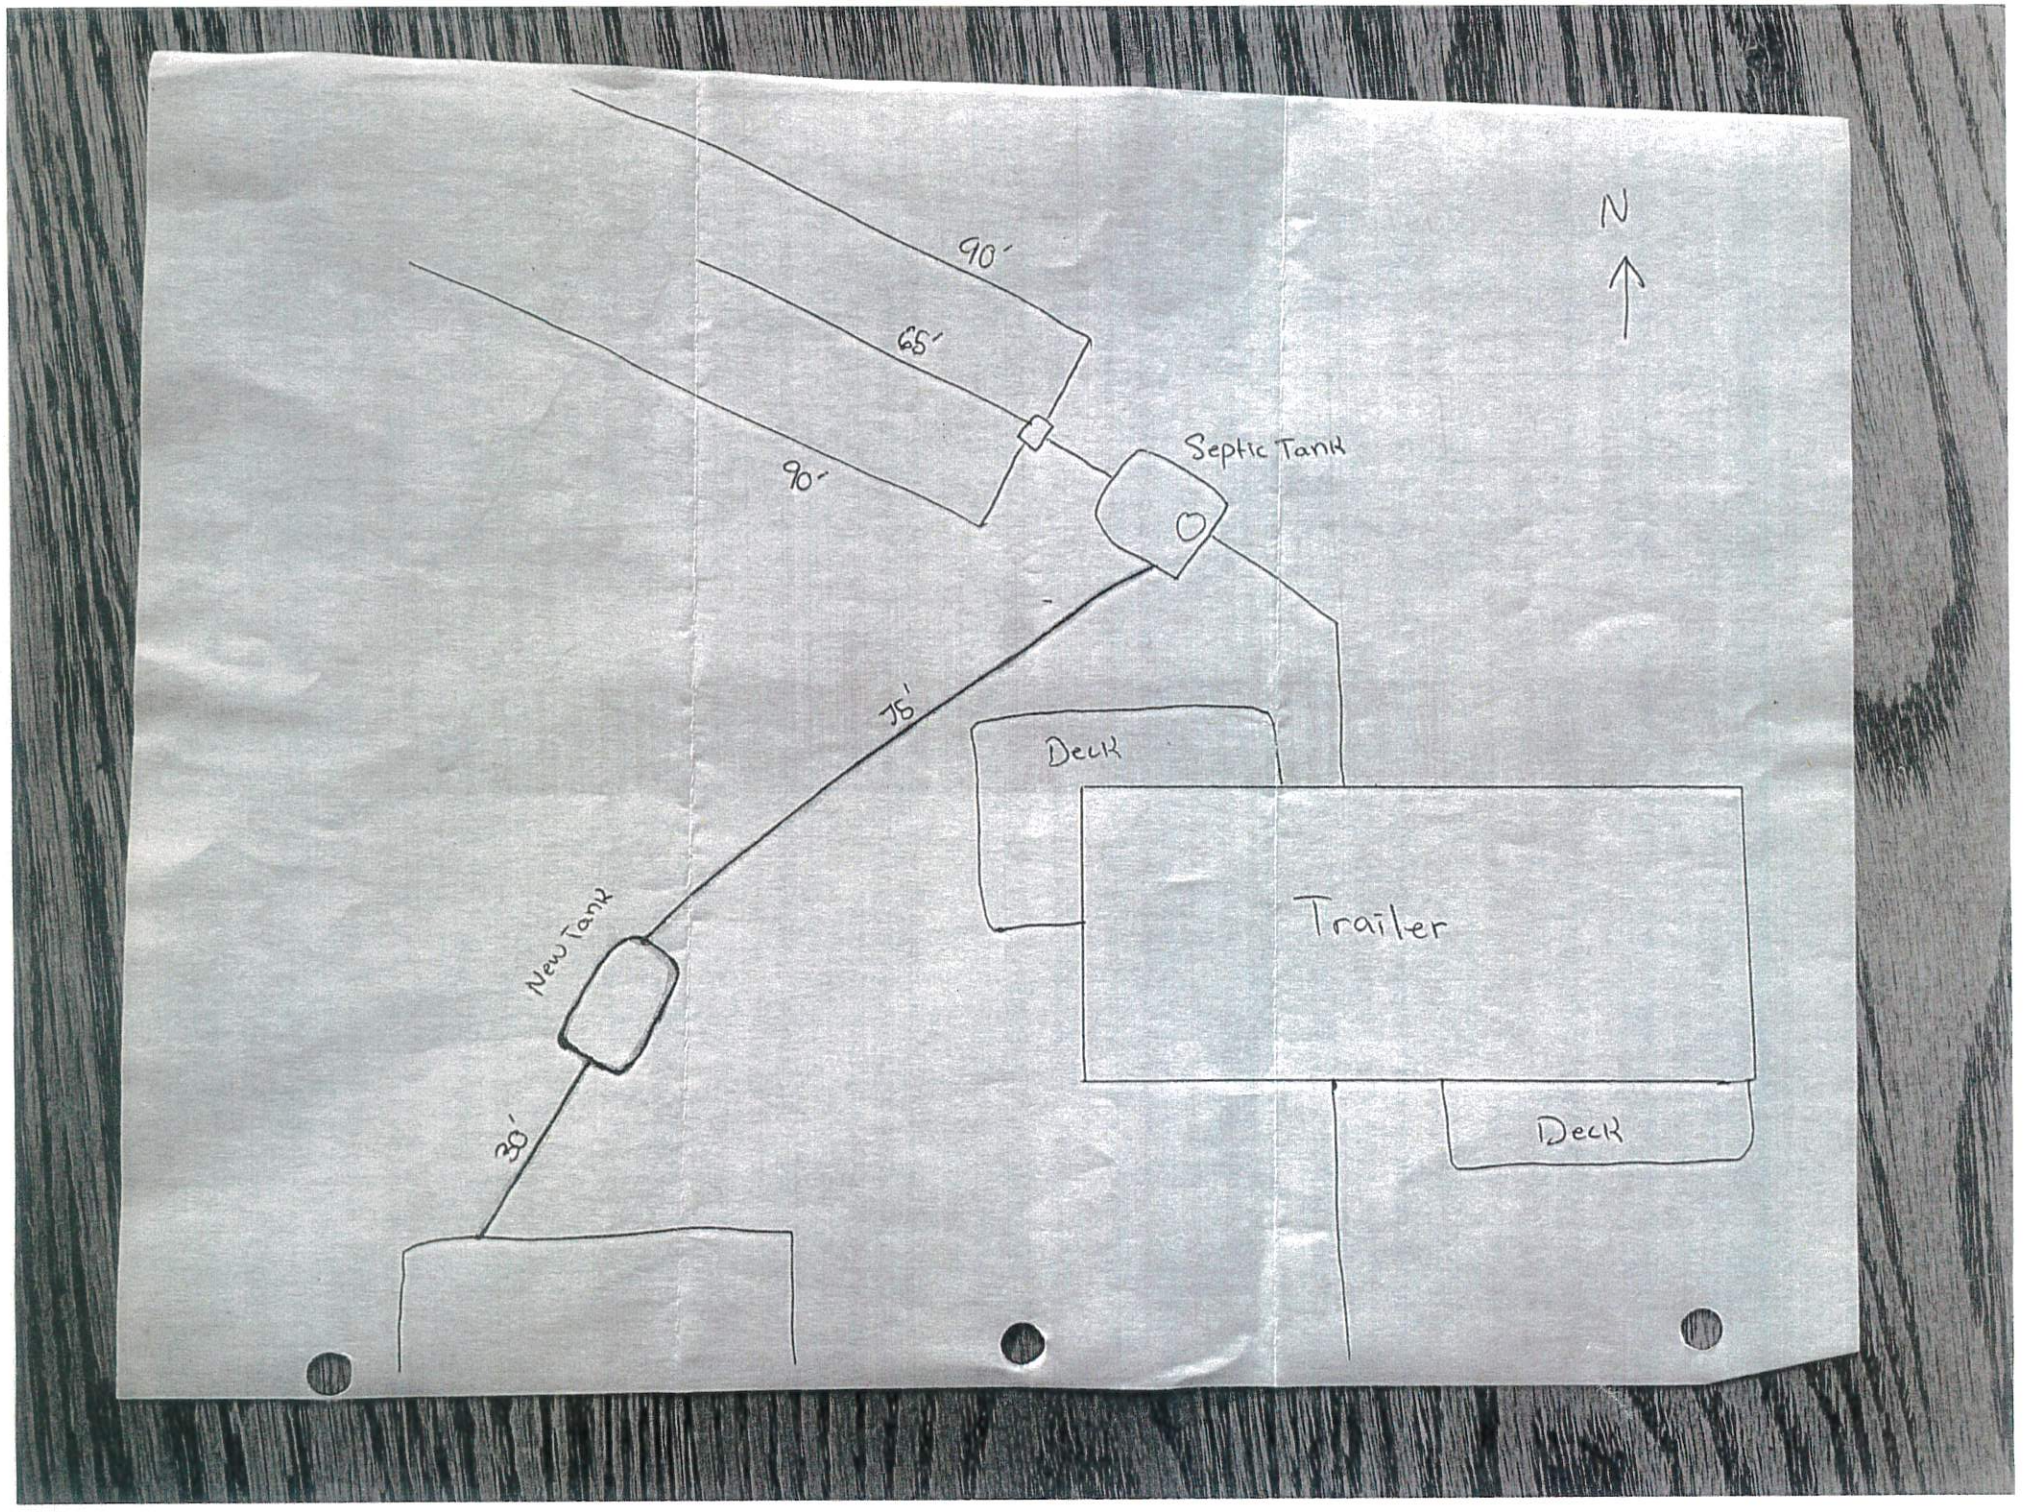
Signed: Elmer Brenner *Date:* 10-2-2023

____ Lincoln County Health Department (LCHD) _V_ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV


90'
65'
90'
Septic Tank
N
75'
Deck
Trailer
New Tank
30'
Deck