LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Permit # 23-8242

Issue Date: 06/19/2023 Expiration Date: 06/18/2024

Property Owner: August Steiner

Mailing Address: [redacted]

Telephone: E-mail:

Installer: Jessica Svendsbye License #: 192

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of gravity system with chambers and 2 laterals @ 50'.

Parcel Description:

Legal: COLLINSON TRACTS, S35, T31 N, R31 W, ACRES .85, PRCLS B&D CS 817 OR TR 1ALB &2A3A IN NENE 8242

Property Address: 158 Warren Rd. Libby, MT 59923 Assessment Code: 8242

DEQ COSA: Date:

Approved Design Criteria: Installation of gravity system with chambers and 2 laterals @50'.

# of Bedrooms: 1 Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 2 Length of Laterals: 50' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, SIT*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

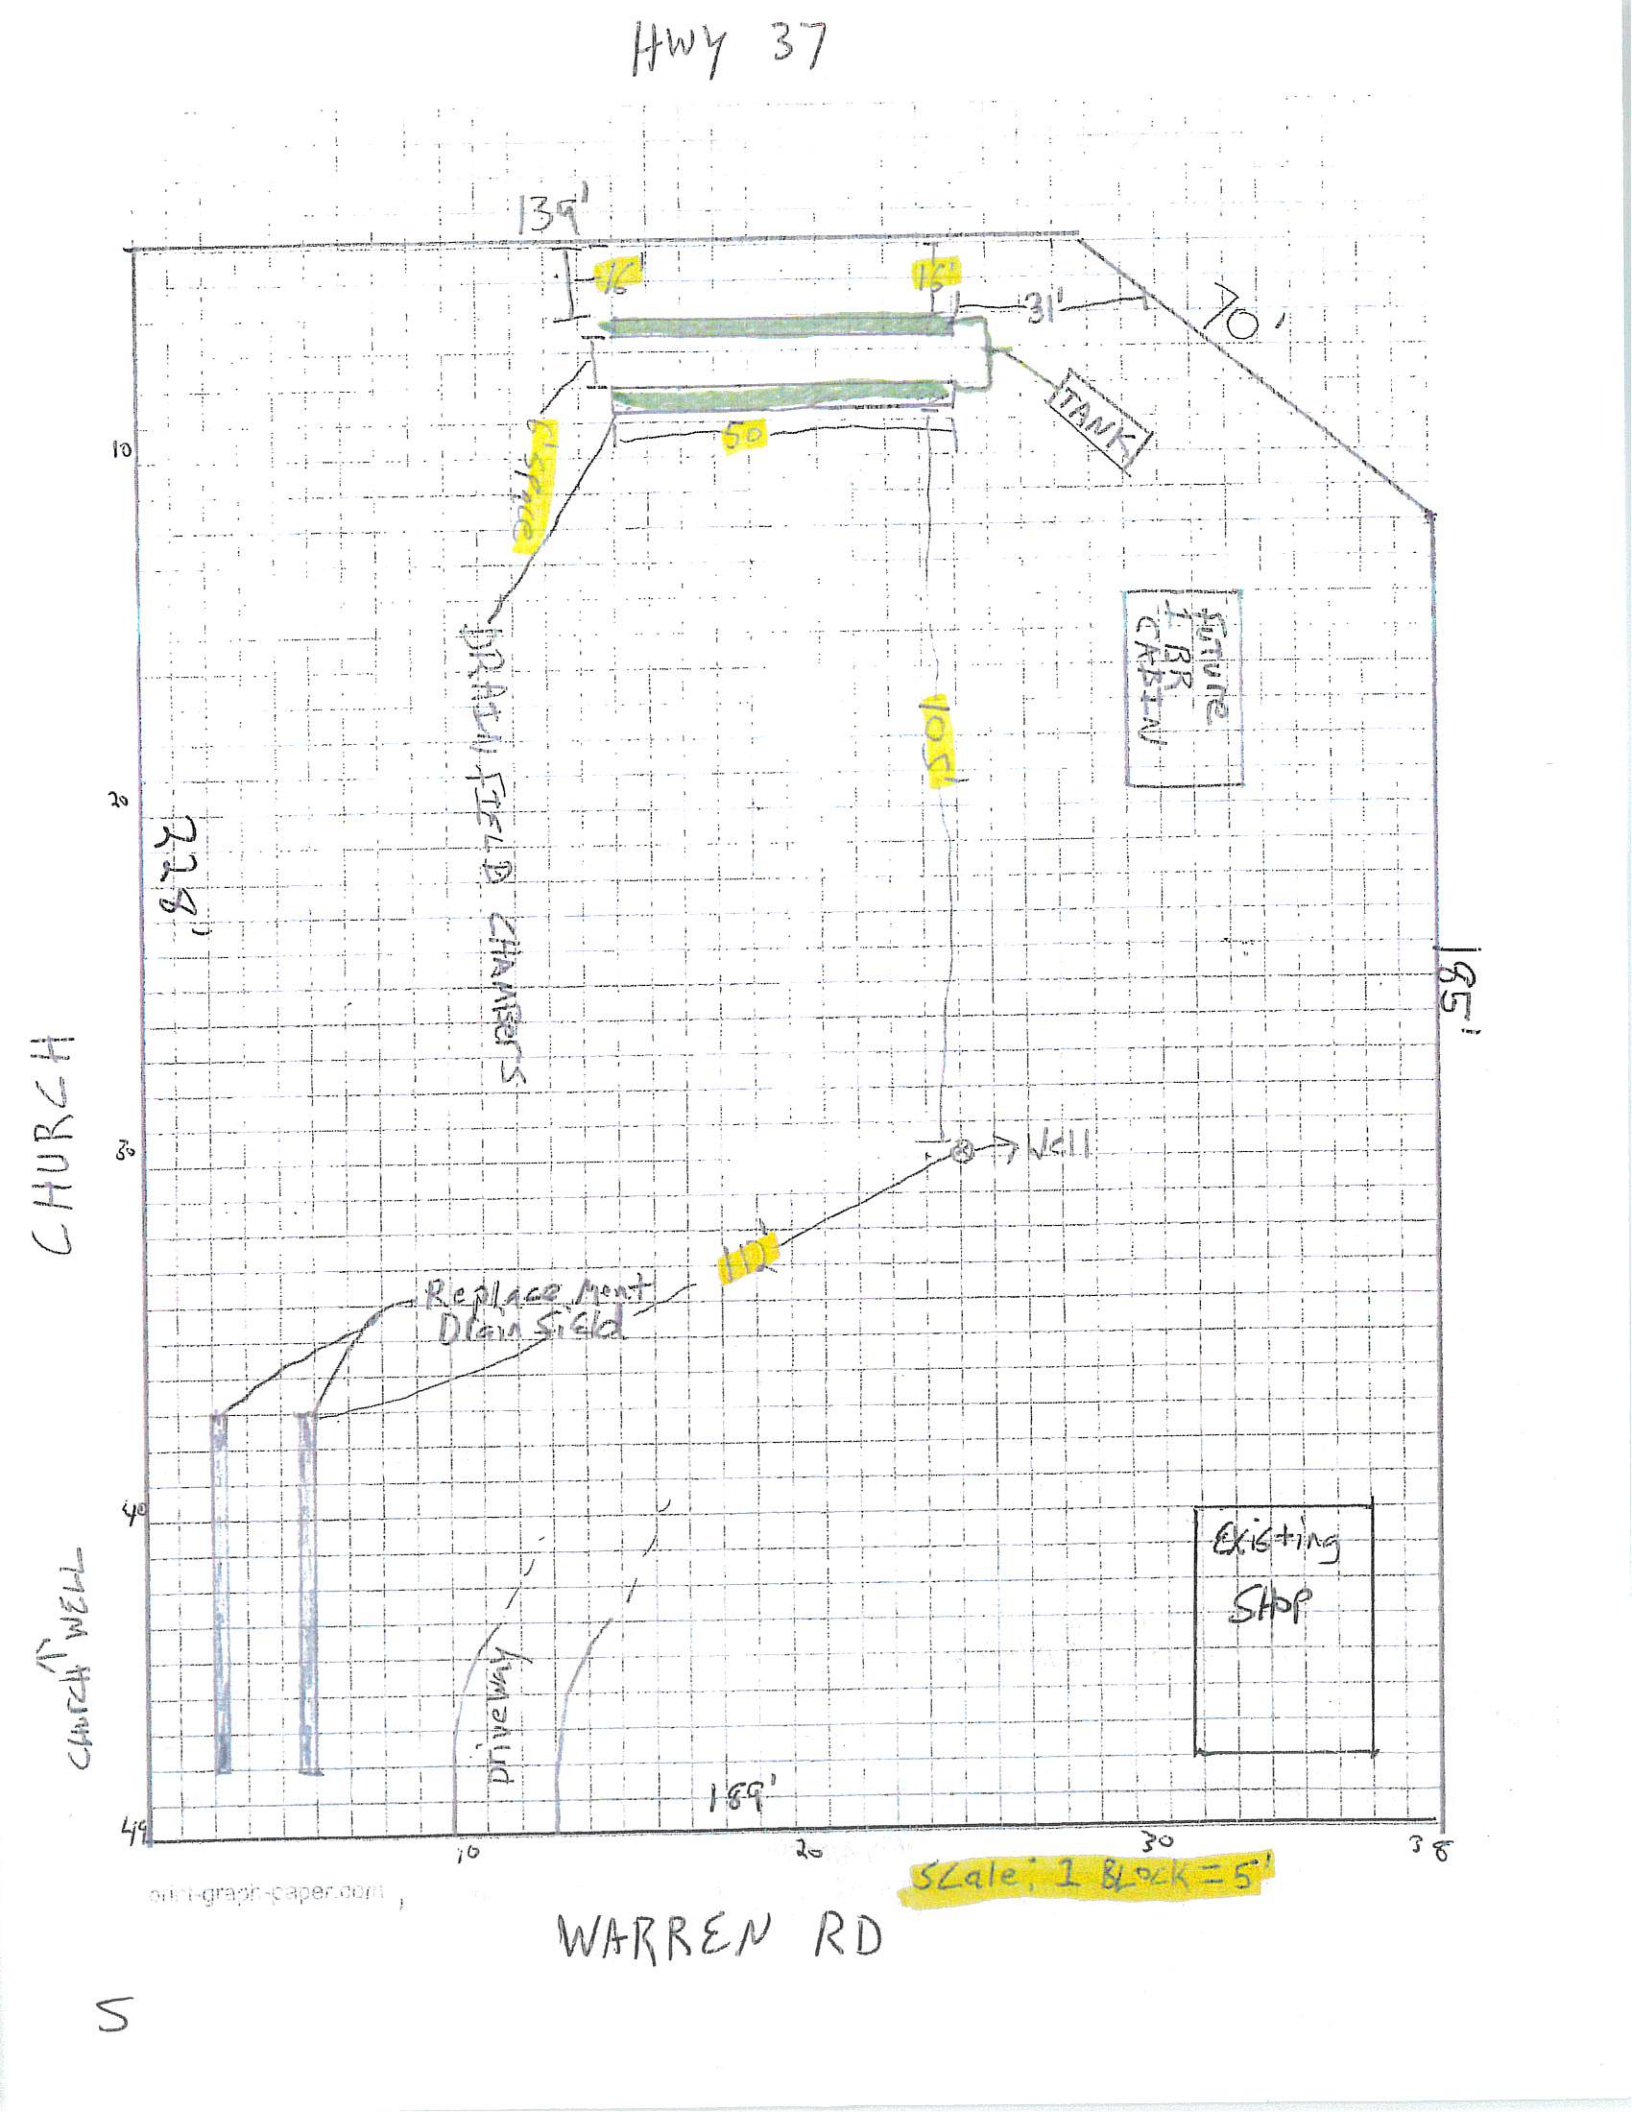
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

_____ Lincoln County Health Department (LCHD) _____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Hwy 37
139'
16'
16'
31'
70'
TANK
50
3 PHASE
UNDERGROUND ELEC
CHAMBERS
150'
Future 1 BR CABIN
185'
232'
Well
HDPE
Replace Ment Drain Field
Existing SHOP
Driveway
189'
CHURCH
Church Well
10
20
30
40
SCALE: 1 BLOCK = 5'
WARREN RD
S