LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/25/2022 Expiration Date: 04/25/2023

Property Owner: Thomson, Eric c/o: MDS

Address: [redacted]

Telephone: [redacted] [redacted]

Installer: Dallas Fluid (inspection by MDS) License No. 135

___ Direct Connection ___ Grinder Pump Connection XX Effluent Lift Tank Connection

Describe: Sewer line connection to sewer main for approved Drainfield

Parcel Description:

Legal: INDIAN SPRINGS PH 1, S36, T37 N, R27 W, ACRES 0.655, LOT 25 AMD CS 4218

Address or Location: 160 Quirk Trl, Eureka, MT 59917

Geo/Assessors code: 0000055125

Approved Design Criteria:

Per the application and Indian Springs Ranch Design Review Committee (DRC) approval, this lot is approved for a 3-bedroom house. This structural size may not be exceeded and wastewater flows are prohibited from exceeding 300 gallons per day. Any proposed increase in wastewater flows must be reviewed by and receive the approval of the DRC and the Montana DEQ Subdivision Section. Any activity that increases wastewater flows without prior review and approval is in violation of the conditions of approval and subject to enforcement action.

Special Instructions: INSTALL 1,000 GALLON SEPTC TANK, 500 GALLON PUMP TANK/CHAMBER, AND SEWERLINE CONNECTION TO THE SEWER MAIN LINE FOR DRAINFIELD ACCORDING TO THE ATTACHED LOT LAYOUT AND DEQ APPROVAL STATEMENT EQ#06-3321. ANY DEVIATIONS FROM APPROVED PLAN MUST HAVE PRIOR AUTHORIZATION FROM THE INDIAN SPRINGS RANCH DRC, DEQ AND THE DEPARTMENT.

Issued By: *Nicholas Raines*

Closure Statement:

I, Buck Schermerhorn, have inspected this system and found it to be in compliance with the conditions of the permit, and the DEQ Approval Statement requirements.

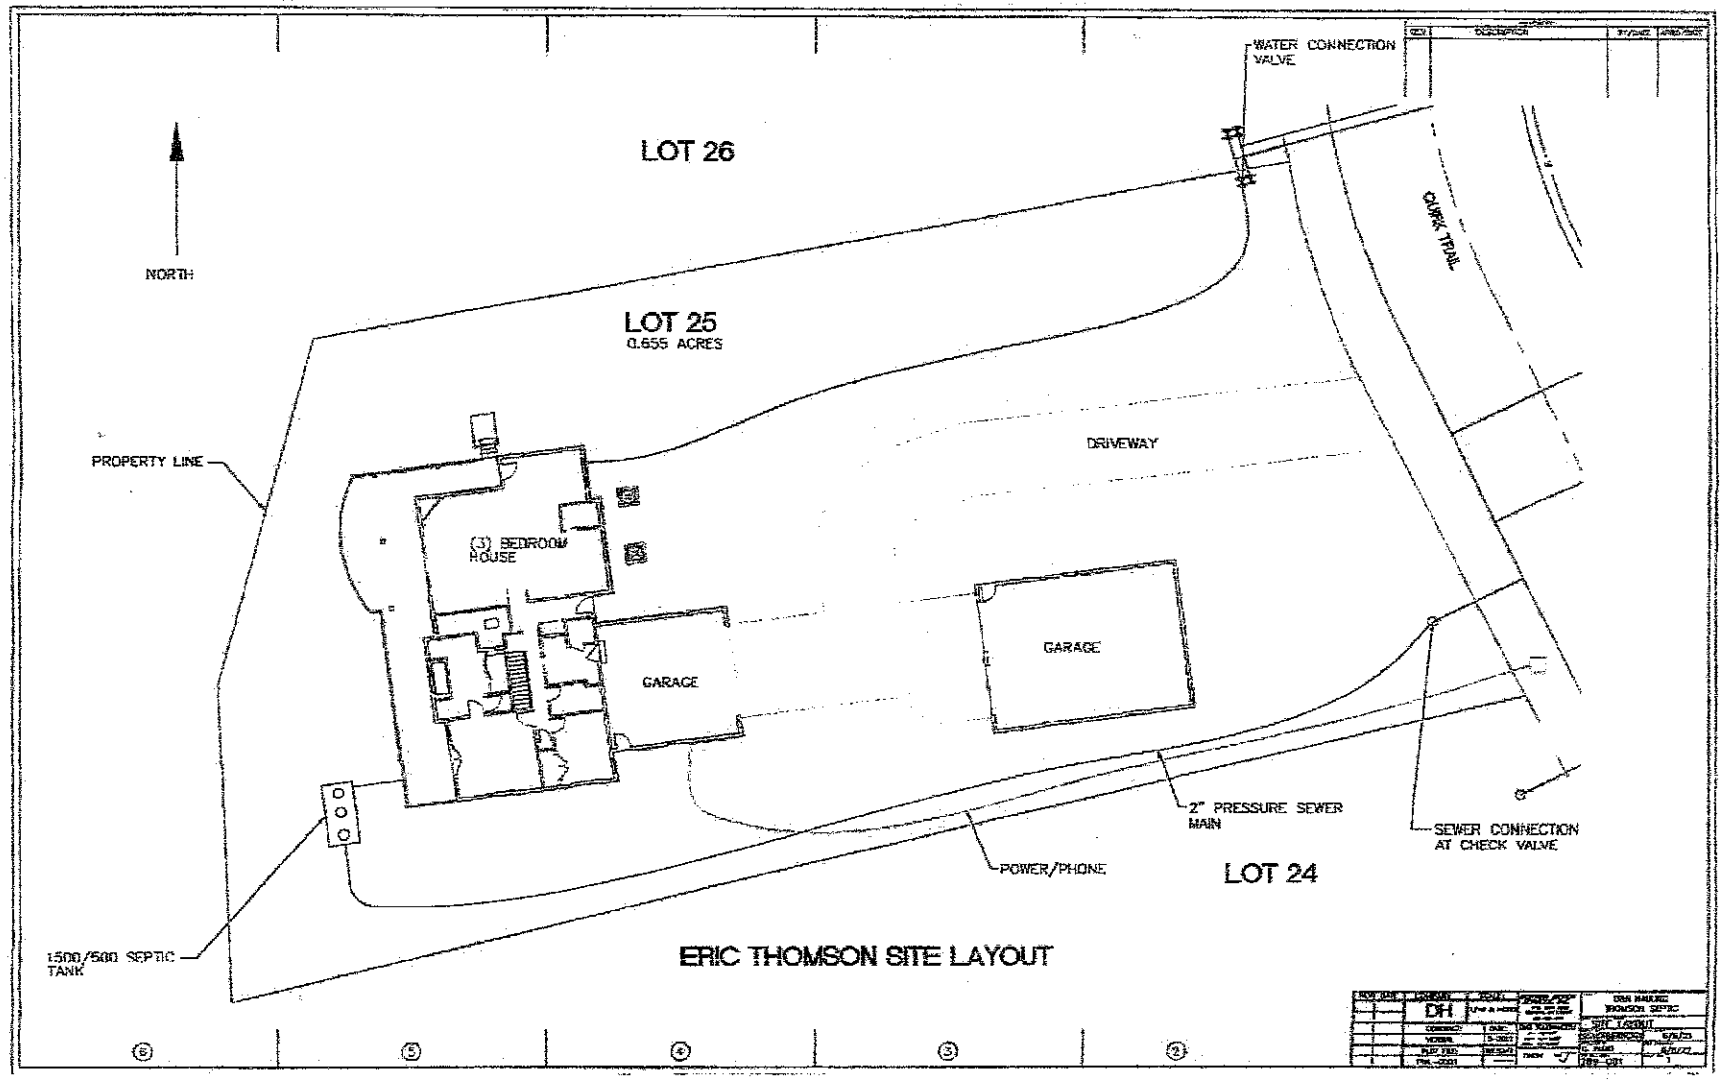
Signed: [signature] *Date:* 8/16/22

Title: PRESIDENT

NOTICE: The Department must be notified at least 48 hours prior to installation of the connection. Any connection installation not inspected by the Department or its designated representative is considered an illegal connection and may be subject to fines and/or requirements to remove or reconstruct the connection.

DISCLAIMER

This permit is not a guarantee by the Department that this connection will function properly for a prescribed period of time.


WATER CONNECTION VALVE
LOT 26
NORTH
LOT 25
0.655 ACRES
CHURK TRAIL
PROPERTY LINE
DRIVEWAY
(3) BEDROOM HOUSE
GARAGE
GARAGE
2" PRESSURE SEWER MAIN
SEWER CONNECTION AT CHECK VALVE
POWER/PHONE
LOT 24
1500/500 SEPTIC TANK
ERIC THOMSON SITE LAYOUT