NEW...

SEPTIC TANK PERMIT
for
LINCOLN COUNTY

Permit Sent _____

Date Oct. 20, 1977

Phone [redacted]

Property Owner GENE VAUGHN Address [redacted]

Lot, Block Number, or legal description of Property PONDEROSA HGTS. LOT 32


To be built by: — Square feet absorption area. 300 sq. ft.

Septic Tank Size 1000 gal # of bedrooms 3 Water Supply WELL


Description of Absorption Area: Dig a ditch 150' in length x 2½-3' deep x 2' wide according to lot layout and ditch diagram. Grade of pipe should not exceed 1% drop.

Sketch; Must include property lines, buildings, and proposed septic tank-drainfield layout. Sketch must show distance from absorption area to wells, springs, streams, or lakes. Indicate depth of water table. Indicate slope.

Lot Layout

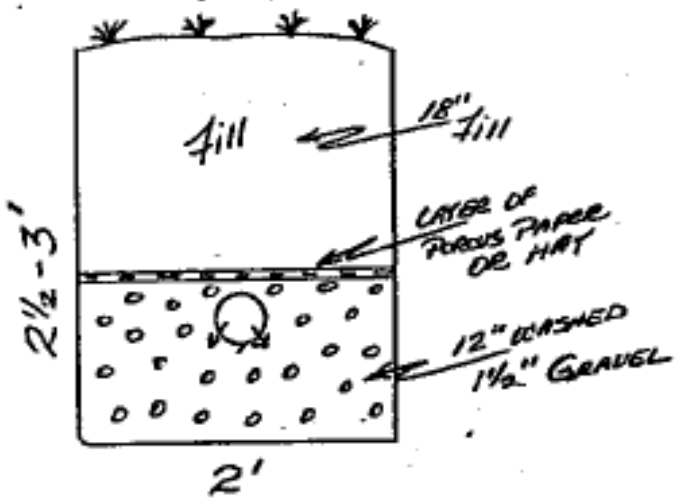

DITCH DIAGRAM

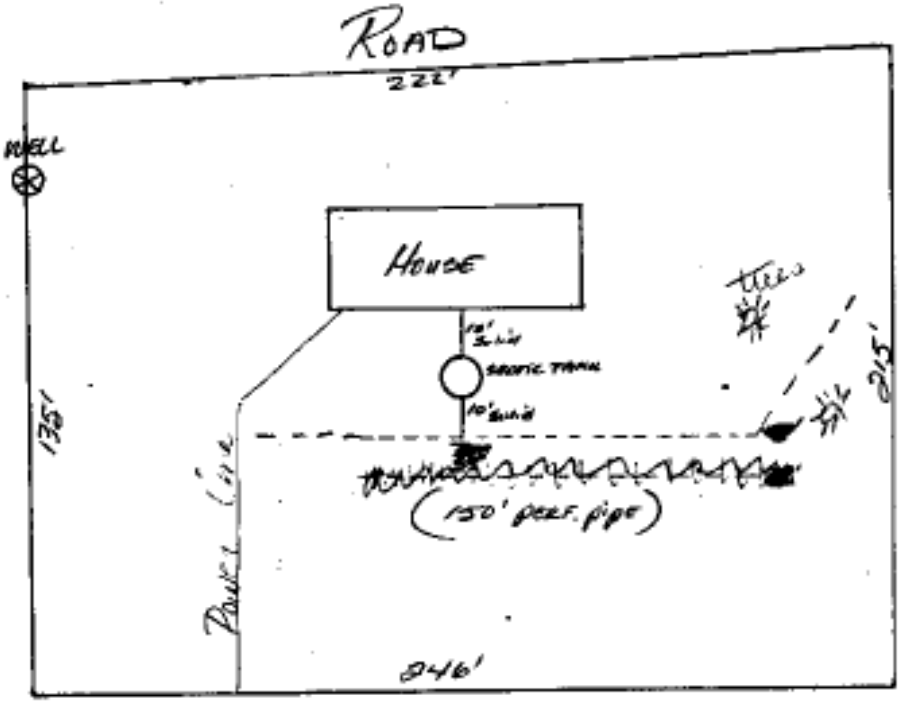

Soil: Sandy loam w/ mixed cobbles

SLOPE: 2-4%.

Issued by Ronald L. Anderson Inspected by _____

Date Oct. 20, 1977