LINCOLN COUNTY HEALTH DEPARTMENT Permit #24-9505
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/25/2023 Expiration Date: 08/24/2024

Property Owner: Mitchell Vogel

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Patriot Property Services License #: 196

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system with 2 laterals @ 84'.

Parcel Description:

Legal: S04, T30 N, R31 W, COS 4639, PARCEL A, ACRES 3.523

Property Address: 373 Education Way., Libby, MT 59923 Assessment Code: 9505

DEQ COSA: EQ#27-80-S24-K237 Date: 06/16/80

Approved Design Criteria: Installation of new gravity system with 2 laterals @84' and reduction for chambers.

# of Bedrooms: 4 Septic Tank Size: 1500gallon Trench Width: 24"

# of Laterals: 2 Length of Laterals: 84' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, S17

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

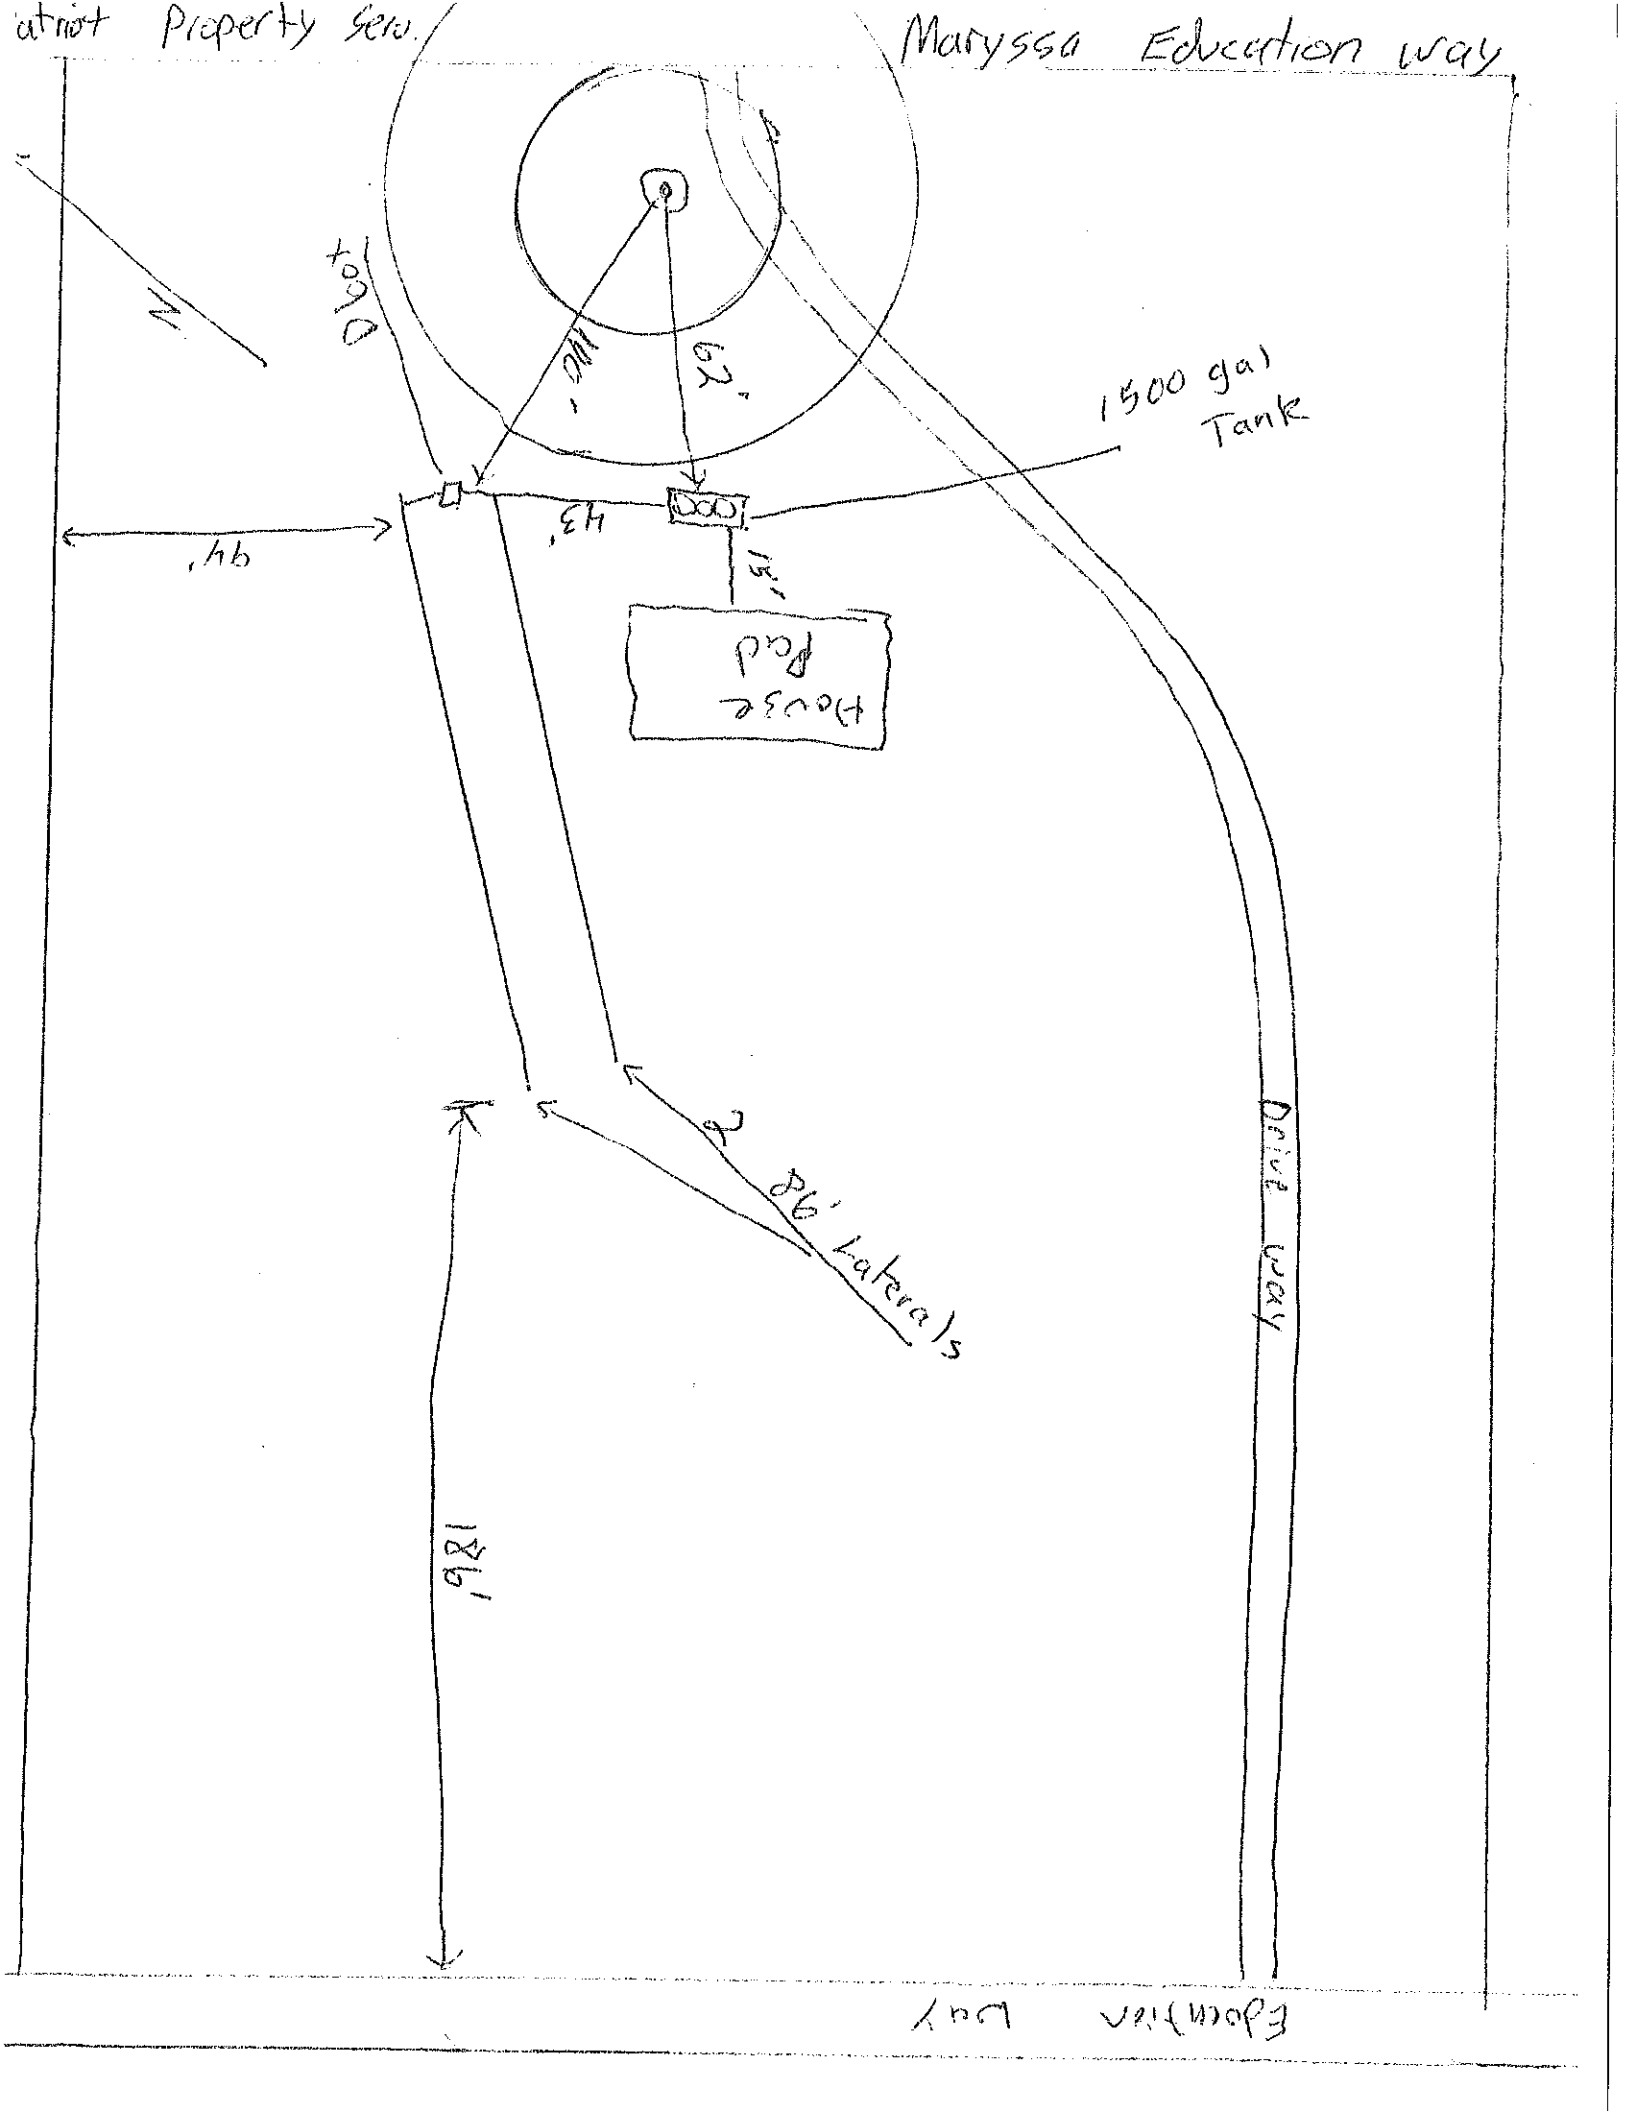
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 7/16/24

__✓__ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


atriot Property Sera.
Marysso Education way
N
200'
1,500 gal
Tank
House
Pad
96' Lateral's
Drive way
Education Way