LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 09/13/2023 Expiration Date: 09/12/2024

Property Owner: Darrlynn Ward and Dinah Underwood

Mailing Address: P.O. Box 963 Troy, MT 59935

Telephone: E-mail:

Installer: May Excavation LLC License #: 194

Approved Work: (Check One) ☐ New Installation ☒ Existing System

☒ Replace Drainfield ☒ Replace Tank ☐ Extension

Describe: Installation of a pressure dosed replacement tank and drainfield.

Parcel Description:

Legal: S33, T31 N, R33 W, COS 3453, PARCEL A(REMAINDER), ACRES 1.67

Property Address: 458 Milnor Lake Rd. Troy, MT 59935 Assessment Code: 12593

DEQ COSA: EQ# 27-90-58-111 Date: 08/1989

Approved Design Criteria: Installation of a pressure dosed replacement tank and drainfield with 3 laterals @ 65', trenches 36" wide and a minimum of 4' of natural undisturbed soil between trenches.

# of Bedrooms: 1 Septic Tank Size: 1000/500 Trench Width: 36"

# of Laterals: 3 Length of Laterals: 65' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, SIT

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 10/10/23

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LINCOLN COUNTY MONTANA


LOT LAYOUT:

SEPTIC TANK PERMIT

Parcel A of C.O.S. 3453

9-7-2023

NOTE: EXISTING DEQ NO. 27-90-S8-111
DATED AUGUST 1989
LINCOLN COUNTY PF4707

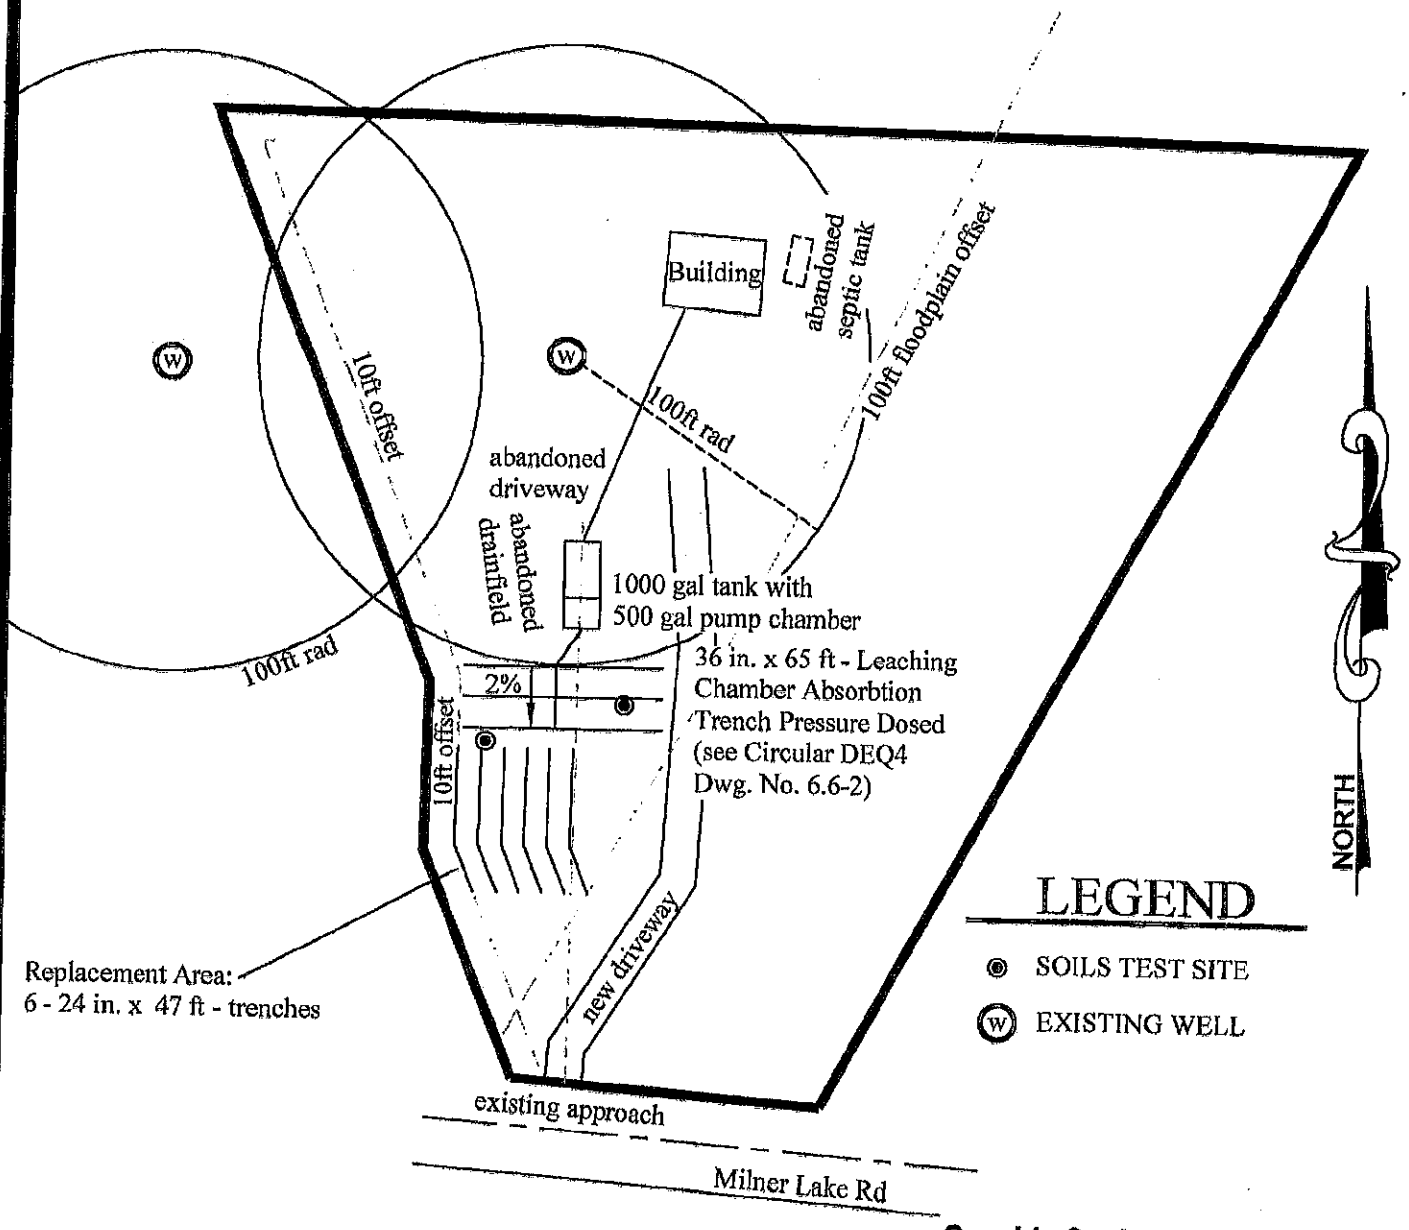

LEGEND

- SOILS TEST SITE
- EXISTING WELL

Graphic Scale:

60 0 30 60

(1 inch = 60 ft.)

DAVIS SURVEYING INC.
TROY, MONTANA

DATE: 9/7/23	REV:
DRAWN BY: SM	
Land Projects 2023	
FILE:	