LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
AFFIDAVIT OF WASTEWATER TREATMENT AND DISPOSAL SYSTEM COMPLIANCE REVIEW FOR SYSTEM INSTALLED, REPAIRED OR REPLACED WITHOUT A VALID PERMIT

Issue Date: 8/16/2022

Property Owner: Rhonda Bache

Mailing Address: [redacted]

Telephone: [redacted] E-Mail: [redacted]

Who Installed System Being Reviewed: Russ Bache & Tim Muniz Date Installed: 2015

Type of System Work Reviewed:

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Use of System: Two bedroom house

Property Description:

Legal: S19 T29N R30W, COS 3446, Parcel A, 35.73 acres

Address or Location: 303 Hammer Cutoff Rd, Libby, MT

Reviewed System Components:

Maximum Discharge: 225 gpd Septic Tank: 1000 gallons Drainfield Construction: perf pipe

# of Laterals: 3 Length of Laterals: 80' Trench Width: 24 inches

Comments: Gravity system using 1000 gallon tank and 2' wide trenches, 80' long and 7' apart, with perf pipe and drain rock. System components (including tank, d-box, and drainfield) were verified by Jerry Bennett and reported to be in working order. System is appropriately sized for wastewater flows of 350 gallons per day. Any future extension, repair, replacement or increase in wastewater flows must be reviewed and permitted by Lincoln County Health Department.

System Review Documentation Statement:


I, Kathi Hooper, have reviewed the components of this system as listed above and found it to be in compliance with the requirements of A.R.M. Chapter 17.36 Subchapter 9, Circular DEQ-4 and Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: [signature] *Date:* 8-16-22

Title: Director

NOTICE: This document is not a permit for installation, repair or alterations of a wastewater treatment and disposal system. It is a statement that the Department has conducted a review of this system and found it to be in compliance with applicable requirements, making it a legal system for the use described above. The Department does not guarantee that this system will continue to function properly for any period of time.

5

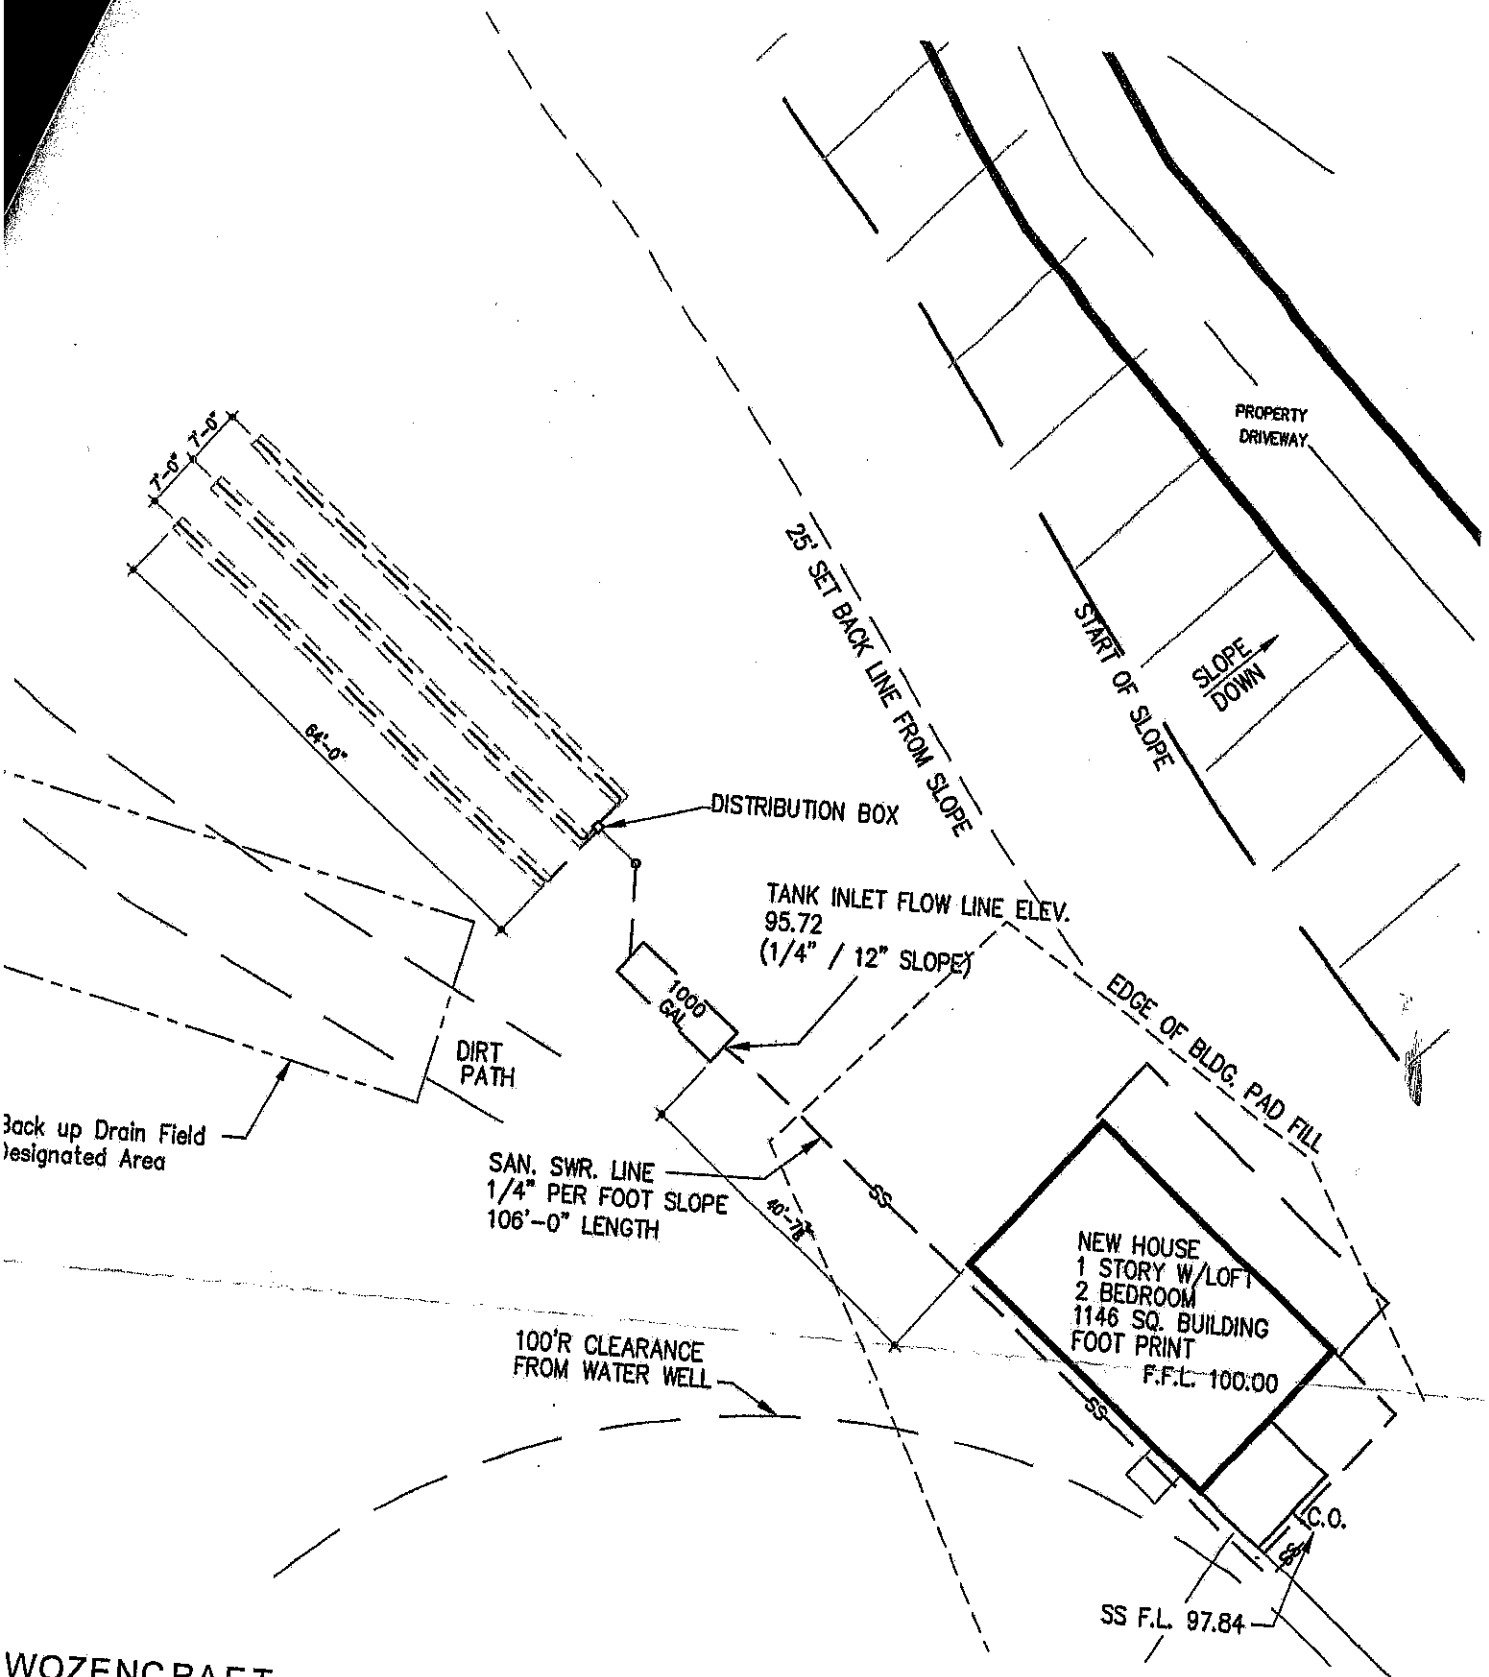

WOZENCRAFT
RESIDENCE

1689 MEADOW CREEK RD., FORTINE, MT 59918
MAIL: P.O. BOX 452, FORTINE, MT 59918
G:\montana\drawings\SITE.dwg
Sep 09, 2022 - 9:22am

SITE PLAN

DATE: 9-9-2022 **SHT No.:** SITE - 3

NO SCALE