LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/20/2025 Expiration Date: 05/19/2026 Permit# 25-6570

Property Owner: David and Jaime Bernhart

Mailing Address: [redacted]

Installer: Logan Munts License #: 160

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system for 3 Bedroom House.

Legal: FAIRVIEW HEIGHTS 2ND ADDN, S13, T31 N, R34 W, LOT 37, ACRES 1.33

Property Address: 278 Kootenai Dr., Troy, MT 59935 Assessment Code: 6570

DEQ COSA: E.Q.#27-79-K2295 Date: 06/28/1979

Approved Design Criteria: Installation of new gravity system for 3 Bedroom House with 3 Laterals @ 60'.

# of Bedrooms: 3 Septic Tank Size: 1000 Trench Width: 24"

# of Laterals: 3 Length of Laterals: 60' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

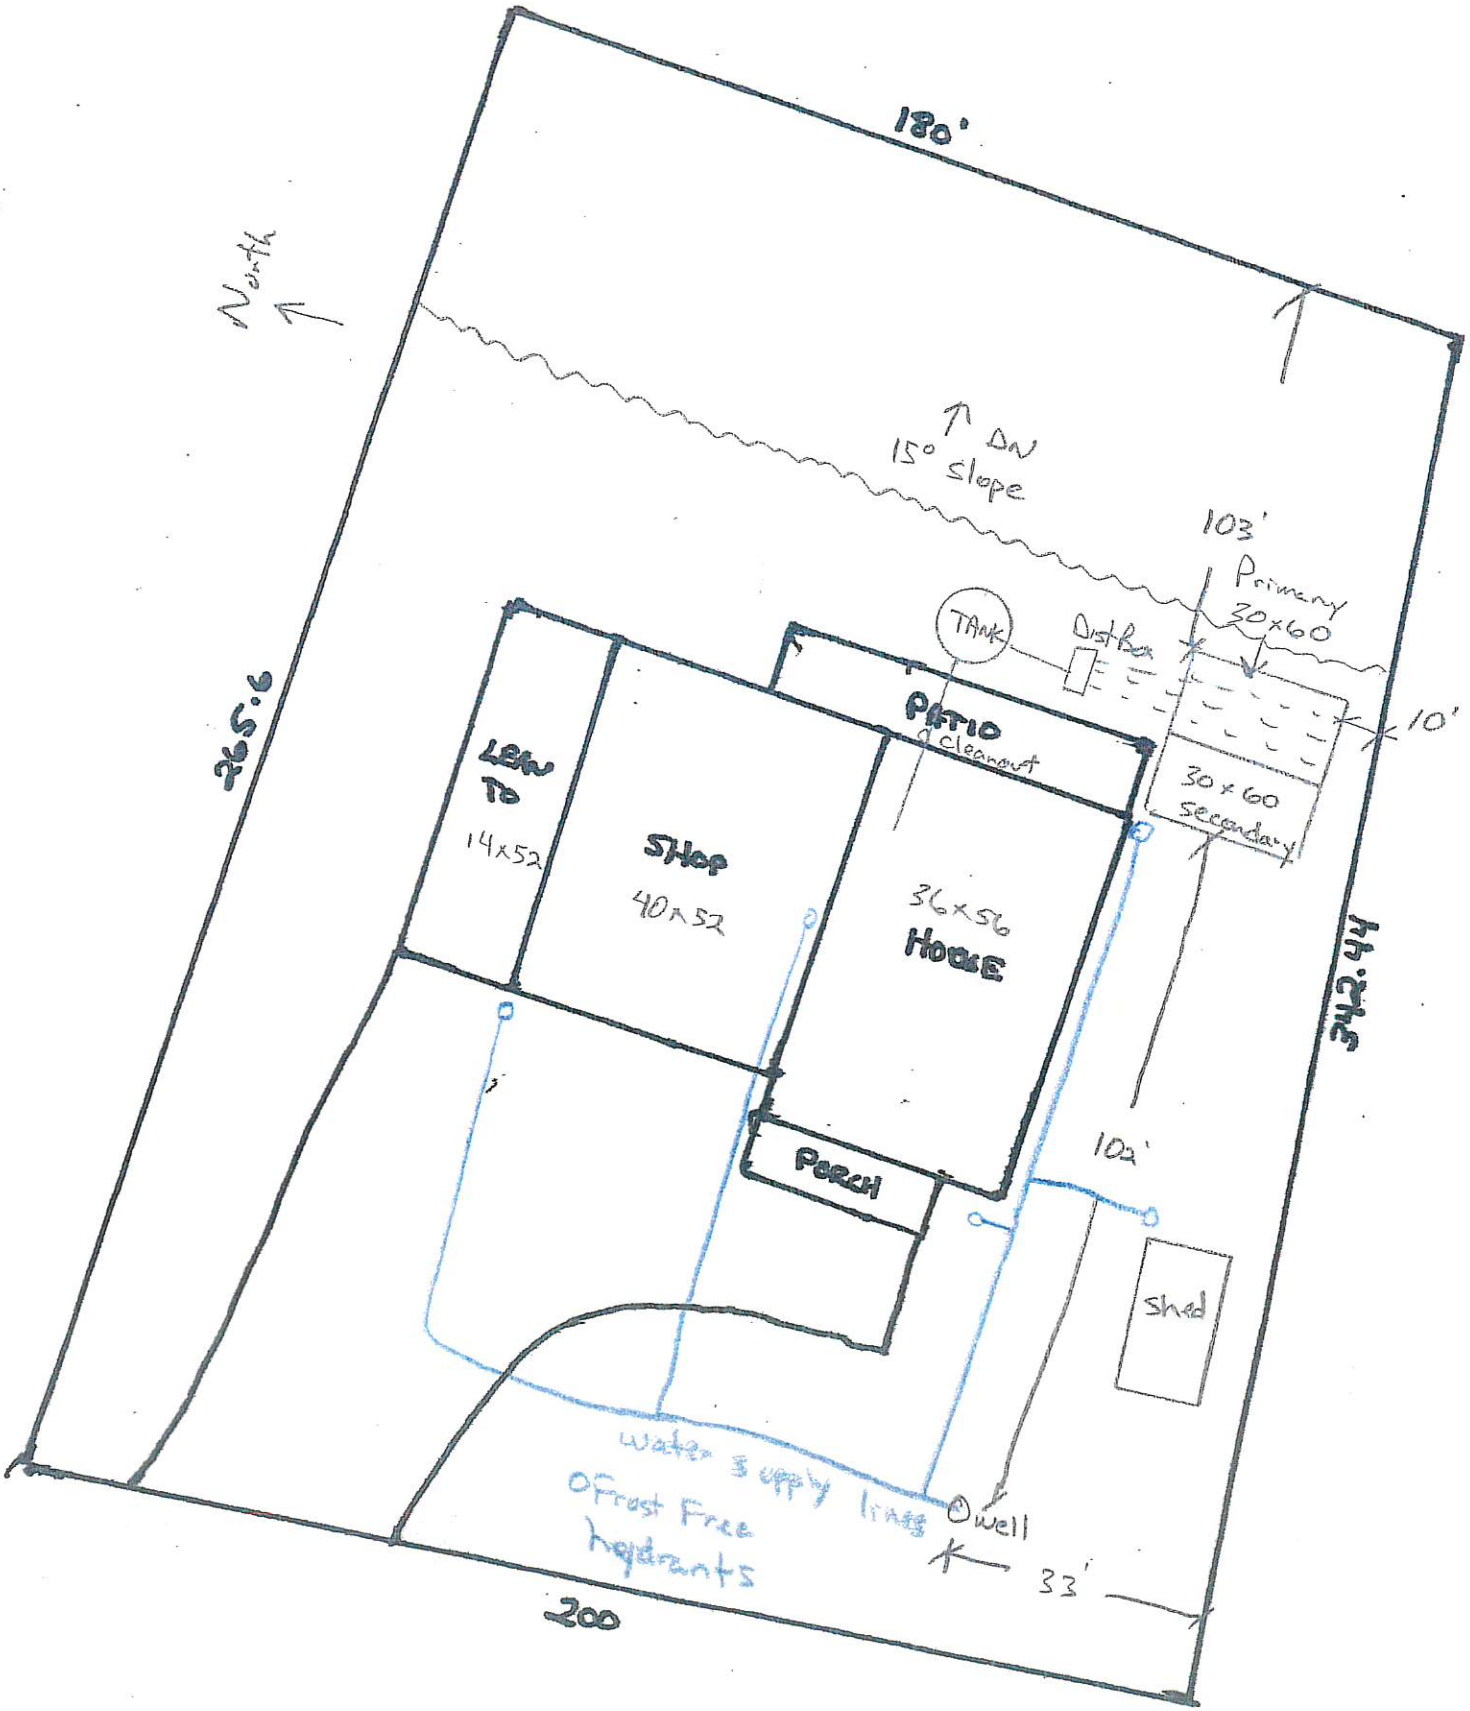
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 5/28/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


180'
North
DN
15° Slope
103'
Primary
30x60
TANK
Distbox
10'
PATIO
& Cleanout
30 x 60
secondary
LEAN TO
14x52
SHOP
40x52
36x56
HOUSE
265.6
342.44
PORCH
102'
Shed
Water supply lines
Frost Free
hydrants
Well
33'
200