LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 9/16/2022 Expiration Date: 9/15/2023

Property Owner: David Burgess

Mailing Address: [redacted]

Telephone: [redacted] E-mail:

Installer: Rupert Schreiner License #: 19

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Gravity system, standard 2' wide trenches, perf pipe and drain rock

Parcel Description:

Legal: S12 T33N R26W, 160 acres

Property Address: Sunday Mountain Rd, Trego Assessment Code: 1298

Approved Design Criteria:

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 1000 square feet

# of Laterals: 5 Length of Laterals: 100 lineal feet Trench Depth: 24 - 36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* 8/14/23

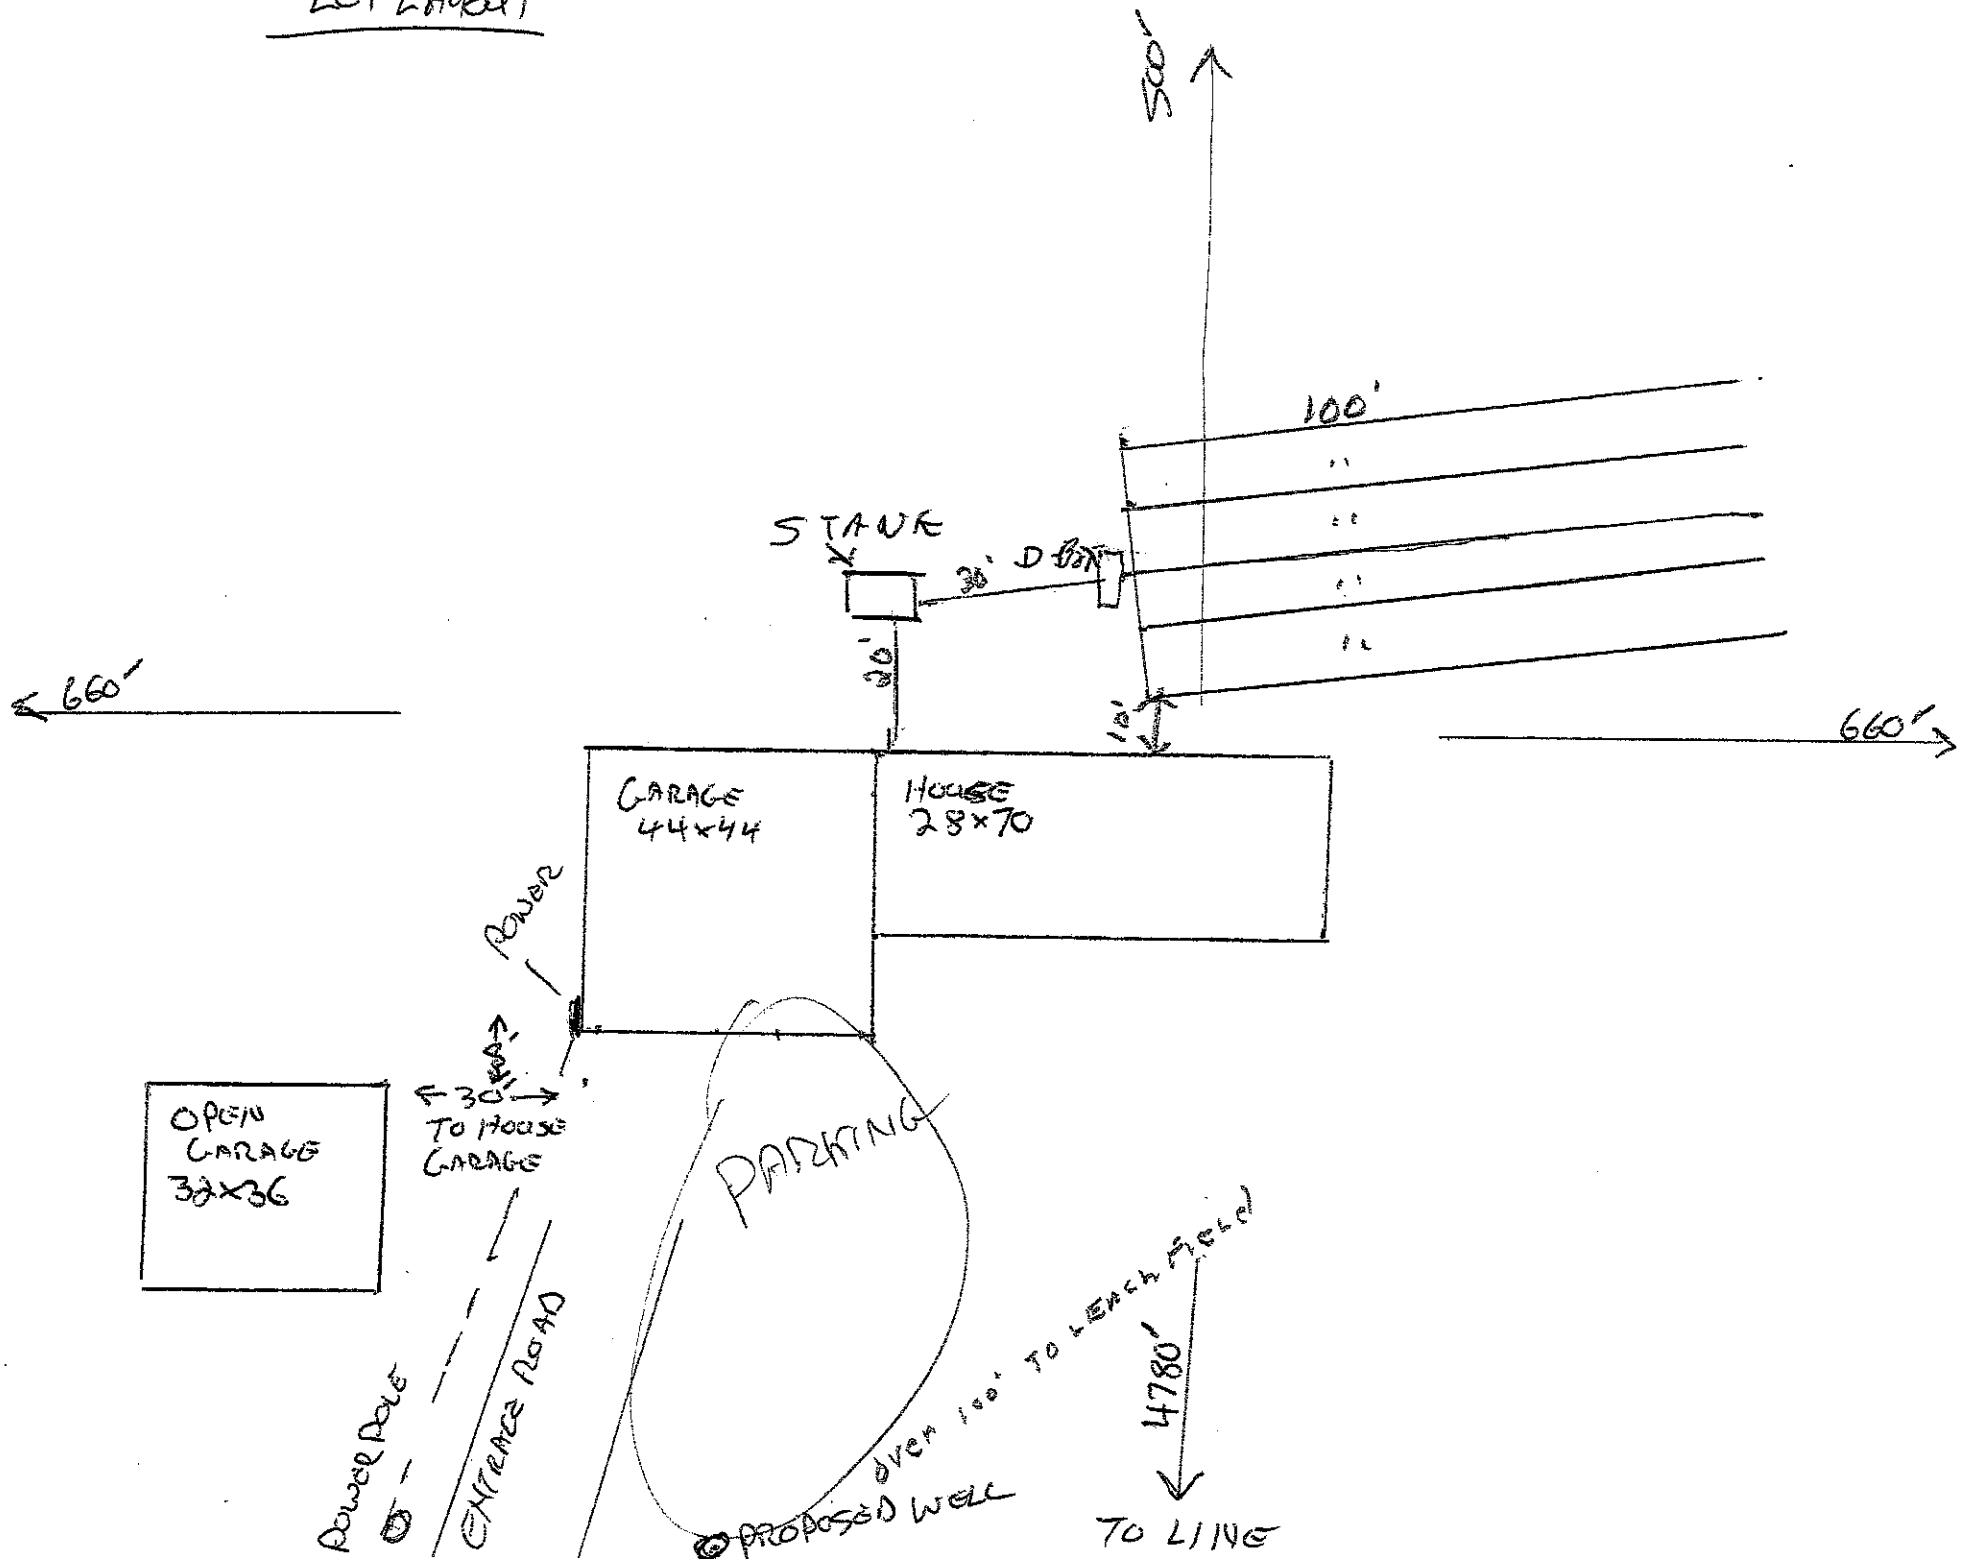
✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV

LOT LAYOUT


500'
100'
STAUK
30' D Box
20'
10'
660'
660'
GARAGE
44×44
HOUSE
28×70
POWER
30'
To House
GARAGE
OPEN
GARAGE
32×36
PARKING
POWER POLE
ENTRANCE ROAD
over 100' TO LEACH FIELD
4780'
PROPOSED WELL
TO LINE