Permit 24-14592

LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/30/2024 Expiration Date: 10/29/2025

Property Owner: Cedar Creek Holdings LLC

Mailing Address: [redacted]

Installer: Tyler Hartz License #: 212

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for 3 Bedroom House.

Parcel Description:

Legal: BARNABY HEIGHTS, S28, T35 N, R26 W, LOT 30, ACRES 1.01, PM 7081

Property Address: Lot 30 Barnaby Heights Starling Dr. Fortine, MT Assessment Code: 14592

DEQ COSA: E.Q.#23-2694 Date: 01/16/2024

Approved Design Criteria: Installation of new pressure dosed system for 3 Bedroom House with 4 Laterals @ 94'.

# of Bedrooms: 3 Septic Tank Size: 1000/500 gallons Trench Width: 36"

# of Laterals: 4 Length of Laterals: 94' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

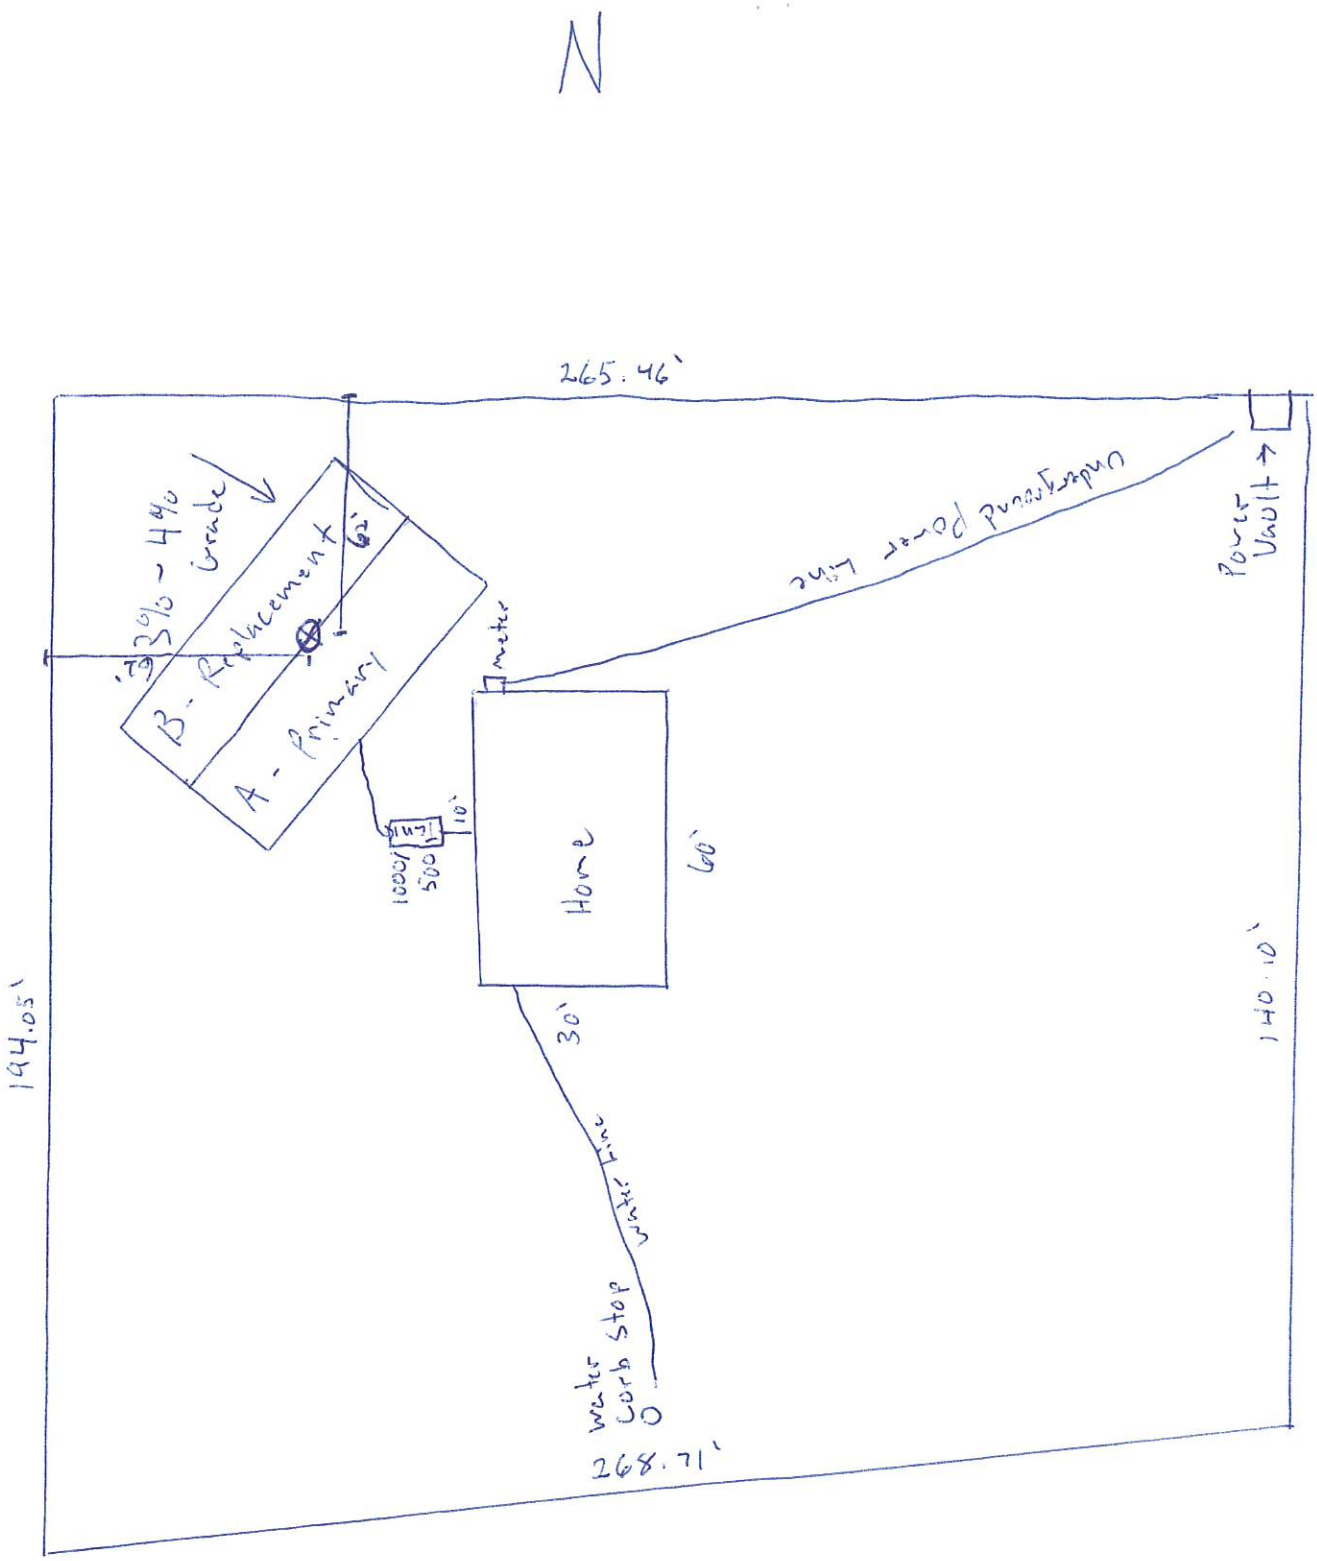
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 5/15/25

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


N
265.46'
3% - 4% Grade
B - Replacement
A - Primary
63'
Underground Power Line
Power Vault
meter
10'
1000/500
Home
60'
30'
194.05'
140.10'
Water Curb Stop
Water Line
268.71'