LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/20/2022 (11/02/2022 rev) Expiration Date: 10/19/2023

Property Owner: Donna Clark

Mailing Address: [redacted]

Telephone: [redacted] Email:

Installer: TBD (licensed installer required) License #:

Approved Work: (Check One) ☐ New Installation ☒ Existing System

☒ Replace Drainfield ☒ Replace Tank ☐ Extension

Describe: Gravity system with standard trenches, chambers

Parcel Description:

Legal: S1 T36N R27W, TR-2C&4C in SE or parcel 14 of CS 1475, 5.933 acres

Property Address: 1401 Indian Creek, Eureka, MT Assessment Code: 7336

Approved Design Criteria:

# of Bedrooms: 2 Septic Tank Size: 1000 gallons Trench Width: 24 inches

# of Laterals: 2 Length of Laterals: 76 feet Trench Depth: 24-36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Kathi J. Hooper, R.S.

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:


I, Buck Schermerhorn have inspected this system and found it to be in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Buck Schermerhorn *Date:* 11/29/23

____ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

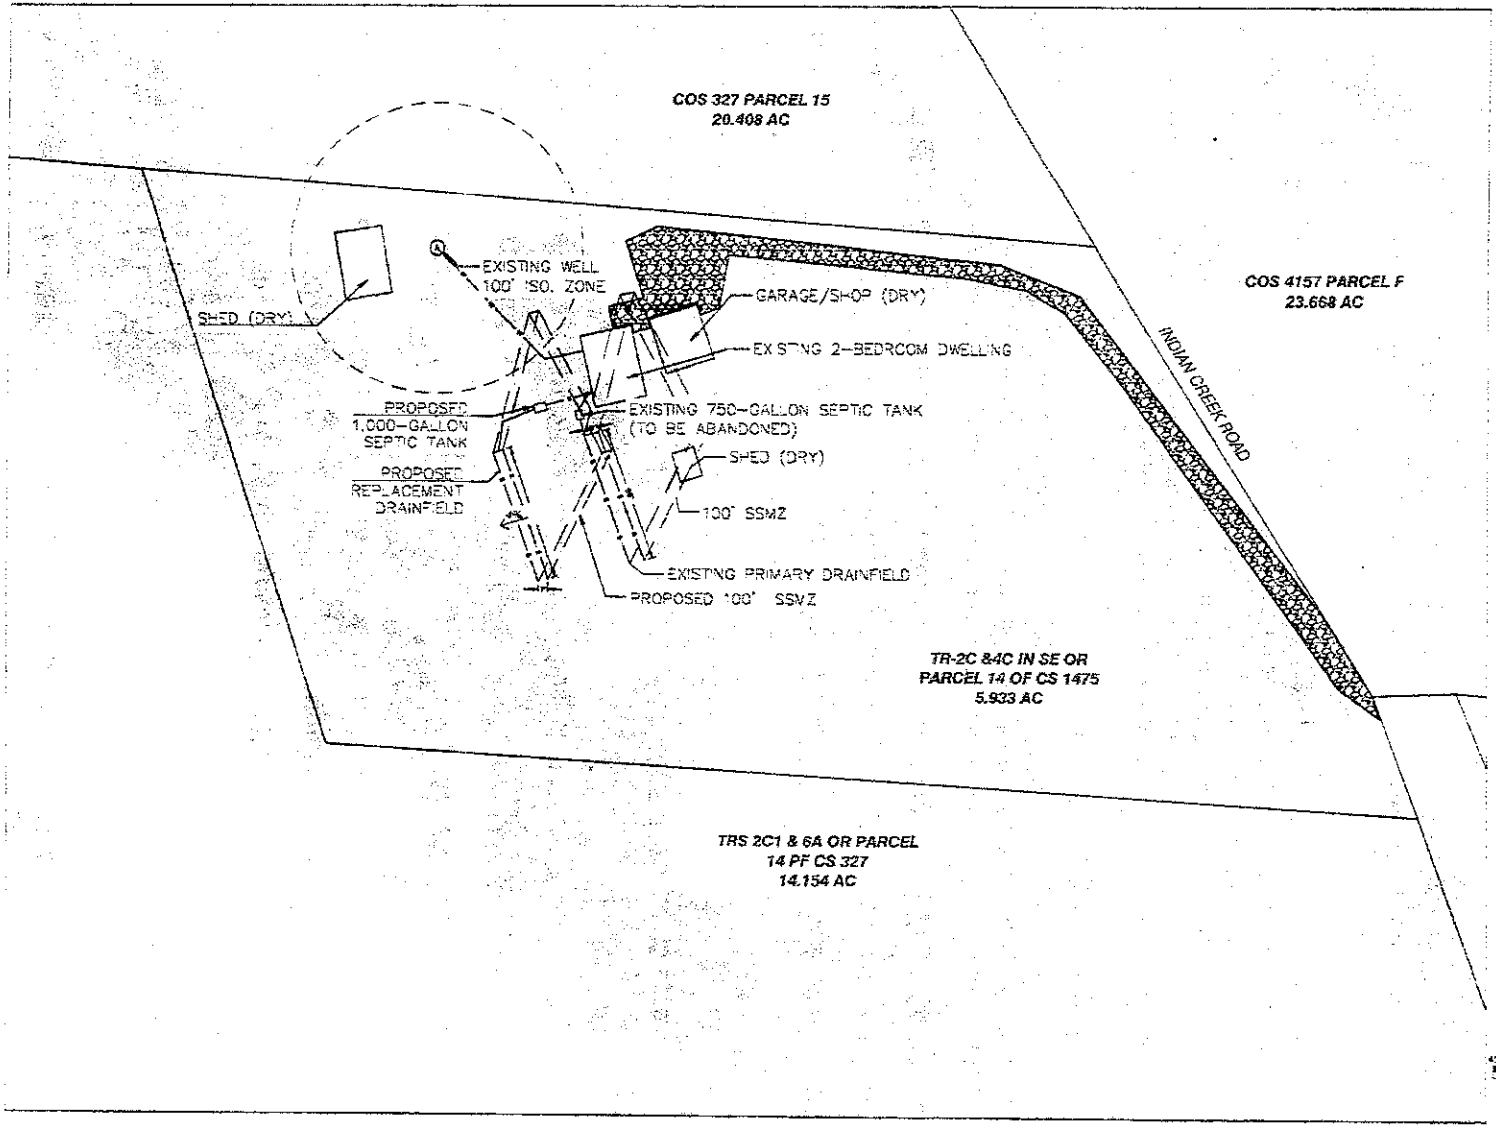

DONNA CLARK

SEPTIC PERMIT

1401 INDIAN CR. RD, EUREKA, MT

S1 T36N R27W LINCOLN CO.

10/3/2022

SITE LAYOUT

1