LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Permit #24-8116

Issue Date: 06/10/2024 Expiration Date: 06/09/2025

Property Owner: Jeff David

Mailing Address: [redacted]

Installer: Brian Anderson License #: 175

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new shallow capped septic system.

Parcel Description:

Legal: S33; T31 N, R31 W, ACRES 18, TR 3A7 IN E2SESW, 8116

Property Address: 1314 W. 2nd Street Ext., Libby, MT Assessment Code: 8116

DEQ COSA: EQ# Date:

Approved Design Criteria: Installation of new shallow capped septic system for bathroom in garage.

# of Bedrooms: 1 Septic Tank Size: 1000/500 gallons Trench Width: 24"

# of Laterals: 2 Length of Laterals: 50' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

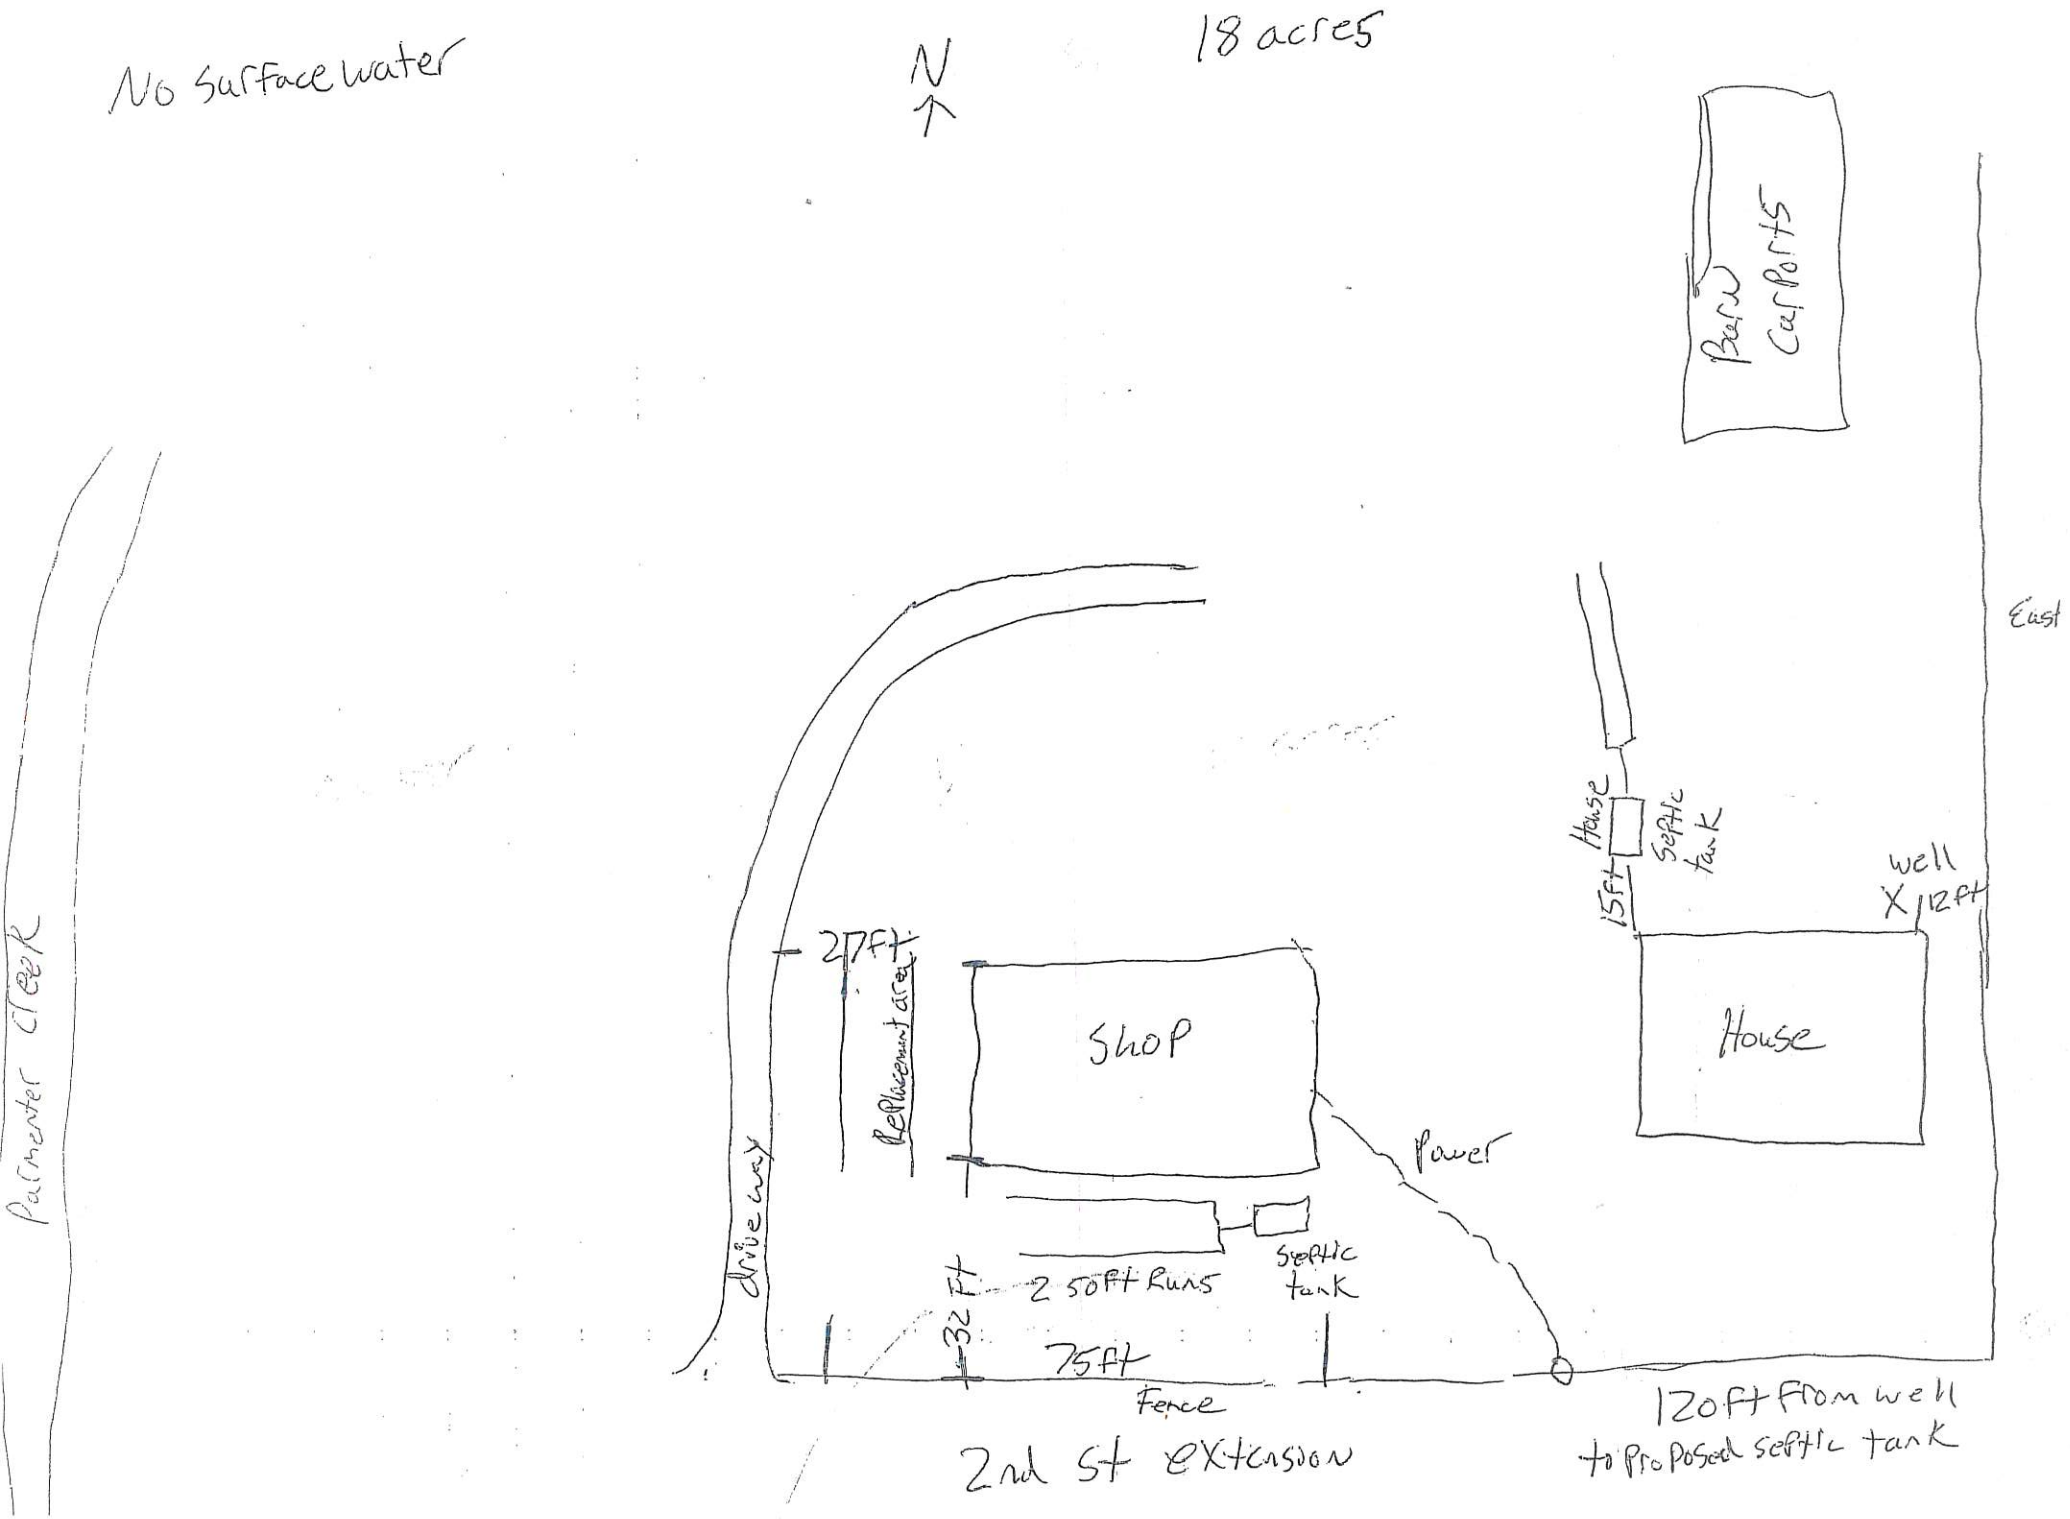
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: John Blmly *Date:* 4/29/25

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


No surface water
N
18 acres
Barn
Carports
East
Palmenter Creek
House
Septic tank
15ft
well
X
12ft
House
27ft
Replacement area
Shop
Power
Driveway
Septic tank
2 50ft Runs
32 ft
75ft
Fence
120ft from well
to Proposed septic tank
2nd St extension