LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/09/2022 Expiration Date: 8/08/2023

Property Owner: Roger Davis

Mailing Address: [redacted]

Telephone: [redacted] Email:

Installer: Sawtooth Excavating LLC License #: 160

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: standard 2' wide trenches, gravity system, infiltrators/chambers

Parcel Description:

Legal: Camp View, Lot 2C, S5 T29N R33W, 7.71 acres

Property Address: 245 N Ridgeway, Troy Assessment Code: 52520

Approved Design Criteria:

# of Bedrooms: 1 Septic Tank Size: 1000 gallons Drainfield Size: 250 square feet

# of Laterals: 2 Length of Laterals: 50 lineal feet Trench Depth: 24 - 36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. 20% reduction given for infiltrators. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Jaxon Munts *Date:* 8/12/22

____ Lincoln County Health Department (LCHD) X Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LINCOLN COUNTY, MONTANA
LOT LAYOUT
LOT 2 OF AMENDED CAMP VIEW SUBDIVISION
IN THE S 1/2 OF SECTION 5
TWP. 29 N., R. 33 W., P.M.M.

FOR: RUSSELL BARNES DATE: DECEMBER 2004

DETAIL OF DITCH
1 1/2" TO 2"
WASHED ROCK


4X1 4X1

ALONG THE UPPER
DITCH LINES OF
APPROACH ROADS

APPROVED
Montana Department of
Environmental Quality
Permitting and Compliance Division
Reviewer 6/6/05 Date

LEGEND

- SOILS PROFILE
- PERCOLATION SITE
- PROPOSED WELL SITE
- STORMWATER POND 20'X30'X2'
- SLOPE
- GRADIENT DIRECTION
- PROPOSED SEPTIC SITE 3-85' TRENCHES 10' APART
- REPLACEMENT SITE 3-85' TRENCHES 10' APART
- 20' MIXING ZONE

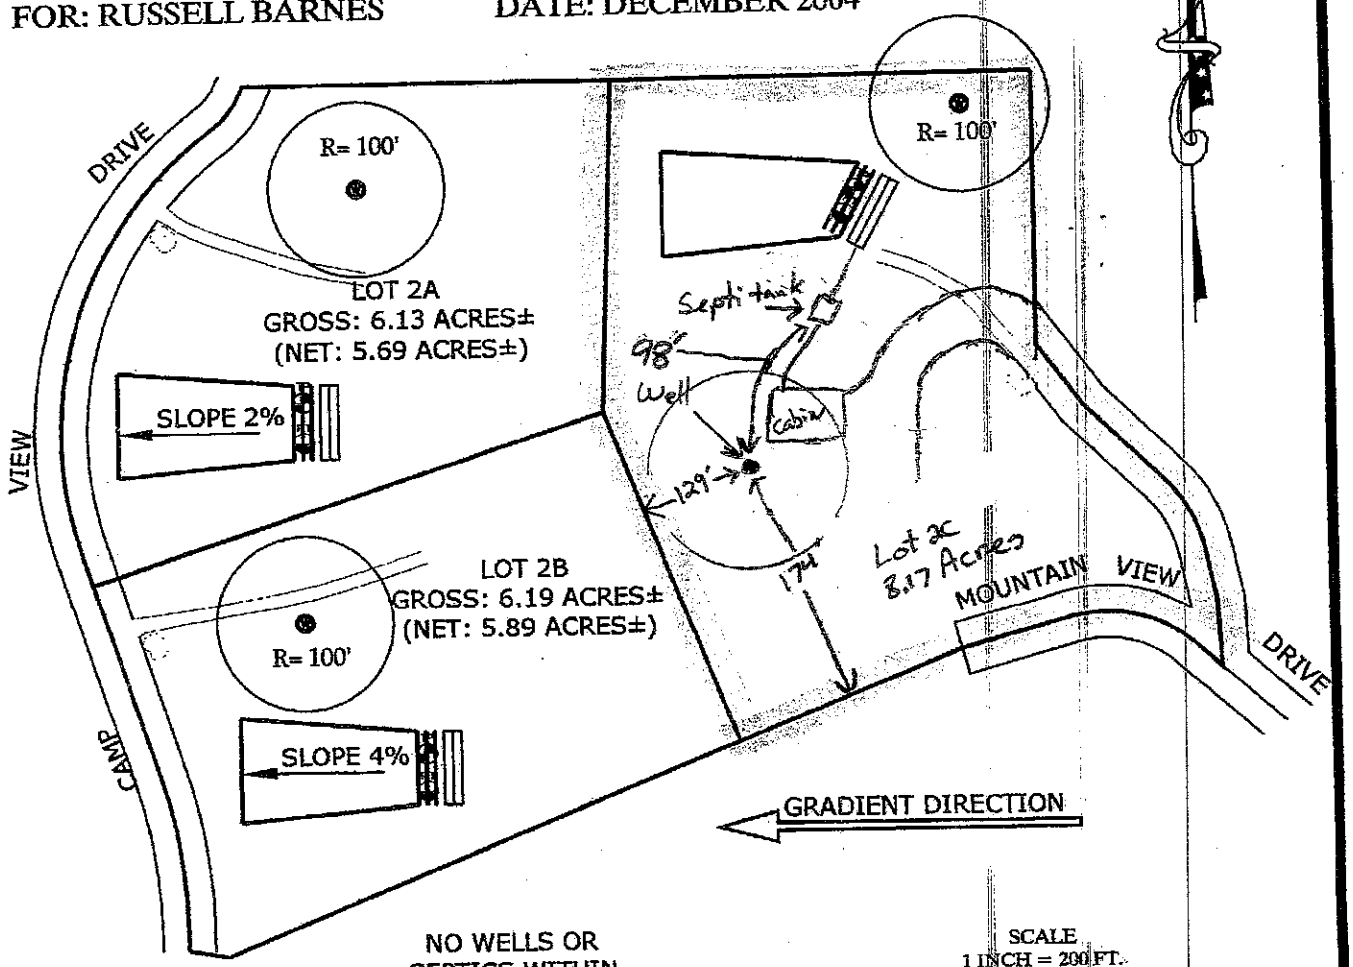

NO WELLS OR
SEPTICS WITHIN
100' OF PROPERTY
BOUNDARIES

SCALE
1 INCH = 200 FT.

Davis Surveying Inc.
TROY MONTANA, (406)295-5441

DATE: 2/15/05	
DRAWN BY: MDM	FILE: T29R33S5.DWG

RECEIVED
FEB 25 2005
MT DEQ PUBLIC WATER
& SUBDIVISIONS BUREAU