LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/21/2022 (rev 8/31/22) Expiration Date: 07/20/2023

Property Owner: Kent Dery

Mailing Address: [redacted]

Telephone: [redacted] Email:

Installer: Elmer Brenneman License #: 170

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Gravity system, standard 2' wide trenches, chambers, 3 bdrm house & shop bathroom

Parcel Description:

Legal: S26 T36N R28W, Warland Subdivision Lot 1, 3.03 acres

Property Address: [redacted] Annerly Ferry Rd, Rexford, MT Assessment Code: 55692

Approved Design Criteria:

# of Bedrooms: 4 Septic Tank Size: 1500 gallons Drainfield Size: 816 sq ft

# of Laterals: 6 Length of Laterals: 68 feet Trench Depth: 24-36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. 10% reduction given for chambers. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

I, Elmer Brenneman *, have inspected this system and found it to be in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.*

Signed: Elmer Brenneman #170 *Date:* 09-17-22


____ Lincoln County Health Department (LCHD) X Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

5

= drainfield site
) replacement area
) wellsite w/100' isolation
) mixing zone

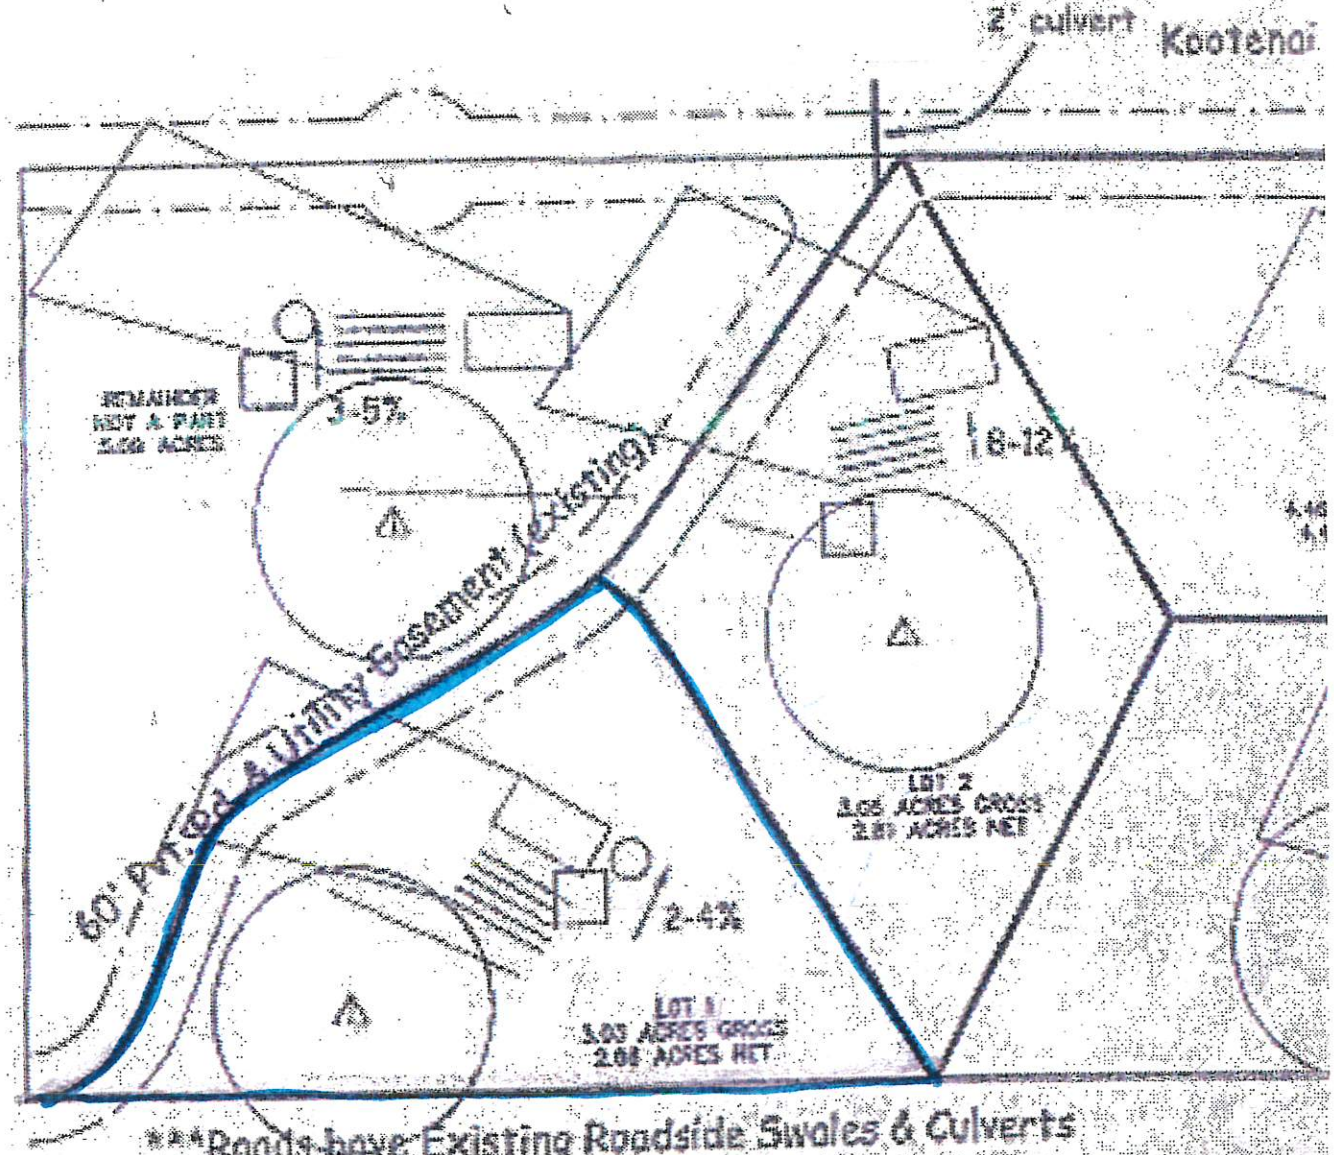

***Roads have Existing Roadside Swales & Culverts

Drainfield sizing = 5 laterals @ 75' each lot

Driveway

Enviro-Tech Consulting Inc.
PO Box 5674
Kalispell, MT 59903
(406)261-7565