LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/20/2022 (10/25/2022 rev) Expiration Date: 10/19/2023

Property Owner: Phillip Epps and Sandra Jones

Mailing Address: [redacted]

Telephone: [redacted] Email:

Installer: TBD License #:

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Gravity system for bathroom in shop, standard trenches, chambers

Parcel Description:

Legal: S35 T32N R34W, Tr 1 BC in Lot 2, 5.175 acres

Property Address: 2561 River Rd, Troy, MT Assessment Code: 6524

Approved Design Criteria:

Shop bathroom only Septic Tank Size: 1000 gallons Trench Width: 24 inches

# of Laterals: 2 Length of Laterals: 48 feet Trench Depth: 24-36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. 20% reduction for chambers. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

I, Maranda Davis *, have inspected this system and found it to be in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.*

Signed: Maranda Davis, Envir. Health Tech. *Date:* 11/2/22

X Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER


This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV

LINCOLN COUNTY, MONTANA

TRACT 1BC, LOT LAYOUT

PER PF #700
SECTION 35, TWP. 32 N., R. 34 W., P.M.M.
FOR: PHILLIP D. EPPS & SANDRA JONES
DATE: SEPTEMBER 2022

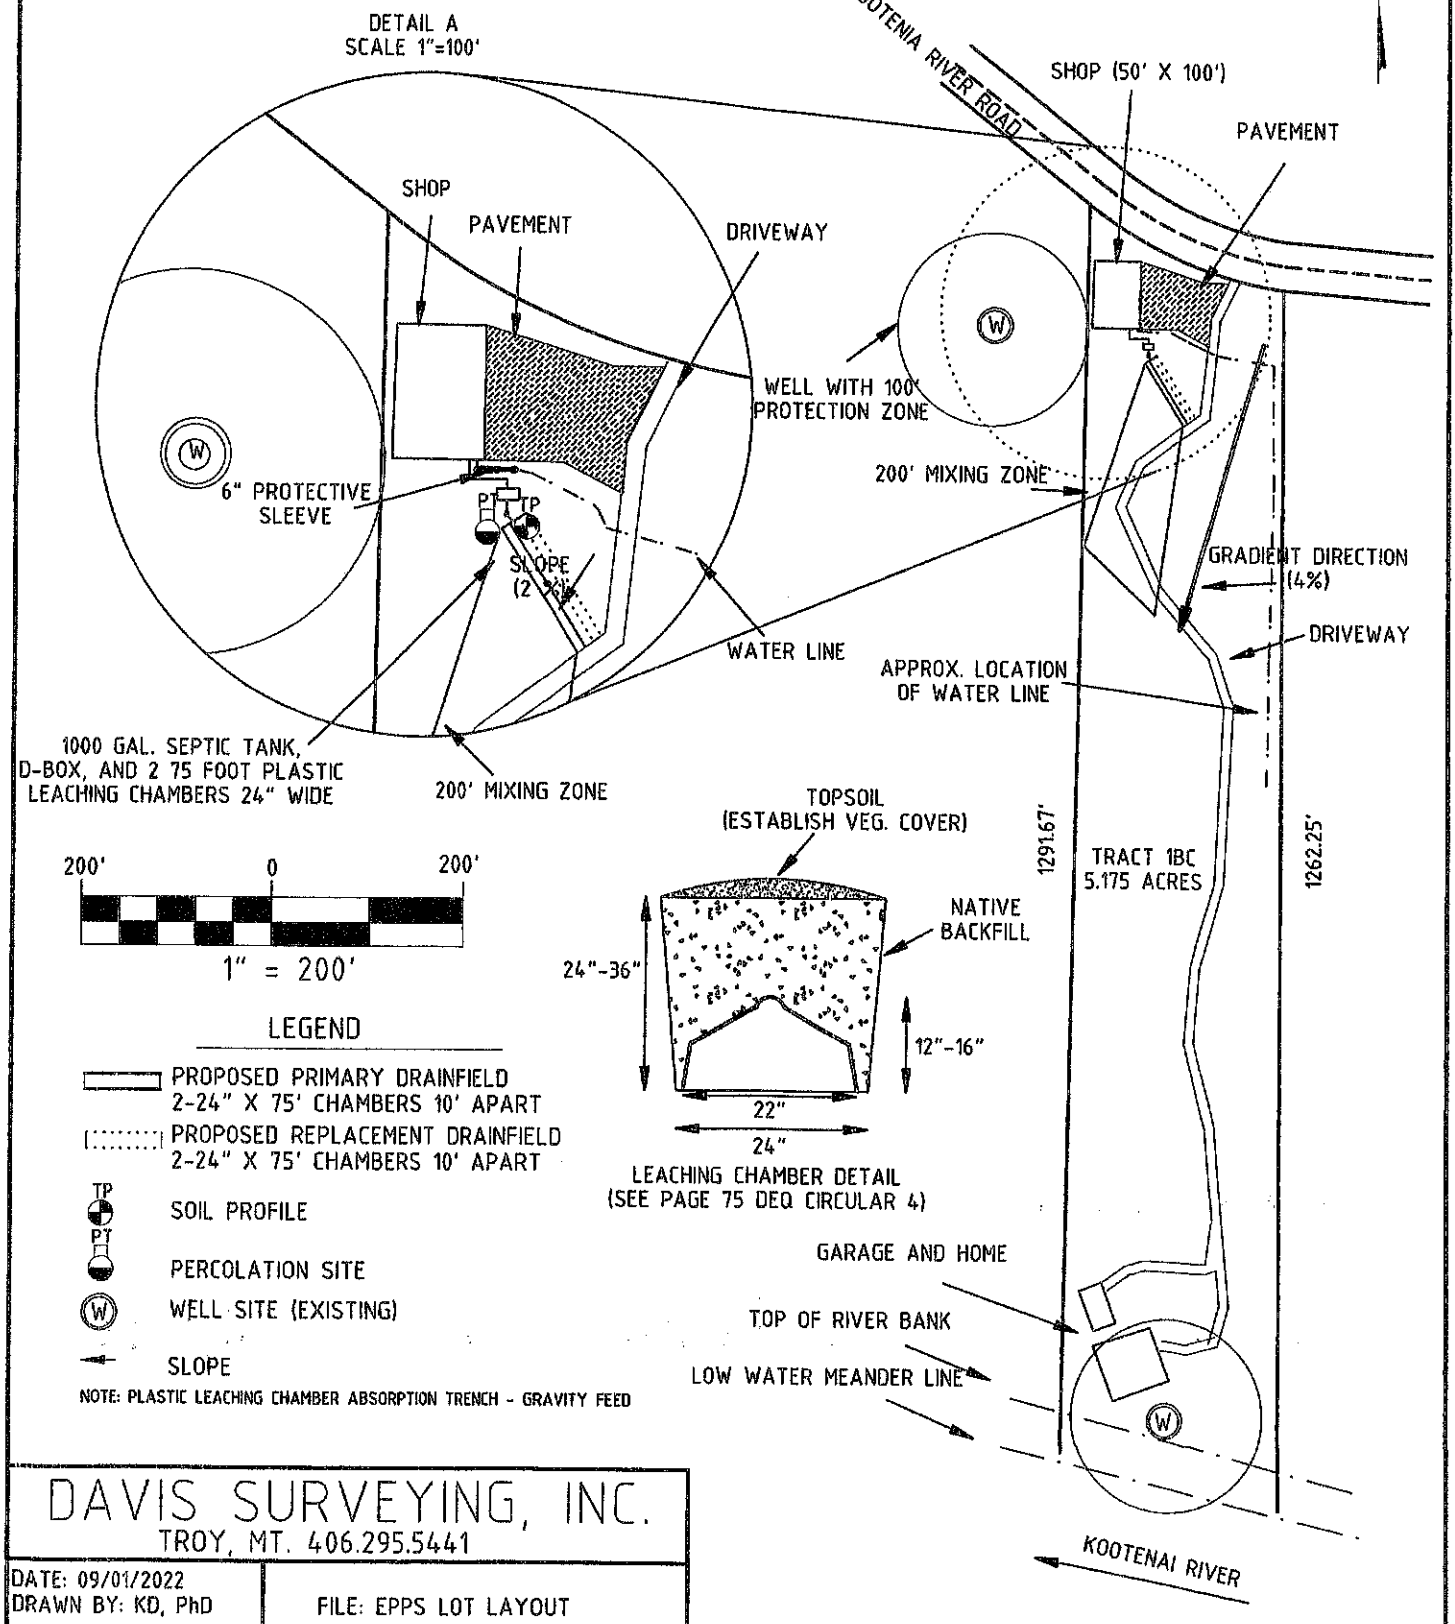

LEGEND

- PROPOSED PRIMARY DRAINFIELD 2-24" X 75' CHAMBERS 10' APART
- PROPOSED REPLACEMENT DRAINFIELD 2-24" X 75' CHAMBERS 10' APART
- TP — SOIL PROFILE
- PT — PERCOLATION SITE
- W — WELL SITE (EXISTING)
- SLOPE

NOTE: PLASTIC LEACHING CHAMBER ABSORPTION TRENCH - GRAVITY FEED

DAVIS SURVEYING, INC.
TROY, MT. 406.295.5441

DATE: 09/01/2022
DRAWN BY: KD, PhD

FILE: EPPS LOT LAYOUT