LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/01/2022 Expiration Date: 04/01/2023

Property Owner: Fitzpatrick, Douglas c/o:

Address: [redacted]

Telephone: [redacted]

Installer: Kootenai Sand and Gravel License No. 109

__XX__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: 1,000-gallon septic tank with effluent filter. Gravity feed system with traditional absorption trenches. 4 laterals at 94-feet in length each.

Parcel Description:

Legal: S25, T33 N, R26 W, N2NWNE OR TR 1 & 1AB CS 1959

Address or Location: 1865 Jim Creek Rd, Trego, MT 59934

Geo/Assessors code: 0000001443

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1,000 gallon Drainfield Size: 375 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: ***INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.*** **SEPTC TANK TO BE INSTALLED AT LEAST 50-FEET FROM THE EXISTING WELL.**

Issued By: Nicholas Raines

Closure Statement:

I, Donavan Truman, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

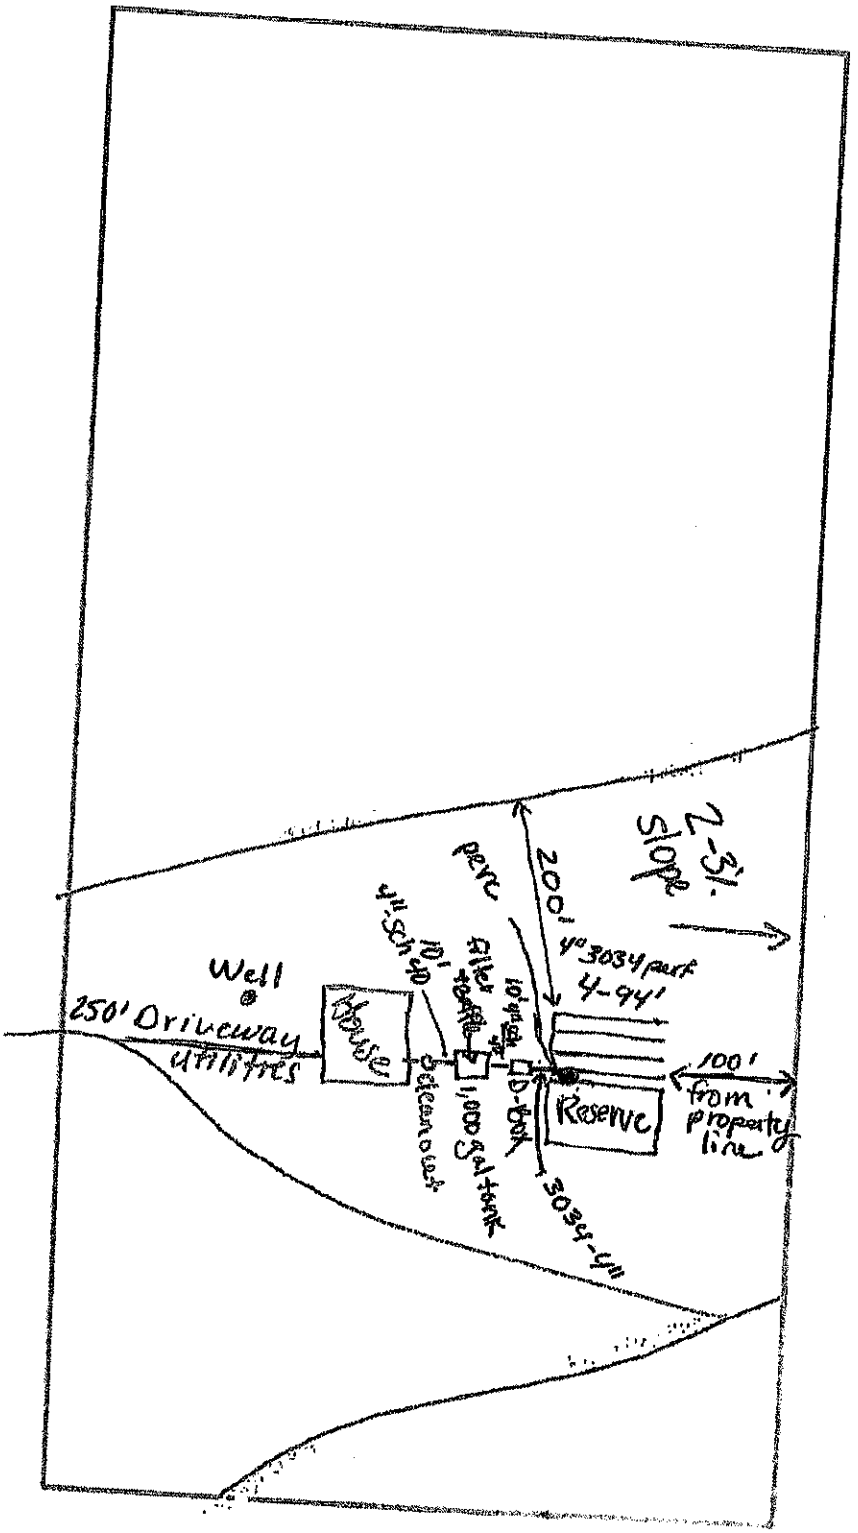
Signed: [signature] *Date:* 9/15/22

Title: Licensed Installer

NOTICE: The Department must be notified at least 48 business hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.
406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Well
250' Driveway
utilities
House
4" Sch 40
10'
Alter trench
perc
200'
4" 3034 part
4-94'
10' septic tank
D-box
Reserve
100' from property line
Pedestal pipe
1,000 Gal tank
3034-411
2-3% slope
N

.1