LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
AFFIDAVIT OF WASTEWATER TREATMENT AND DISPOSAL SYSTEM COMPLIANCE REVIEW FOR SYSTEM INSTALLED, REPAIRED OR REPLACED WITHOUT A VALID PERMIT

Issue Date: 7/21/2022 -2023

Property Owner: Gateway Freedom Ranch c/o Buck Schermerhorn

Mailing Address: [redacted]

Telephone: [redacted]

Who Installed System Being Reviewed: D&H Hauling & Excavation Date Installed: 2016

Type of System Work Reviewed:

xx New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Use of System: Garage with one bathroom (toilet & sink only) used as classroom for 10 people max

Property Description:

Legal: S27 T36N R26W, COS 1935, Parcel A, 20.012 acres

Address or Location: 111 Glen Lake Dr, Eureka, MT 59917

Reviewed System Components:

Maximum Discharge: 110 gpd Septic Tank: 1000 gallons Drainfield Construction: 2' chambers

# of Laterals: 2 Length of Laterals: 52' Trench Depth: 36 inches

Comments: Gravity system using 1000 gallon tank and 2' wide infiltrator galleries in gravelless trenches. System components (including tank, d-box, and drainfield) were inspected by Montana Design Services on 6/22/22 and 6/24/22 and reported to be in working order. System is appropriately sized for wastewater flows of 110 gallons per day. Any future extension, repair, replacement or increase in wastewater flows must be reviewed and permitted by Lincoln County Health Department.


System Review Documentation Statement:

I, Kathi Hooper *, have reviewed the components of this system as listed above and found it to be in compliance with the requirements of A.R.M. Chapter 17.36 Subchapter 9, Circular DEQ-4 and Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 7-21-22

Title: Director

NOTICE: This document is not a permit for installation, repair or alterations of a wastewater treatment and disposal system. It is a statement that the Department has conducted a review of this system and found it to be in compliance with applicable requirements, making it a legal system for the use described above. The Department does not guarantee that this system will continue to function properly for any period of time.

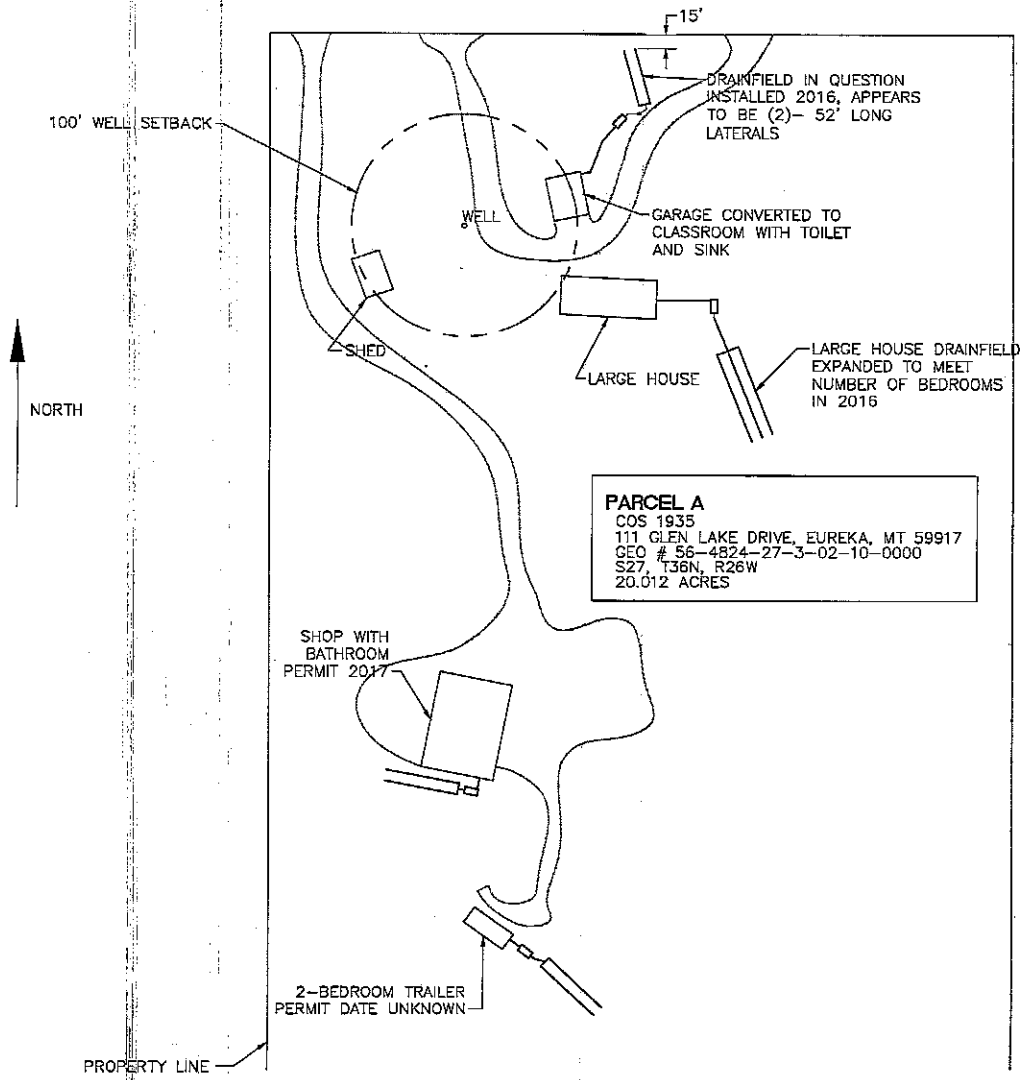

GATEWAY FREEDOM RANCH SITE LAYOUT

REV	DATE	COMPANY	SCALE:	D & HAULING
		D/H	1/16 & NOTED	MAREK SITE LAYOUT
		CONTRACT:	DATE:	SITE LAYOUT
		VERSAL	8/2022	SCHEMATIC/DESIGN 8/20/22
		PLOT FILE:	WEIGHT:	D. PLUID 8/20/22
		PML-0001		DESIGN: MAREK SHEET 1

THIS DRAWING IS PROPERTY OF DAN LIVIS, CONTRACT AND MUST RECEIVE WRITTEN CLEARANCE BEFORE IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM DAN MANAGEMENT