LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 3/25/2023 Expiration Date: 3/24/2024

Property Owner: Joel W. Geddes Jr

Mailing Address: [redacted]

Telephone: [redacted] Email:

Installer: Bobbie Jo Sprague License #: 182

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Pressure dosed system with standard 3' wide trenches, chambers

Parcel Description:

Legal: Scenery Hill 2, Lot 3, S15 T36N R27W, 20.3 acres

Property Address: 750 Scenery Hill Dr, Rexford, MT Assessment Code: 53867

Approved Design Criteria:

Bedrooms: 3 & RV Connection Septic Tank Sizes: 1500/500 gallons Trench Width: 36 in

# of Laterals: 7 Length of Laterals: 96 lineal feet Trench Depth: 24 - 36 in

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks must be met. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

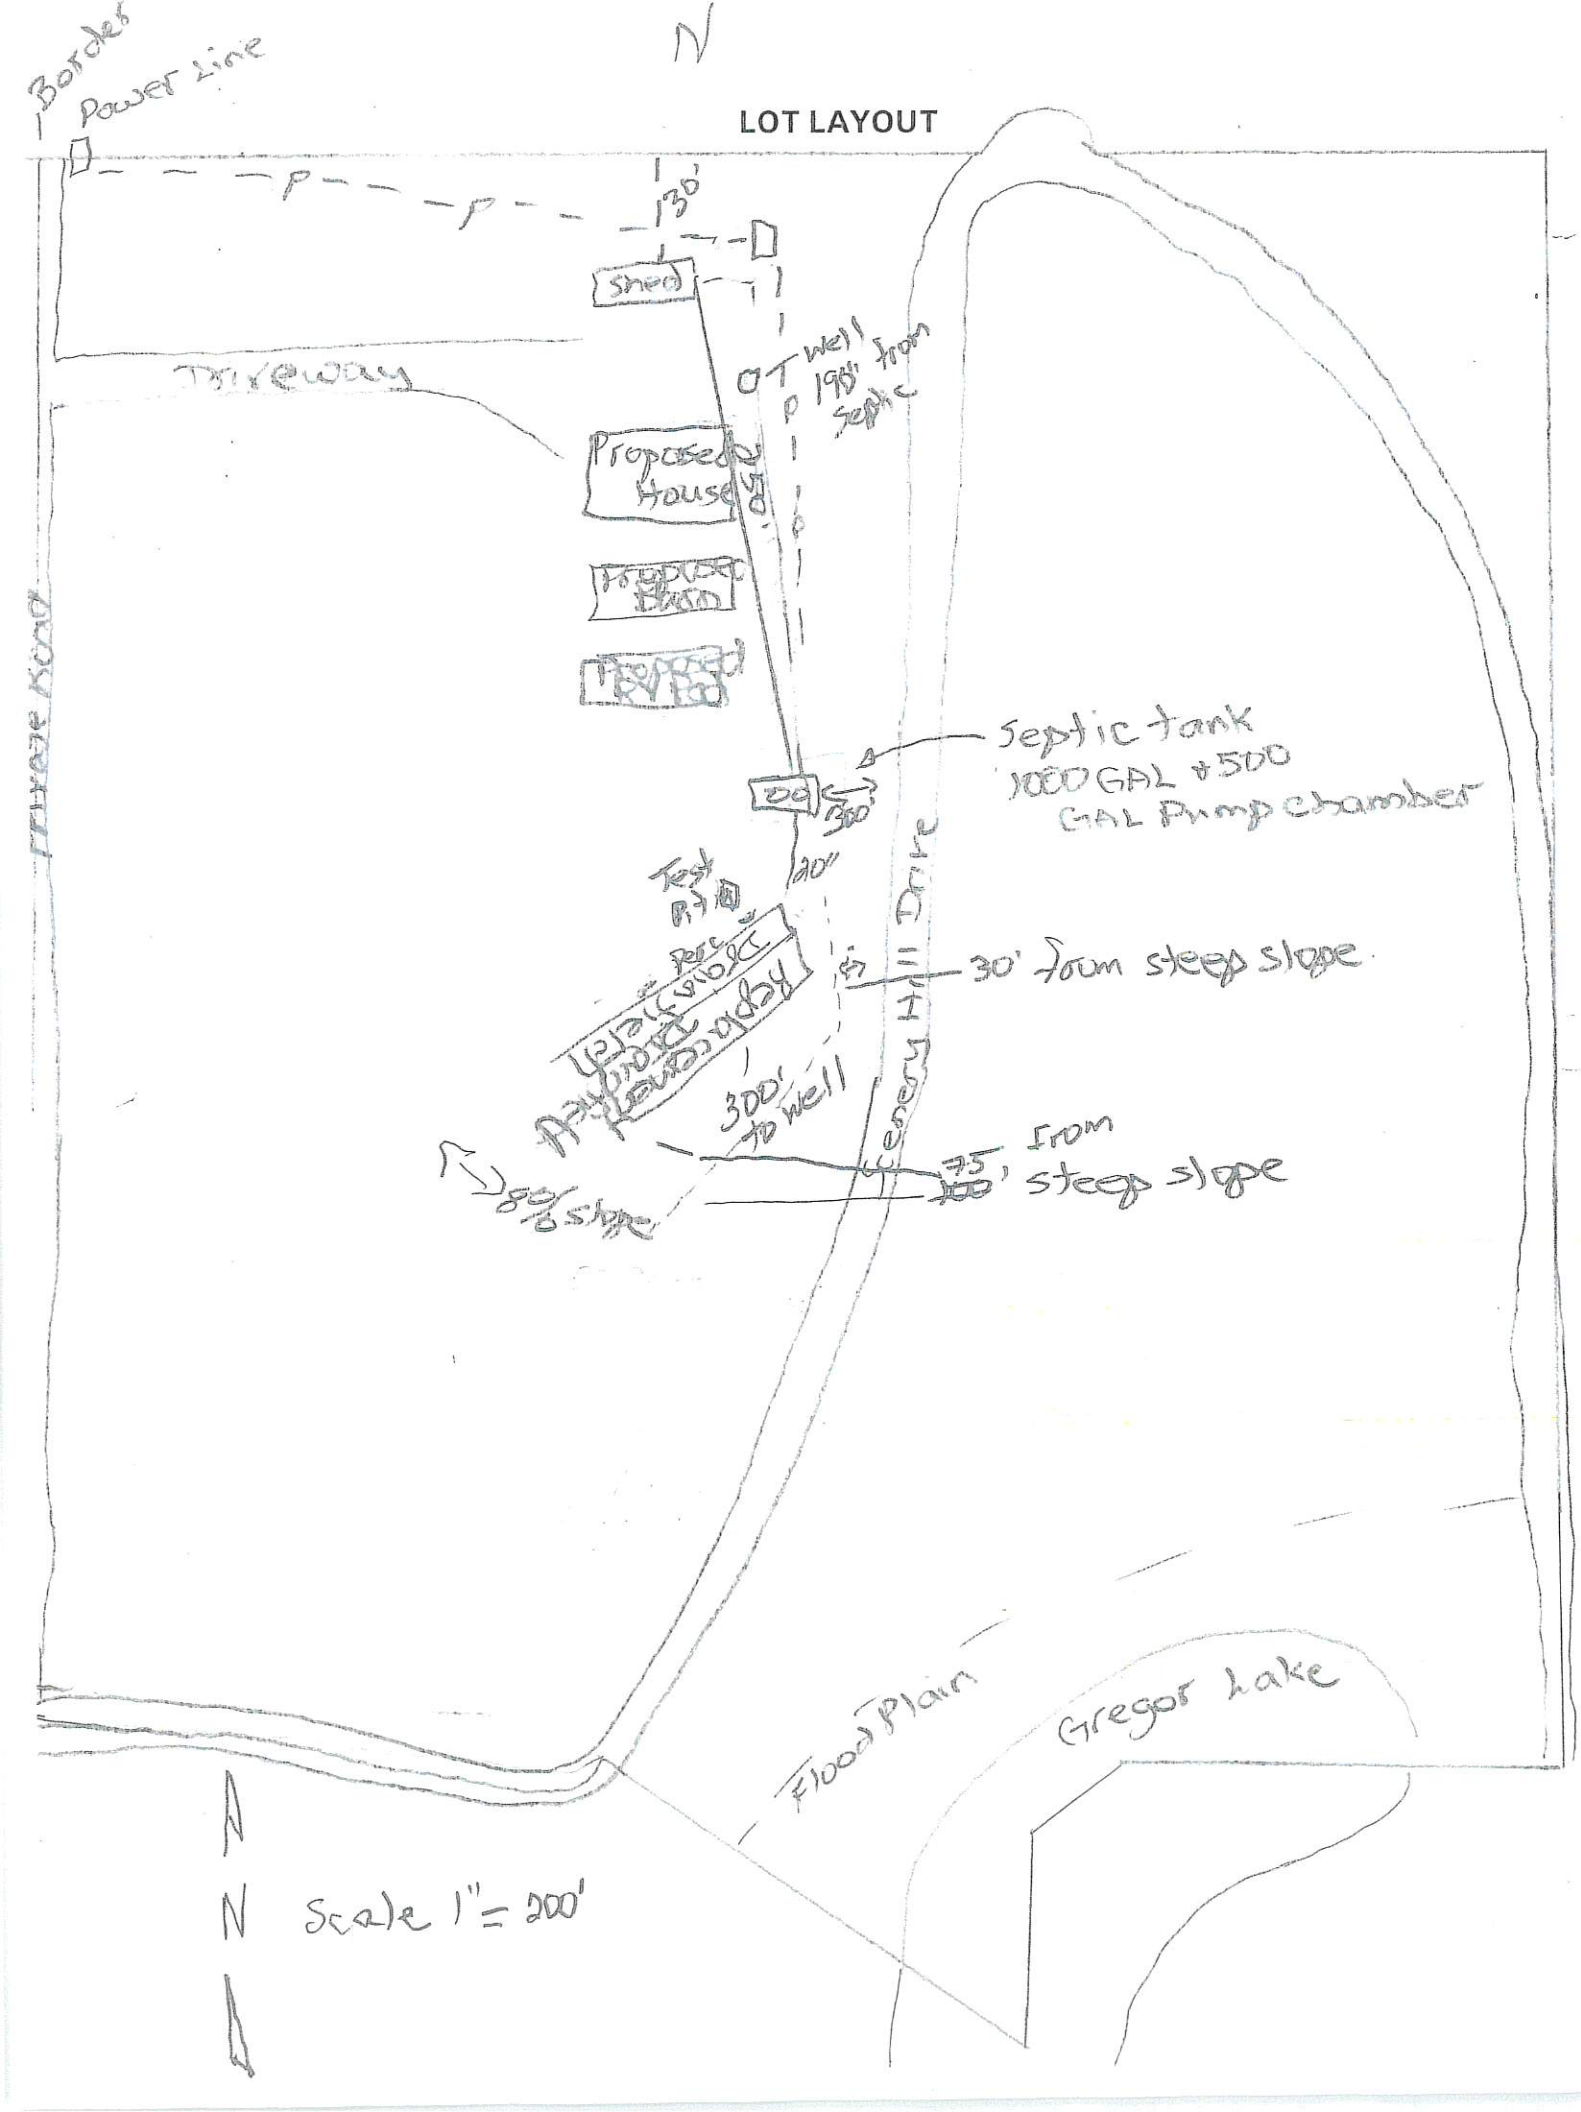
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

_____ Lincoln County Health Department (LCHD) _____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


LOT LAYOUT
Border
Power Line
N
130'
Shed
Driveway
Well
198' from
Septic
Proposed
House
Proposed
Shed
Proposed
RV Pad
Ridge Road
Septic tank
1000 GAL & 500
GAL Pump chamber
120'
Test
Pit
Perc
Area
Proposed
Leach Field
30' from steep slope
Access
Drive
300'
to well
75'
100'
from
steep slope
15% slope
Flood Plain
Gregor Lake
N
N
Scale 1" = 200'