LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 11/03/2022 Expiration Date: 11/02/2023

Property Owner: Tyler Handy

Mailing Address: [redacted]

Telephone: [redacted] Email: [redacted]

Installer: homeowner (inspection required) License #:

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Gravity system with standard trenches, chambers

Parcel Description:

Legal: Tract 1 of COS 4753, S33 T37N R27W, 14.51 acres

Property Address: Happy Holw, Eureka, MT Assessment Code: 13318

Approved Design Criteria:

# of Bedrooms: 4 Septic Tank Size: 1500 gallons Trench Width: 24 inches

# of Laterals: 2 Length of Laterals: 84 feet Trench Depth: 24-36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. 25% reduction given for chambers. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

_____ Lincoln County Health Department (LCHD) _____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


5

REVISED LOT LAYOUT PARCEL 'A' OF ES# 27-83-S52-1276

CURRENTLY KNOWN AS TRACT 1 OF COS 4753 RB

W ½ OF SECTION 33, T 37N, R27W

LINCOLN COUNTY, MONTANA

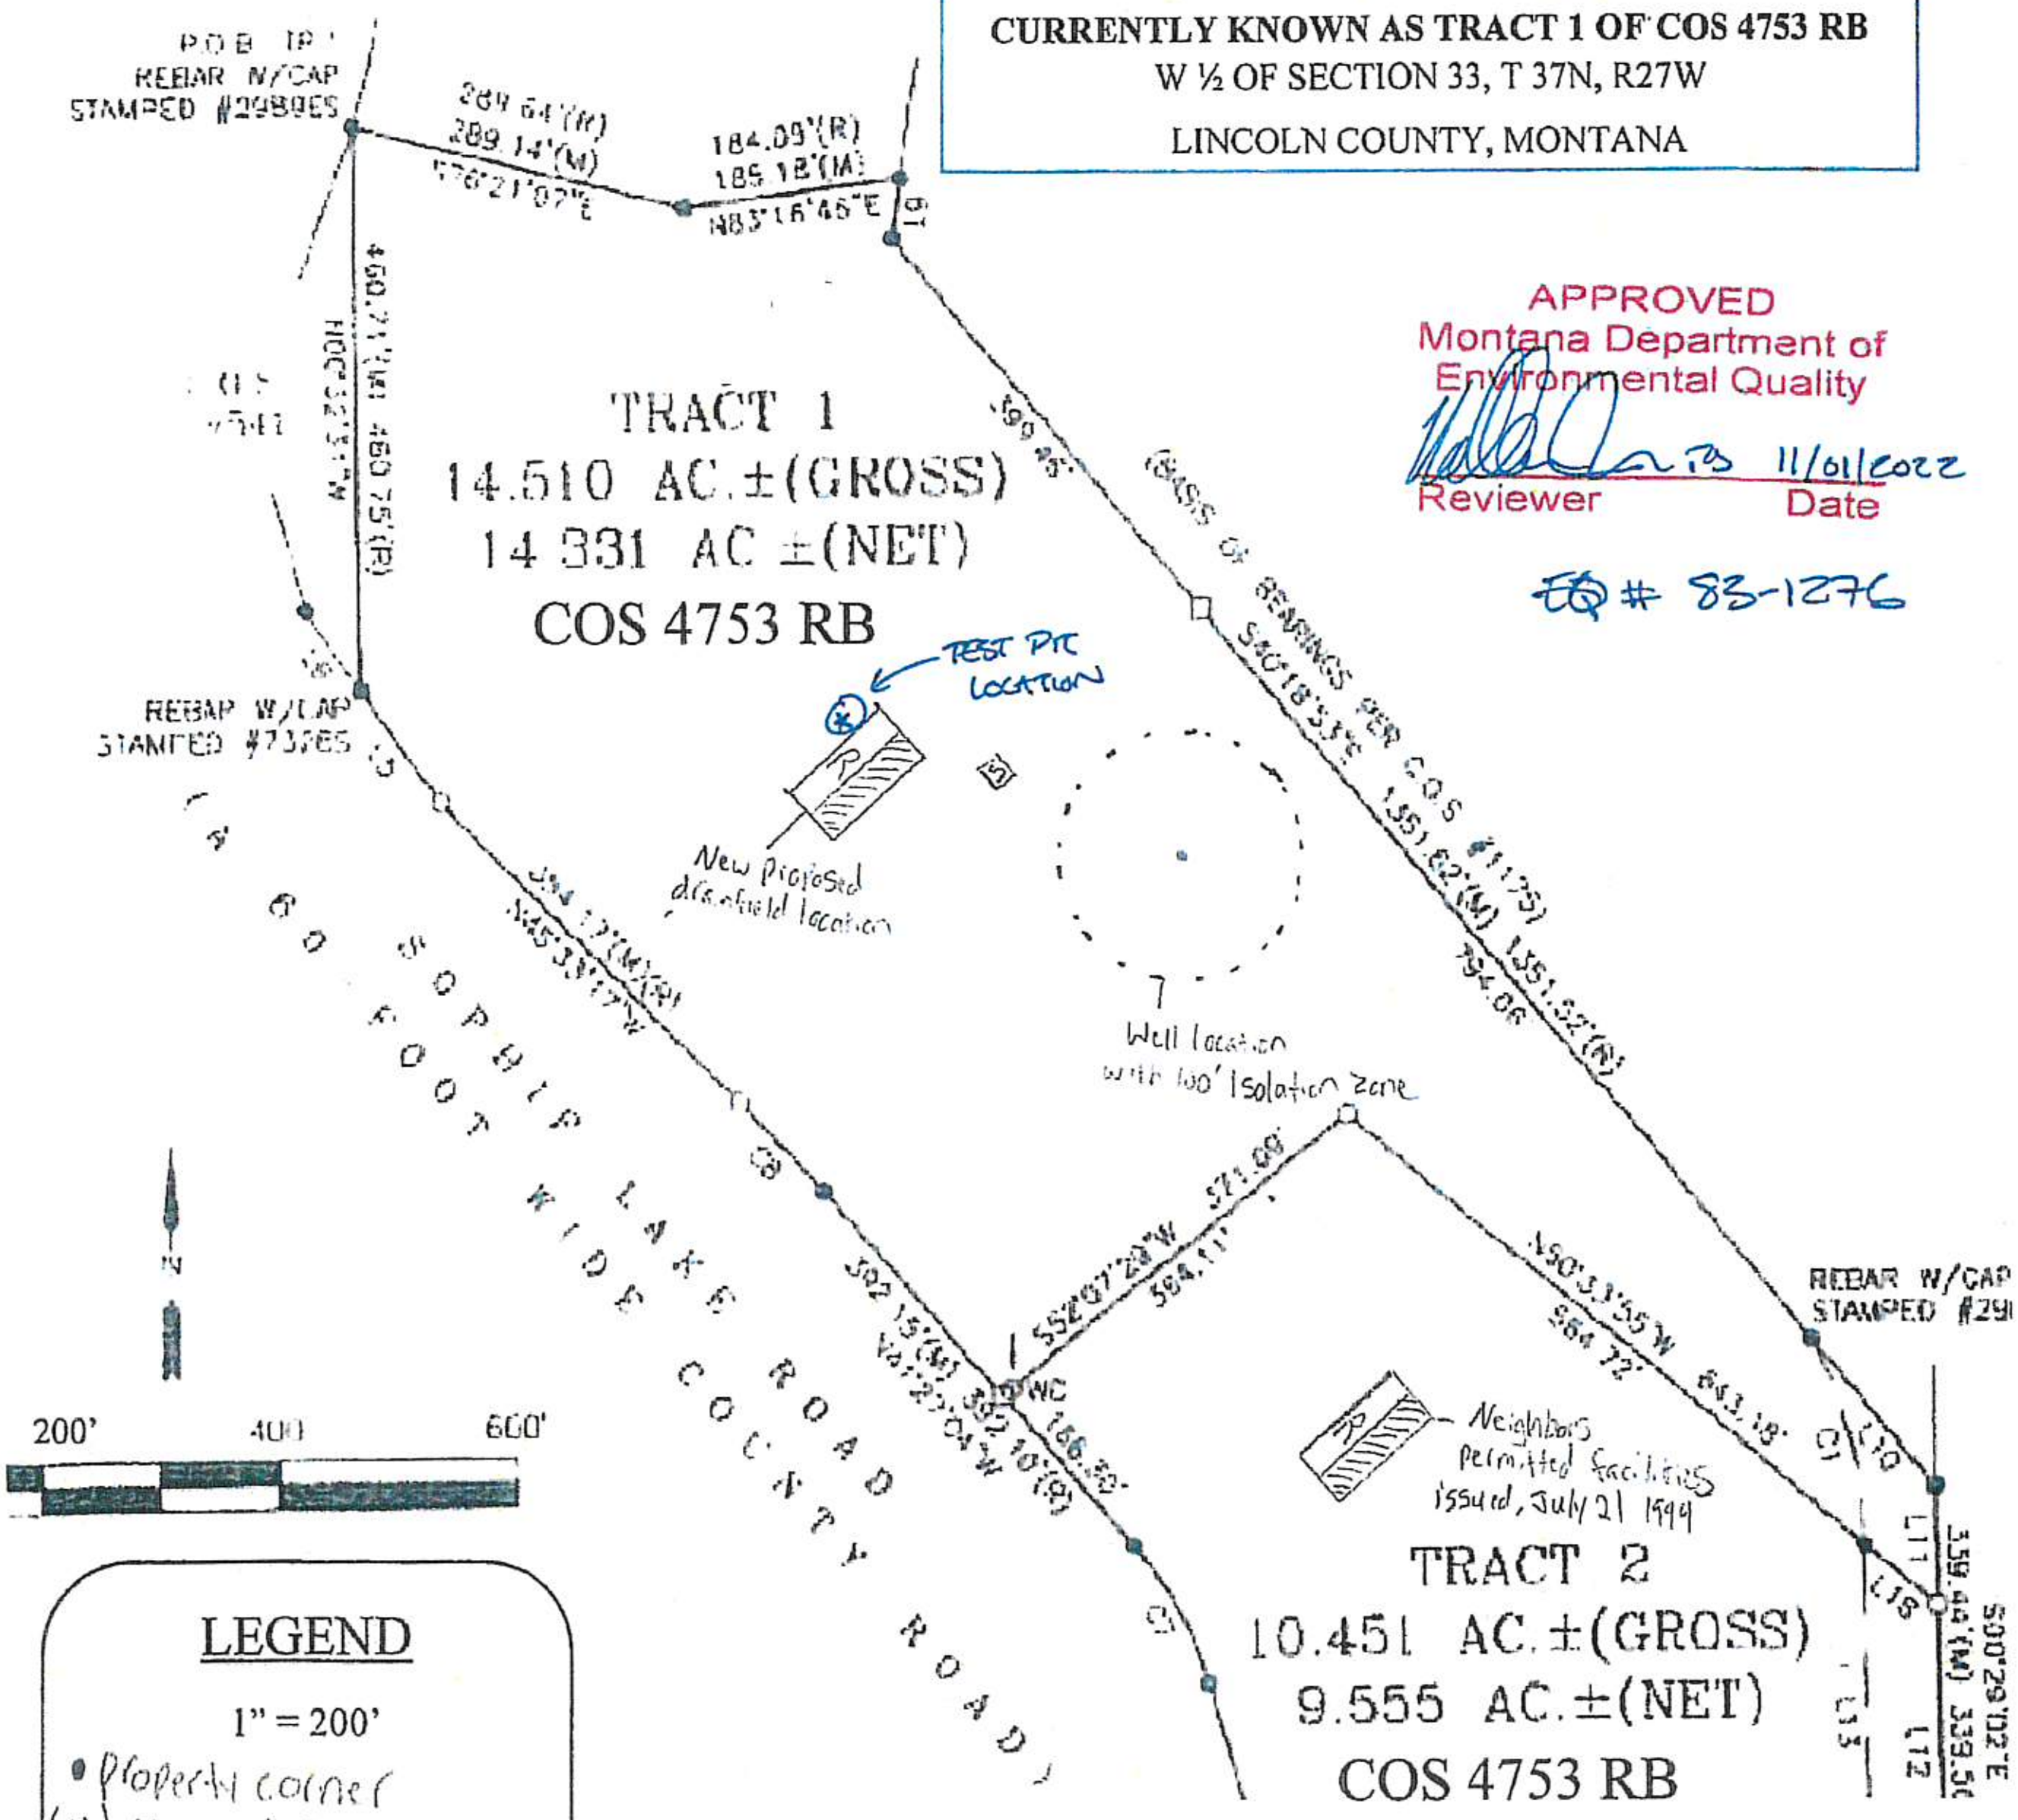

APPROVED
Montana Department of
Environmental Quality
Reviewer 11/01/2022
Date

EQ# 83-1276

LEGEND

1" = 200'

- • Property corner
- (M) Measured Distance
- (R) Recorded Distance
- [R] Drainfield & Replacement area
- ( ) Existing well w/100' Radius isolation zone
- [S] 1,500 gal septic tank
- (*) TEST PIT LOCATION

* There are no known wastewater treatment systems within 100' of the property boundaries other than the facilities shown

RECEIVED
OCT 29 2022
MT DEQ PUBLIC WATER
& SUBDIVISIONS