LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 3/13/2023 Expiration Date: 3/12/2024

Property Owner: Justin & Sue Haveman

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Koocanusa Plumbing License #: 169

Approved Work: (Check One) ☐ New Installation ☒ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Connect accessory building to existing WWTS, add grinder pump at new building

Parcel Description:

Legal: Berger Lake Ph 3, Lot 12, S25 T37N R27W, 5.001 acres

Property Address: 250 Berger Lane, Eureka Assessment Code: 53279

Approved Design Criteria: Main dwelling is 1 bdrm, accessory bldg. is 1 bdrm with bathroom only. Accessory bldg. may not include kitchen or laundry without DEQ rewrite and new permit.

# of Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 380 square feet

# of Laterals: 2 Length of Laterals: 95 lineal feet Trench Depth: 24 - 36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: [signature] *Date:* 6-13-23


____ Lincoln County Health Department (LCHD) _✓_ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

3✓

Lot 12 Berger Lake Unit III
5.001 Acres

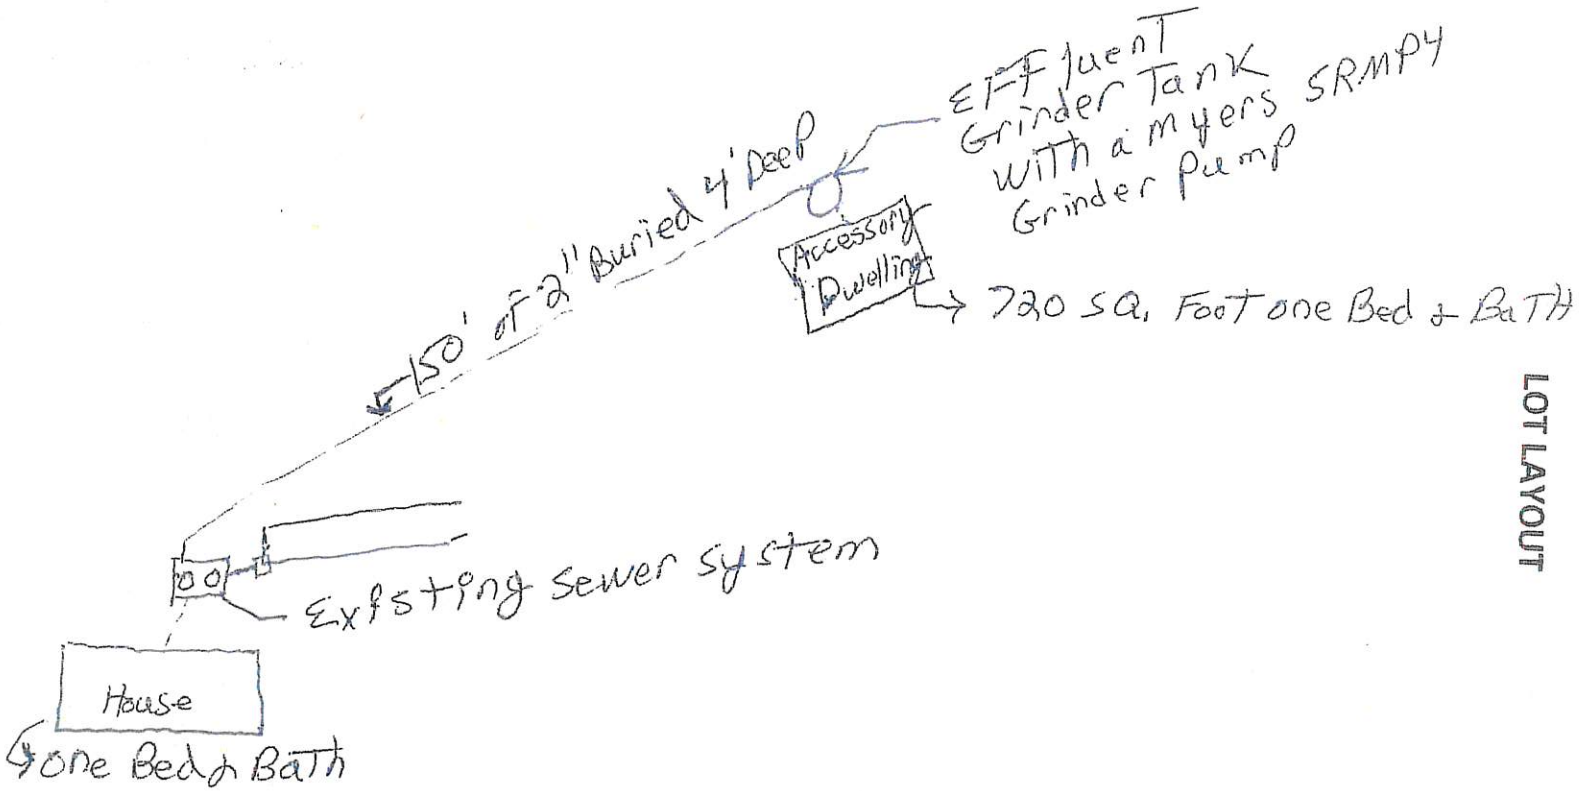

LOT LAYOUT

Assessment Code